


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Arrow Linen
05/01/05 to 05/31/05


Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
05/01/05	100.00	0.25	n/a	99.68	0.00	0.00	-
05/02/05	100.00	15.25	n/a	43099.72	22357.38	0.00	100.00
05/03/05	99.48	14.75	n/a	41698.92	21513.20	0.00	100.00
05/04/05	99.48	13.75	n/a	39599.32	20812.62	0.41	100.00
05/05/05	98.96	13.50	n/a	36098.82	18690.55	0.00	100.00
05/06/05	100.00	14.75	n/a	40998.62	21986.24	0.02	100.00
05/07/05	100.00	18.25	n/a	46099.72	24104.56	0.05	100.00
05/08/05	100.00	0.00	n/a	0.00	0.00	0.00	-
05/09/05	97.92	18.25	n/a	49714.60	26887.26	0.01	100.00
05/10/05	100.00	14.00	n/a	40099.82	21418.96	0.07	100.00
05/11/05	95.83	14.00	n/a	40299.72	21061.65	0.00	100.00
05/12/05	4.17	0.25	n/a	99.68	0.00	0.00	-
05/13/05	95.83	14.75	n/a	41200.02	21608.50	0.01	100.00
05/14/05	4.17	0.25	n/a	99.68	0.00	0.00	-
05/15/05	100.00	0.00	n/a	0.00	0.00	0.00	-
05/16/05	100.00	15.75	n/a	43598.72	22821.11	1.97	99.99
05/17/05	100.00	15.50	n/a	41099.32	21673.90	0.00	100.00
05/18/05	99.48	14.00	n/a	39700.02	21404.86	0.03	100.00
05/19/05	100.00	13.00	n/a	36399.42	18956.67	0.30	100.00
05/20/05	100.00	14.75	n/a	42298.62	22400.48	2.66	99.99
05/21/05	100.00	16.00	n/a	37998.62	20108.11	0.24	100.00
05/22/05	100.00	0.00	n/a	0.00	0.44	0.00	100.00
05/23/05	100.00	16.00	n/a	44599.72	22962.53	0.75	100.00
05/24/05	100.00	14.75	n/a	41698.92	22304.28	0.00	100.00
05/25/05	100.00	15.00	n/a	44199.92	22551.60	2.16	99.99
05/26/05	100.00	14.50	n/a	39298.72	19978.02	1.42	99.99
05/27/05	100.00	15.00	n/a	42699.92	23134.78	2.70	99.99
05/28/05	100.00	17.00	n/a	41399.92	21954.04	1.15	99.99
05/29/05	100.00	0.00	n/a	0.00	0.00	0.00	-
05/30/05	100.00	14.00	n/a	38299.22	20105.90	0.01	100.00
05/31/05	95.83	13.00	n/a	36298.72	19641.47	0.00	100.00
Total	93.26	360.25	n/a	988798.13	520439.13	13.97	100.00

Generator Gas Use

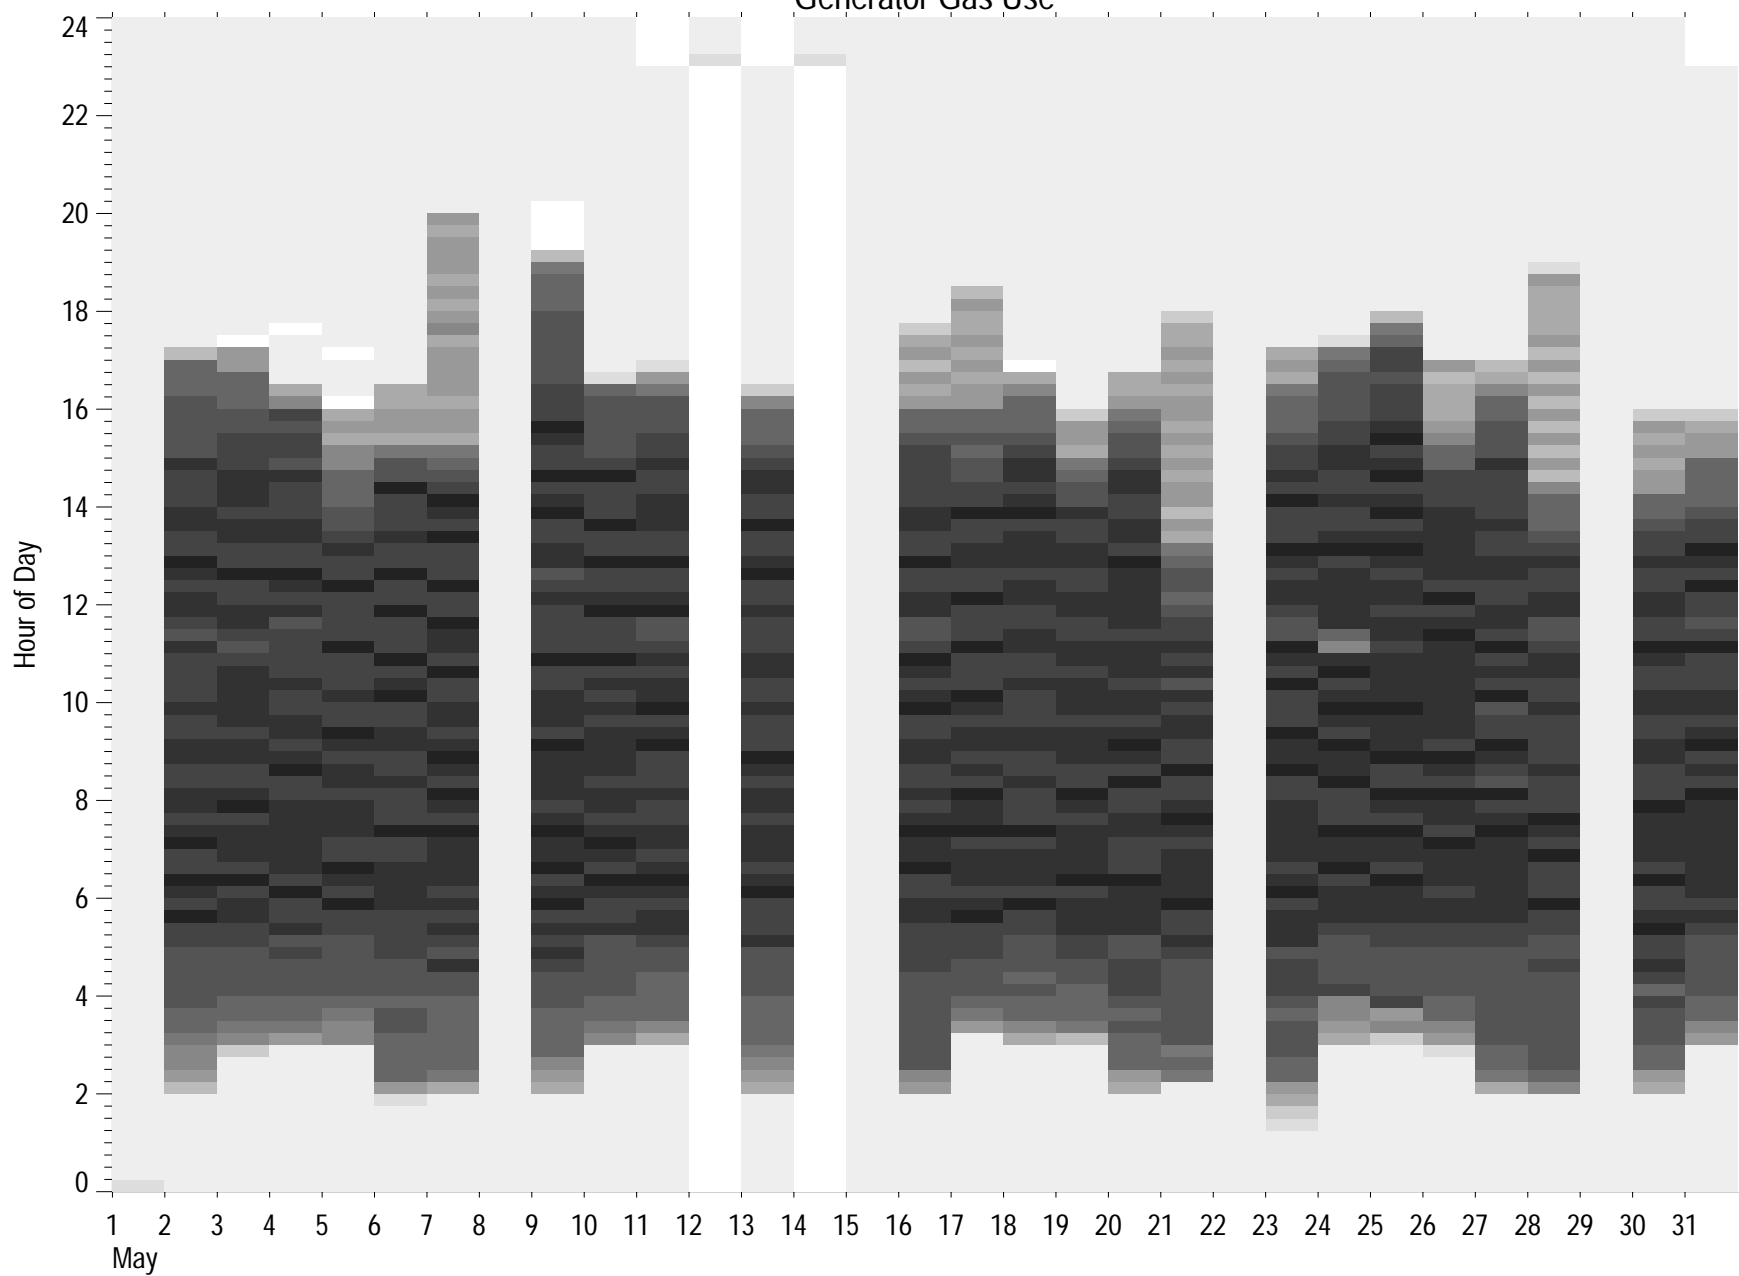

Day (MAX/MIN = 3567.96/ 0.00 cu ft)

Total Useful Heat Recovery

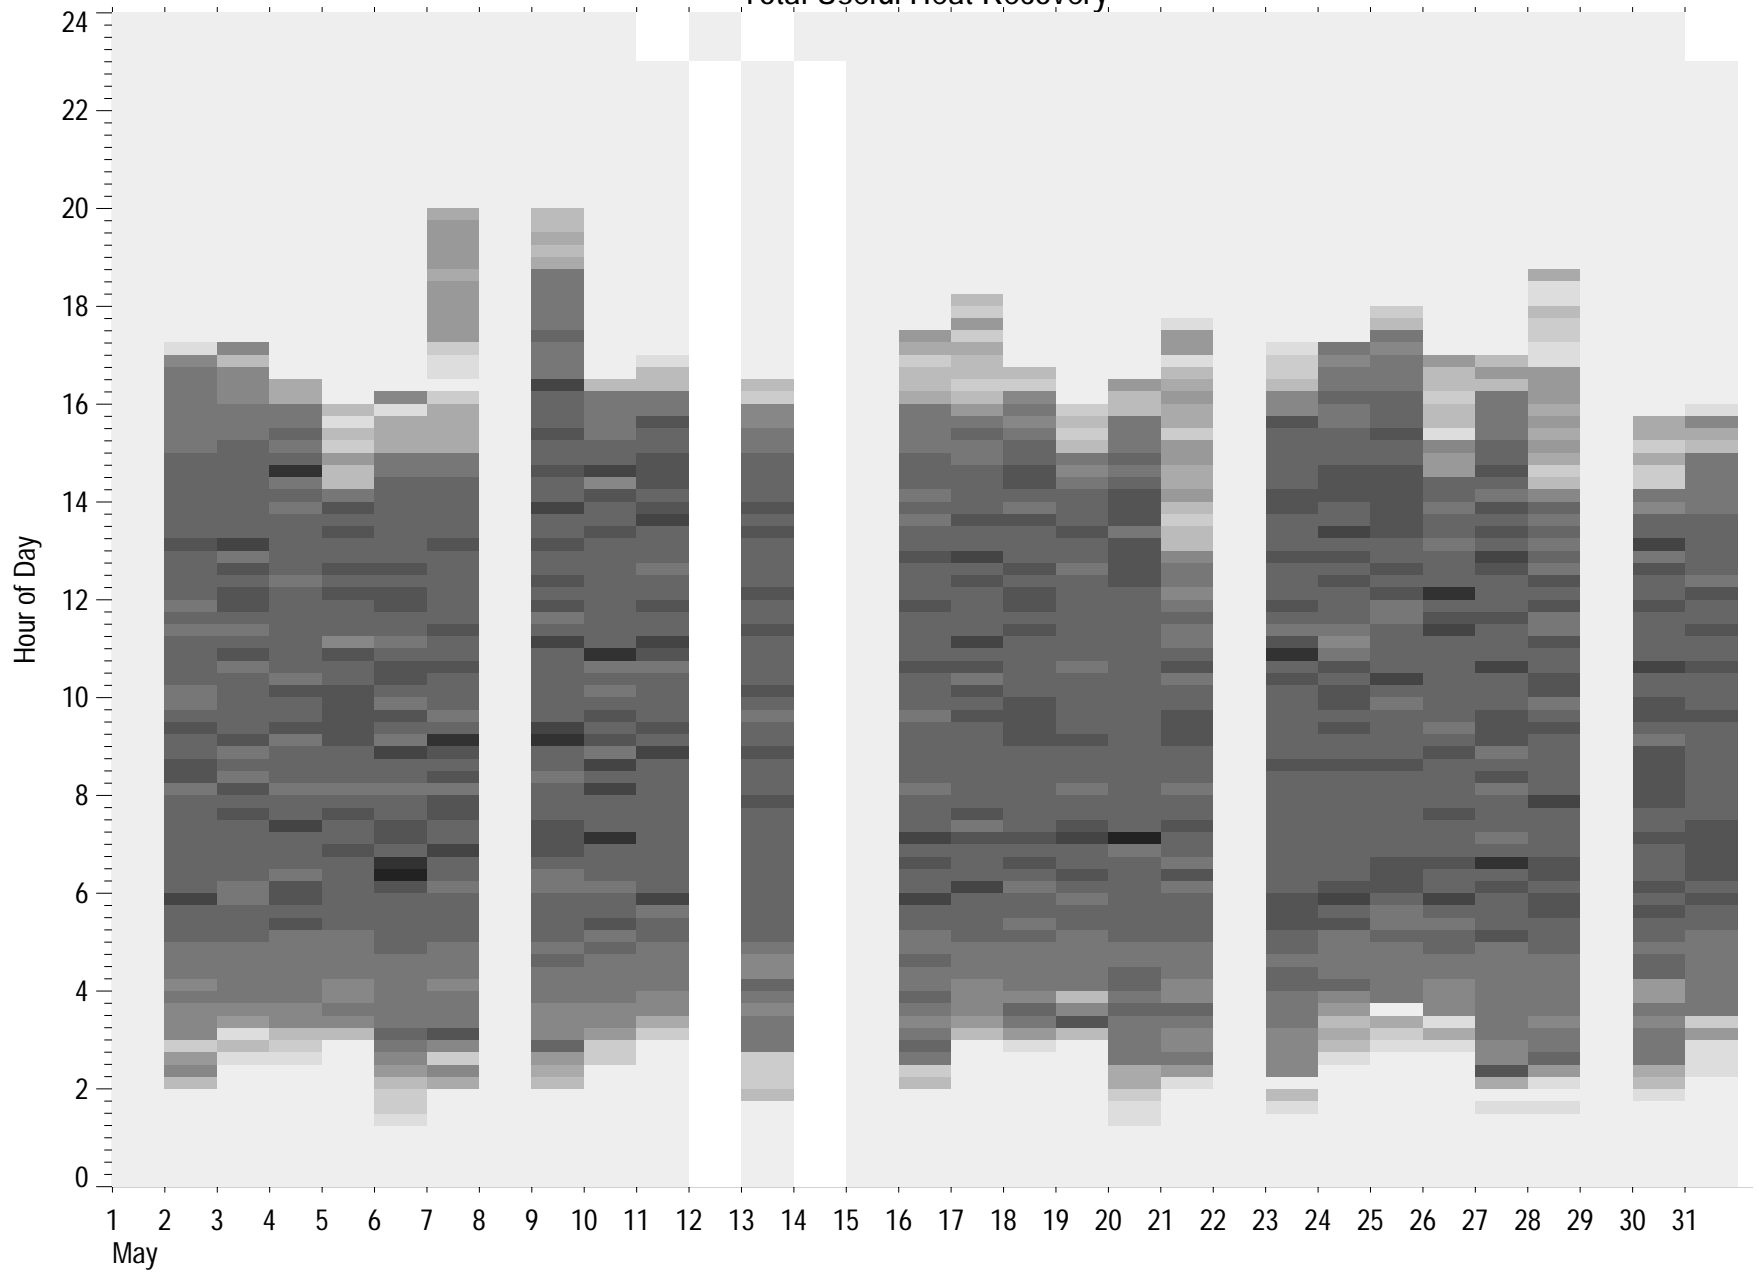

Day (MAX/MIN = 2397.69/ 0.00 MBtu)

Total Unused Heat Recovery

