


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Arrow Linen
01/01/06 to 01/31/06

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
01/01/06	100.00	0.00	n/a	0.00	0.00	0.00	-
01/02/06	100.00	13.50	n/a	36298.72	18951.12	0.00	100.00
01/03/06	99.48	12.50	n/a	35297.72	18527.40	0.33	100.00
01/04/06	100.00	12.25	n/a	35898.92	18659.59	0.35	100.00
01/05/06	99.48	11.50	n/a	32799.72	17132.06	0.00	100.00
01/06/06	99.48	13.75	n/a	38799.72	19656.55	0.32	100.00
01/07/06	100.00	14.25	n/a	34699.52	18543.27	0.65	100.00
01/08/06	100.00	0.00	n/a	0.00	0.00	0.00	-
01/09/06	100.00	10.50	n/a	29799.82	15595.52	1.32	99.99
01/10/06	100.00	13.25	n/a	38299.22	19920.36	0.90	100.00
01/11/06	100.00	12.50	n/a	36098.82	19097.48	0.00	100.00
01/12/06	98.96	11.00	n/a	29099.42	16100.92	0.00	100.00
01/13/06	100.00	12.75	n/a	36399.42	19639.86	0.00	100.00
01/14/06	100.00	14.50	n/a	37699.52	19033.98	0.93	100.00
01/15/06	100.00	0.00	n/a	0.00	1.91	0.00	100.00
01/16/06	99.48	11.25	n/a	32599.92	15795.58	3.70	99.98
01/17/06	99.48	12.50	n/a	37299.72	19621.39	0.26	100.00
01/18/06	100.00	12.00	n/a	19998.82	8403.98	3.79	99.95
01/19/06	97.92	11.75	n/a	17500.82	9266.61	0.17	100.00
01/20/06	100.00	13.00	n/a	36298.72	18770.73	0.39	100.00
01/21/06	100.00	13.75	n/a	34199.02	17668.76	0.77	100.00
01/22/06	100.00	0.00	n/a	0.00	0.00	0.00	-
01/23/06	99.48	11.50	n/a	32699.02	16653.12	0.96	99.99
01/24/06	100.00	12.25	n/a	36799.22	18576.06	0.48	100.00
01/25/06	99.48	12.50	n/a	36799.22	18883.41	0.00	100.00
01/26/06	98.96	11.75	n/a	32497.62	16881.34	0.00	100.00
01/27/06	100.00	12.25	n/a	34699.52	17591.07	0.04	100.00
01/28/06	100.00	14.00	n/a	34899.42	18871.72	2.93	99.98
01/29/06	100.00	0.00	n/a	0.00	0.24	0.00	100.00
01/30/06	99.48	11.50	n/a	32299.22	17003.56	1.94	99.99
01/31/06	99.48	12.25	n/a	36899.92	18576.77	0.00	100.00
Total	99.71	324.50	n/a	876680.69	453424.38	20.23	100.00

Total Useful Heat Recovery

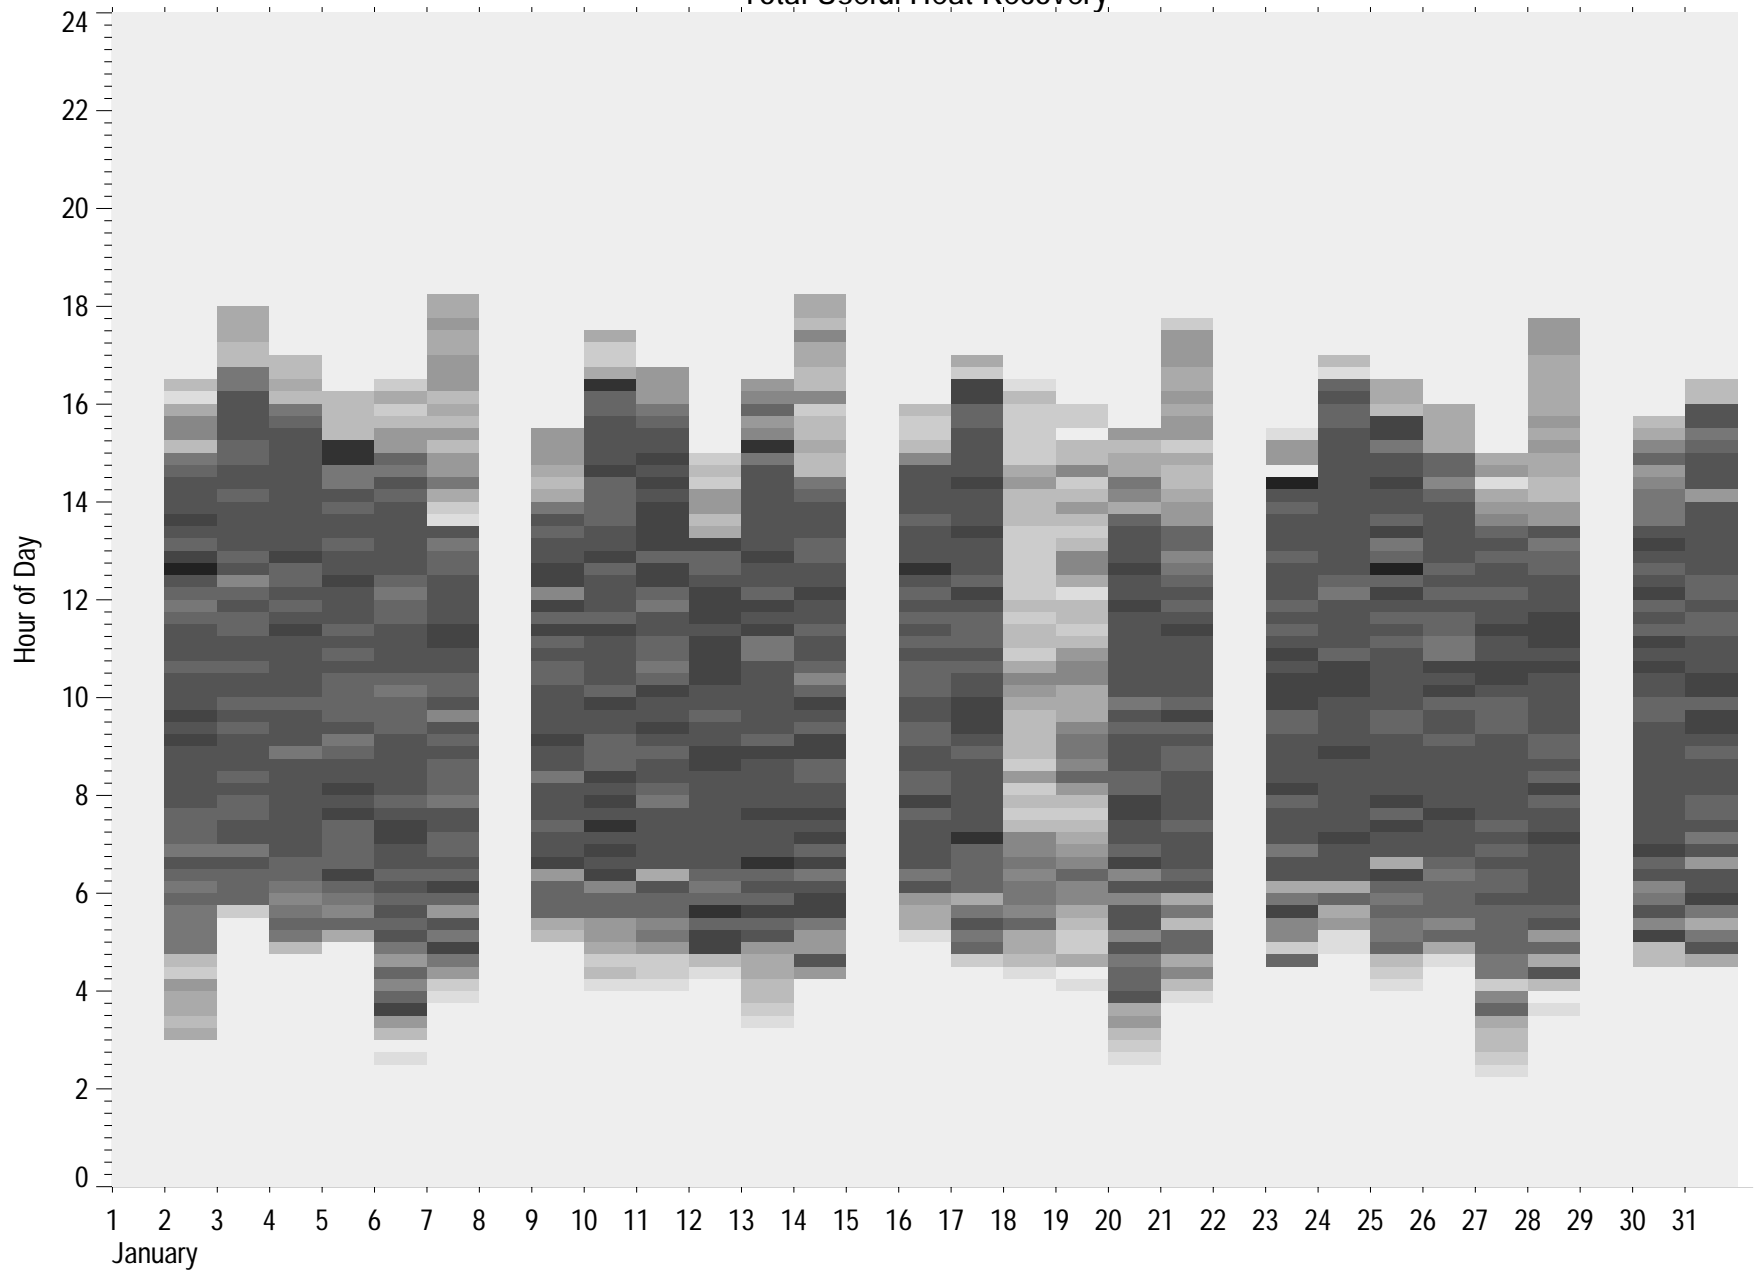

Day (MAX/MIN = 2267.83/ 0.00 MBtu)

Total Unused Heat Recovery

