


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Arrow Linen

11/01/06 to 11/30/06


Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
11/01/06	100.00	12.75	n/a	38299.22	20310.88	12.27	99.94
11/02/06	100.00	14.25	n/a	36899.92	18893.12	0.00	100.00
11/03/06	100.00	12.00	n/a	35399.92	16898.41	0.00	100.00
11/04/06	99.48	11.50	n/a	31699.62	15213.27	0.00	100.00
11/05/06	100.00	0.00	n/a	0.00	0.00	0.00	-
11/06/06	99.48	12.00	n/a	35099.32	17912.54	3.12	99.98
11/07/06	100.00	14.25	n/a	43099.72	22774.20	0.75	100.00
11/08/06	100.00	13.00	n/a	38699.02	19841.52	0.00	100.00
11/09/06	100.00	14.00	n/a	35099.32	17534.57	5.39	99.97
11/10/06	99.48	12.50	n/a	36298.72	19583.49	0.73	100.00
11/11/06	100.00	10.75	n/a	31798.72	17137.32	0.00	100.00
11/12/06	100.00	0.00	n/a	0.00	0.00	0.00	-
11/13/06	100.00	12.25	n/a	34798.72	17806.88	0.00	100.00
11/14/06	100.00	15.00	n/a	43798.62	21898.19	4.48	99.98
11/15/06	100.00	13.25	n/a	39199.52	20621.97	1.32	99.99
11/16/06	100.00	14.25	n/a	36298.72	18241.55	0.00	100.00
11/17/06	100.00	12.00	n/a	34699.52	17044.18	0.39	100.00
11/18/06	99.48	11.75	n/a	32799.72	16460.73	0.00	100.00
11/19/06	100.00	0.00	n/a	0.00	0.00	0.00	-
11/20/06	98.96	12.00	n/a	34598.82	17002.48	0.49	100.00
11/21/06	100.00	15.25	n/a	46398.82	23282.52	0.00	100.00
11/22/06	100.00	13.75	n/a	42399.42	21316.47	0.11	100.00
11/23/06	100.00	0.00	n/a	0.00	0.68	0.00	100.00
11/24/06	100.00	16.25	n/a	43198.92	21545.01	1.61	99.99
11/25/06	99.48	11.00	n/a	31998.62	15541.68	0.63	100.00
11/26/06	100.00	0.00	n/a	0.00	0.00	0.00	-
11/27/06	100.00	11.75	n/a	34699.52	16875.88	1.18	99.99
11/28/06	99.48	15.00	n/a	44499.02	23584.82	2.62	99.99
11/29/06	100.00	12.50	n/a	35799.72	18454.67	1.85	99.99
11/30/06	100.00	13.75	n/a	33899.92	17048.08	0.09	100.00
Total	99.86	326.75	n/a	931481.13	472825.09	37.03	99.99

Generator Gas Use

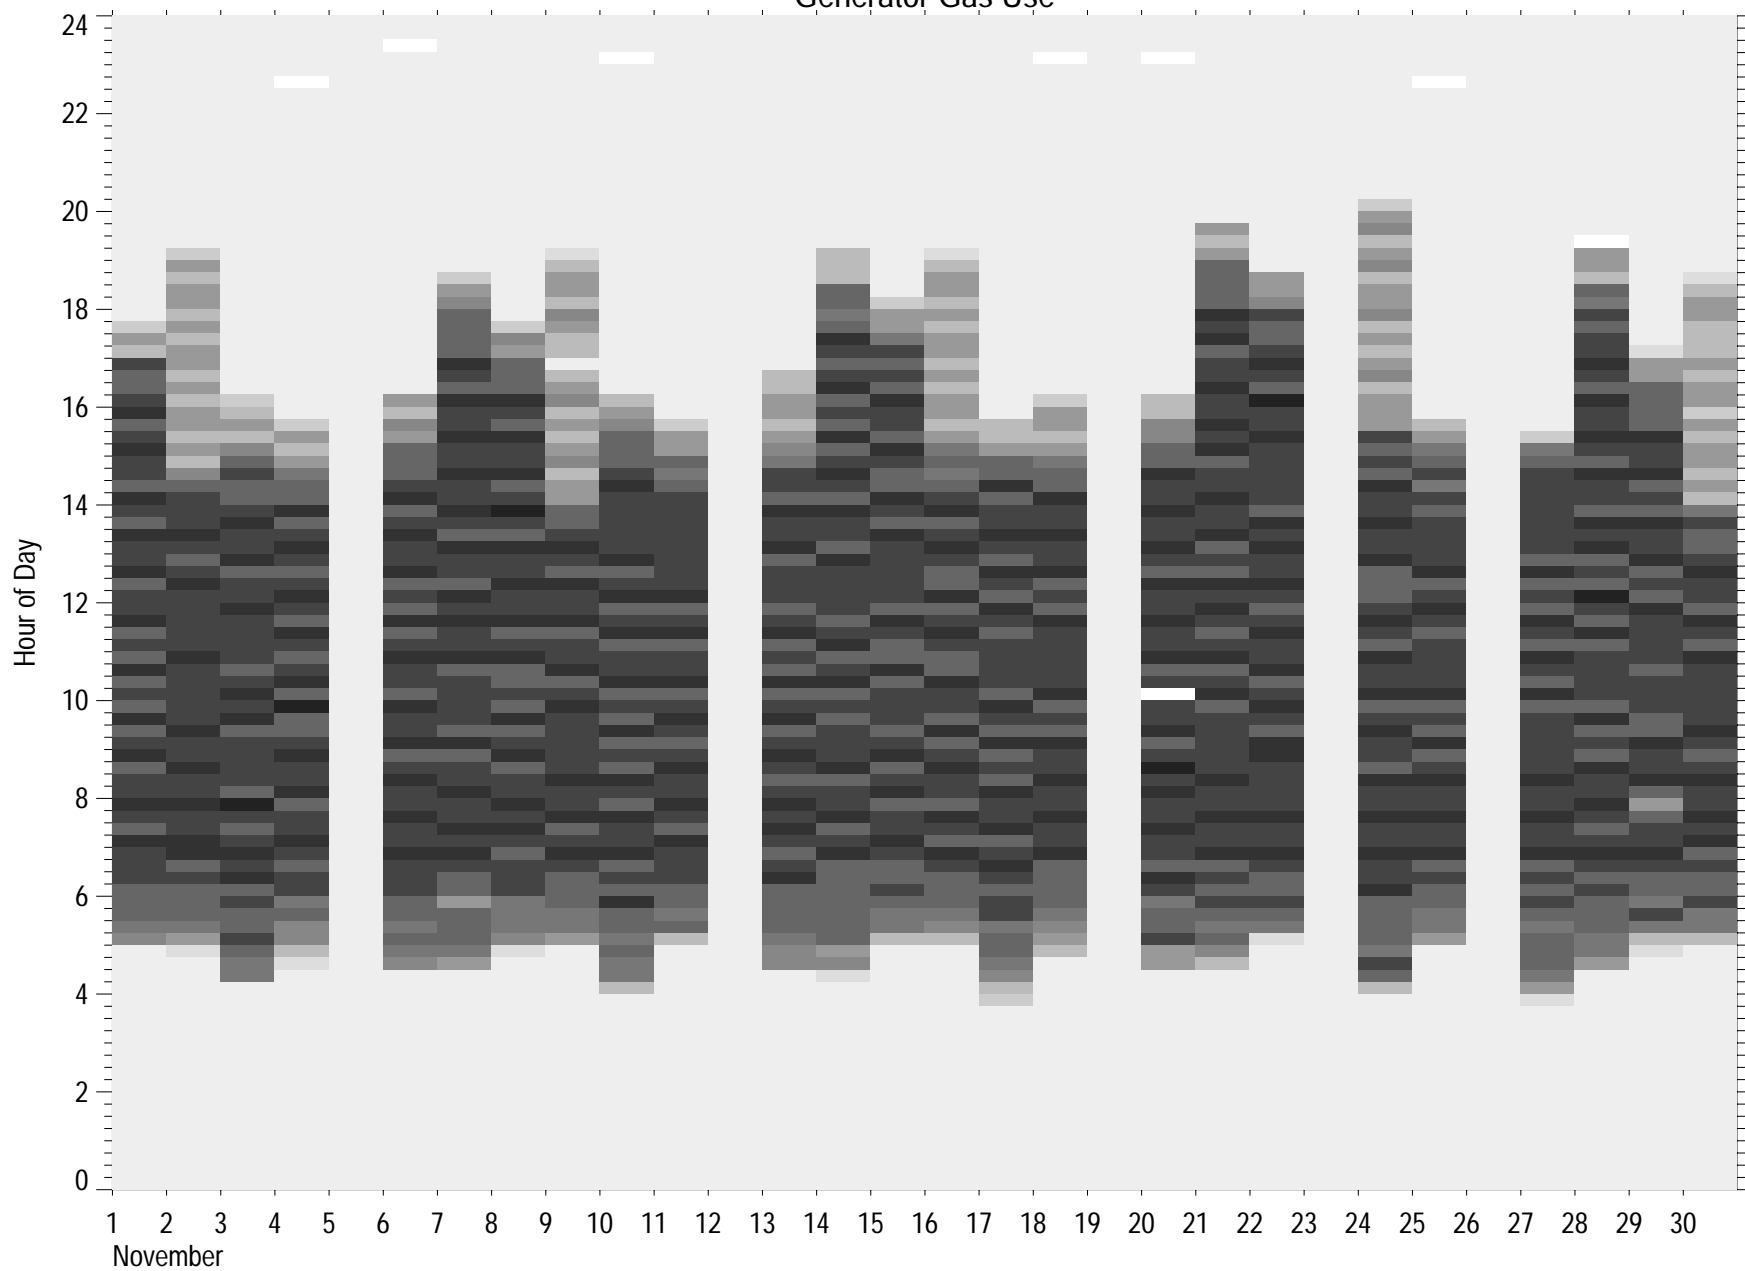

Day (MAX/MIN = 3998.00/ 0.00 cu ft)

Total Useful Heat Recovery

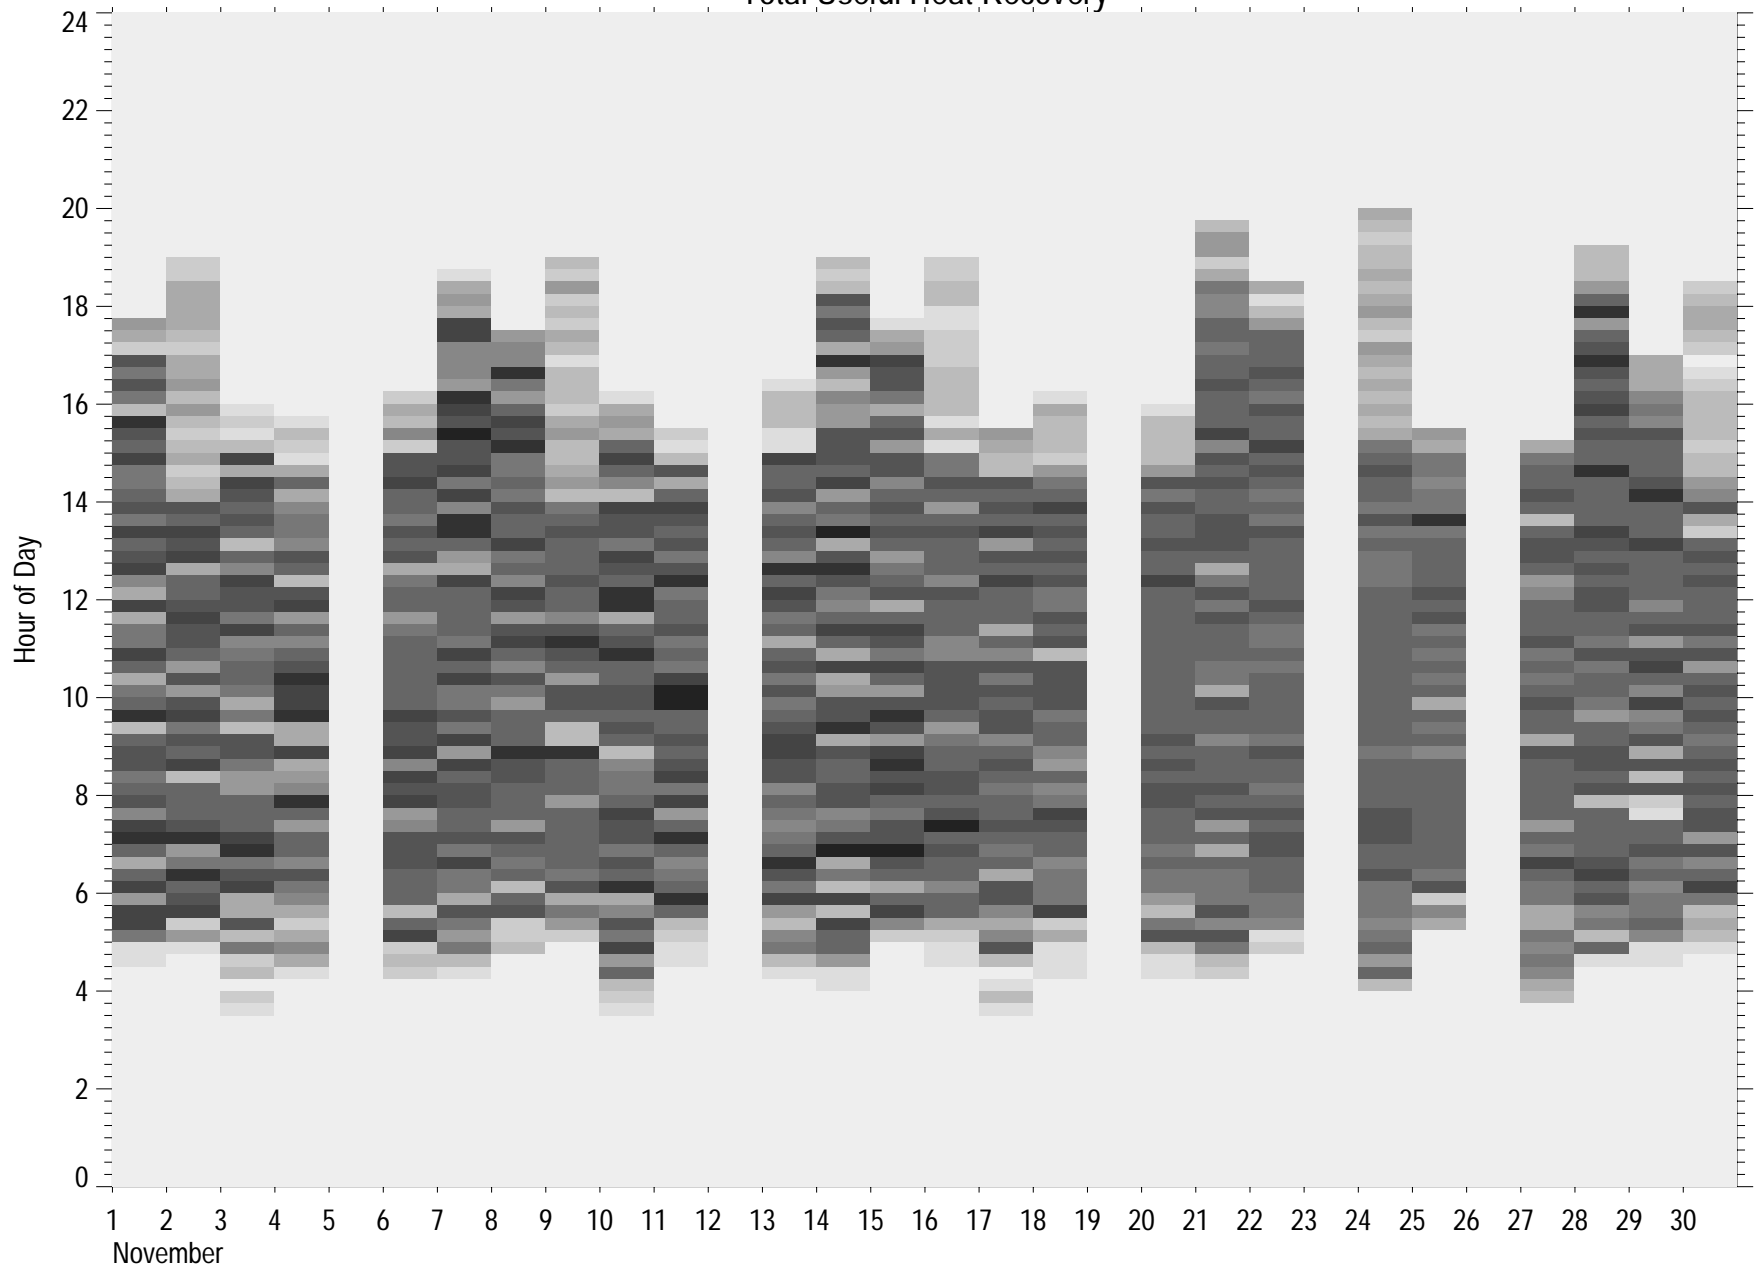

Day (MAX/MIN = 2491.13/ 0.00 MBtu)

Total Unused Heat Recovery

