


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Arrow Linen


01/01/06 to 12/31/06

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
Jan 2006	99.71	324.50	n/a	876680.69	453424.38	20.23	100.00
Feb 2006	99.74	304.00	n/a	832882.25	419838.28	23.47	99.99
Mar 2006	99.87	351.75	n/a	969987.81	488436.25	67.65	99.99
Apr 2006	95.78	285.75	n/a	796179.19	403410.97	18.22	100.00
May 2006	98.74	360.75	n/a	1020879.60	497825.22	65.53	99.99
Jun 2006	54.05	197.25	n/a	564388.56	278444.56	35.30	99.99
Jul 2006	99.28	321.75	n/a	901980.31	460577.06	54.80	99.99
Aug 2006	99.23	354.75	n/a	989480.94	499351.75	98.74	99.98
Sep 2006	99.67	338.50	n/a	945680.63	483531.53	49.42	99.99
Oct 2006	77.81	266.50	n/a	719585.00	365845.97	29.95	99.99
Nov 2006	99.86	326.75	n/a	931481.13	472825.09	37.03	99.99
Dec 2006	99.83	331.00	n/a	956785.69	473355.94	29.50	99.99
Total	93.65	3763.25	n/a	10505992.00	5296867.00	529.84	99.99

Generator Gas Use

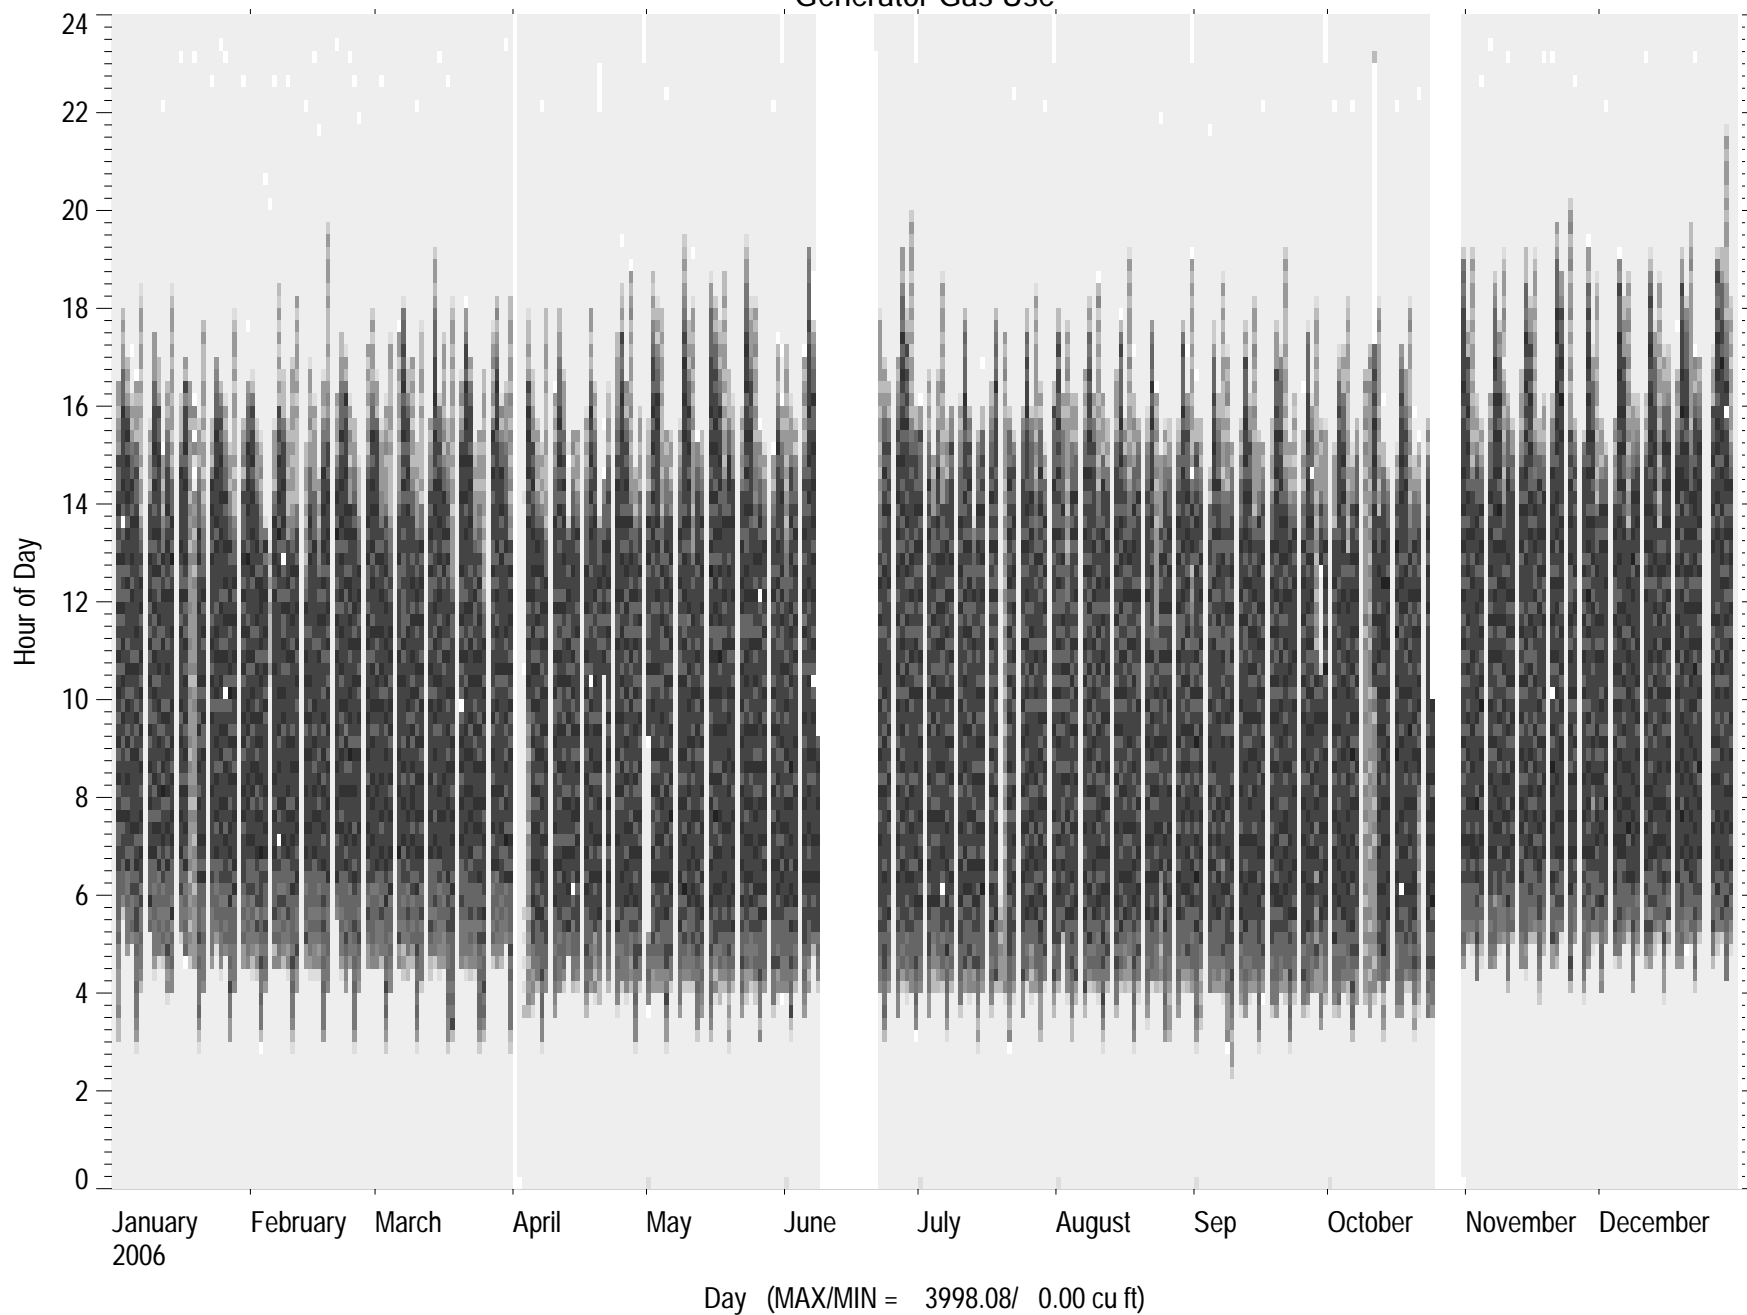

Total Useful Heat Recovery

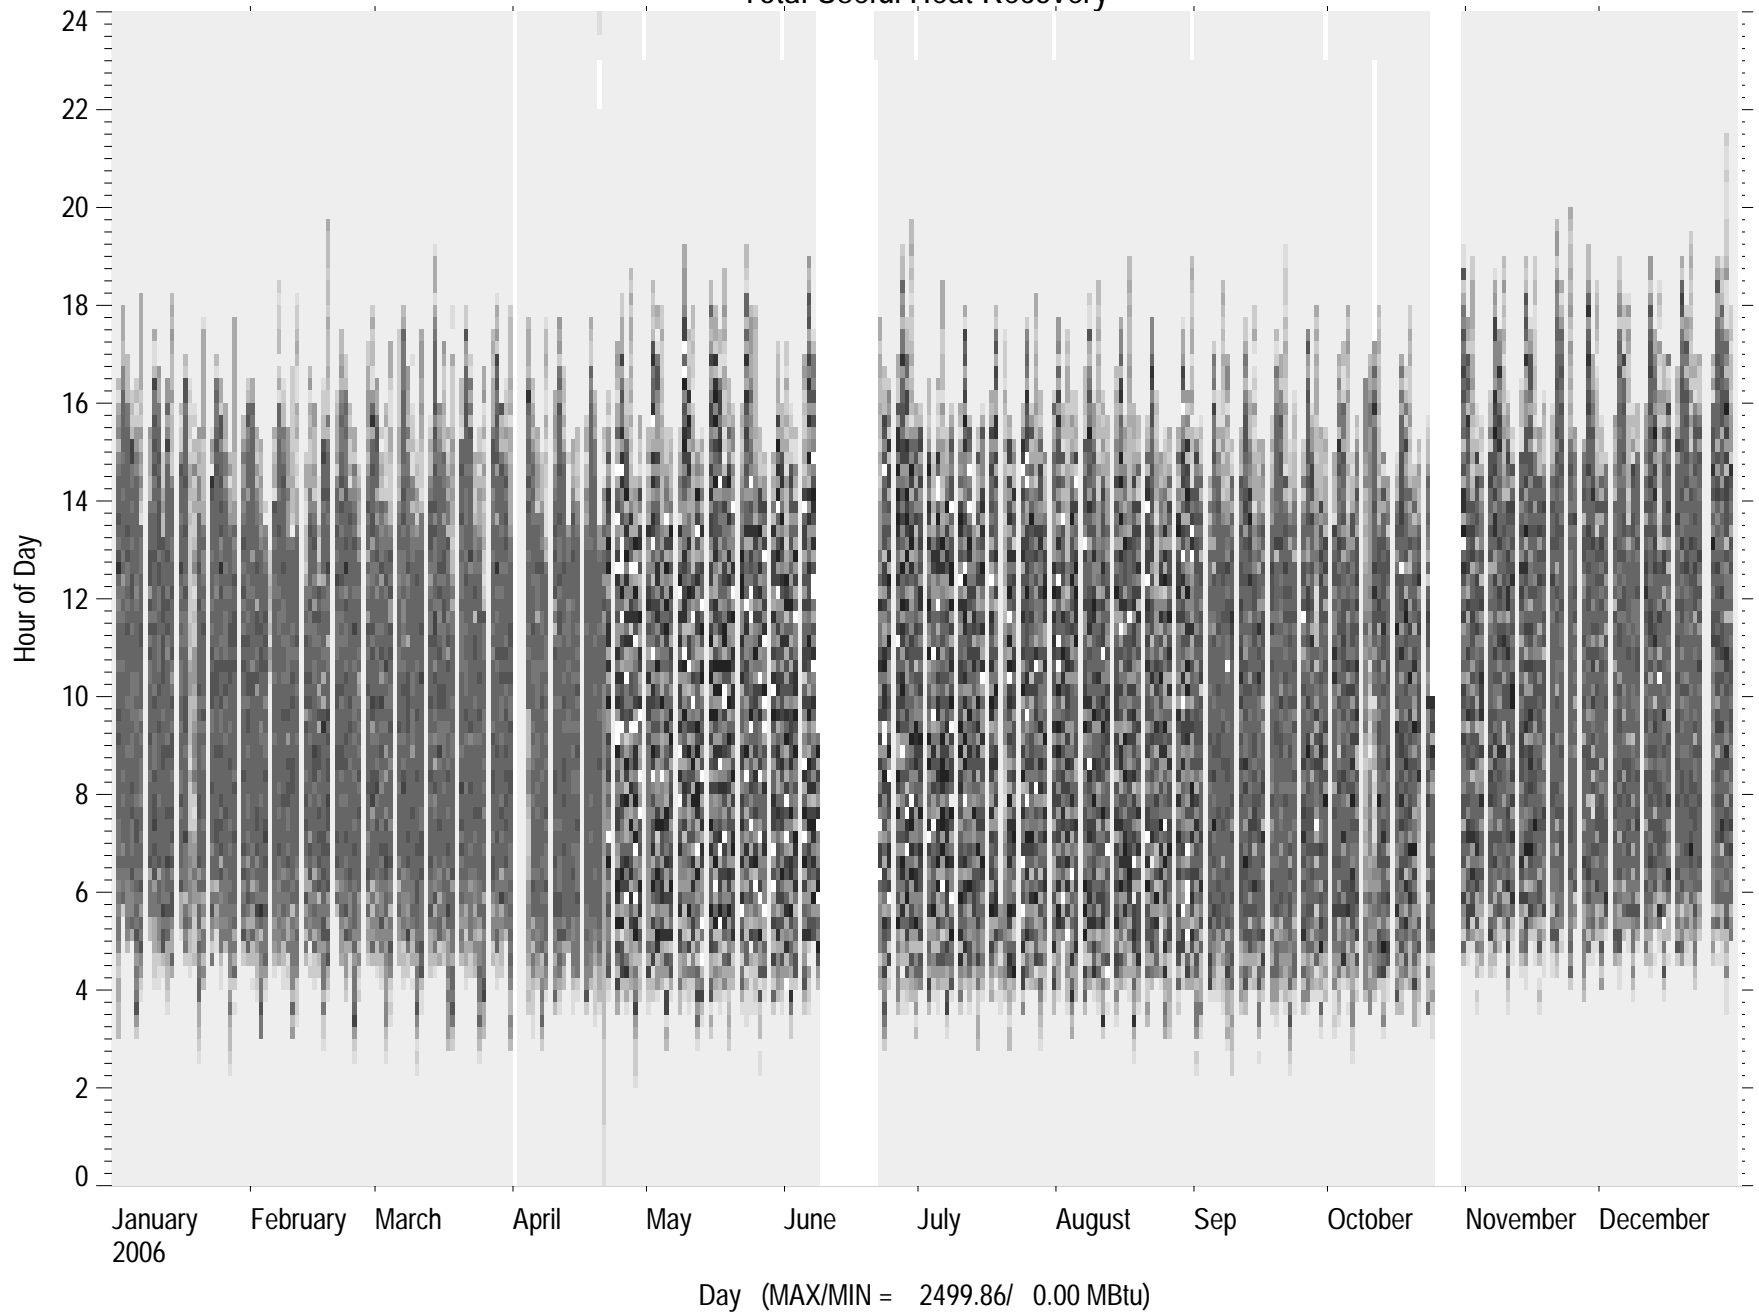

Total Unused Heat Recovery

