


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Arrow Linen
02/01/07 to 02/28/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
02/01/07	100.00	14.00	n/a	35200.70	16987.92	0.19	100.00
02/02/07	100.00	11.75	n/a	34300.40	16653.41	0.26	100.00
02/03/07	100.00	11.00	n/a	31900.20	14580.29	0.00	100.00
02/04/07	100.00	0.00	n/a	0.68	0.00	0.00	-
02/05/07	98.96	11.00	n/a	29398.52	14849.59	3.64	99.98
02/06/07	98.96	12.25	n/a	34698.70	17817.62	2.28	99.99
02/07/07	98.96	11.75	n/a	33798.40	15170.18	0.00	100.00
02/08/07	99.48	13.75	n/a	33801.50	15746.79	0.18	100.00
02/09/07	100.00	11.25	n/a	31799.40	13889.86	0.00	100.00
02/10/07	100.00	11.50	n/a	32299.90	15086.31	2.20	99.99
02/11/07	100.00	0.00	n/a	0.68	0.00	0.00	-
02/12/07	76.56	11.00	n/a	30699.32	15399.35	0.00	100.00
02/13/07	99.48	3.25	n/a	8999.90	20033.74	1.33	99.99
02/14/07	100.00	11.75	n/a	36200.20	16761.67	9.93	99.94
02/15/07	99.48	13.25	n/a	35199.20	17085.21	0.86	99.99
02/16/07	98.44	12.25	n/a	33397.09	15728.45	2.90	99.98
02/17/07	100.00	11.50	n/a	33499.30	15612.51	0.00	100.00
02/18/07	100.00	0.00	n/a	0.68	0.00	0.00	-
02/19/07	100.00	11.25	n/a	25699.62	11071.36	5.68	99.95
02/20/07	100.00	13.25	n/a	39299.40	19604.57	3.90	99.98
02/21/07	100.00	11.75	n/a	33999.80	16719.22	2.79	99.98
02/22/07	100.00	15.00	n/a	37100.50	17832.58	3.92	99.98
02/23/07	99.48	12.00	n/a	34700.20	17040.10	3.68	99.98
02/24/07	99.48	11.00	n/a	31100.60	15107.06	1.86	99.99
02/25/07	100.00	0.00	n/a	0.68	0.00	0.00	-
02/26/07	100.00	11.25	n/a	32999.72	15091.22	0.00	100.00
02/27/07	100.00	12.25	n/a	37199.70	18453.72	0.09	100.00
02/28/07	98.96	12.25	n/a	34799.40	17422.29	0.00	100.00
Total	98.87	281.25	n/a	782094.38	389745.00	45.69	99.99

Generator Gas Use

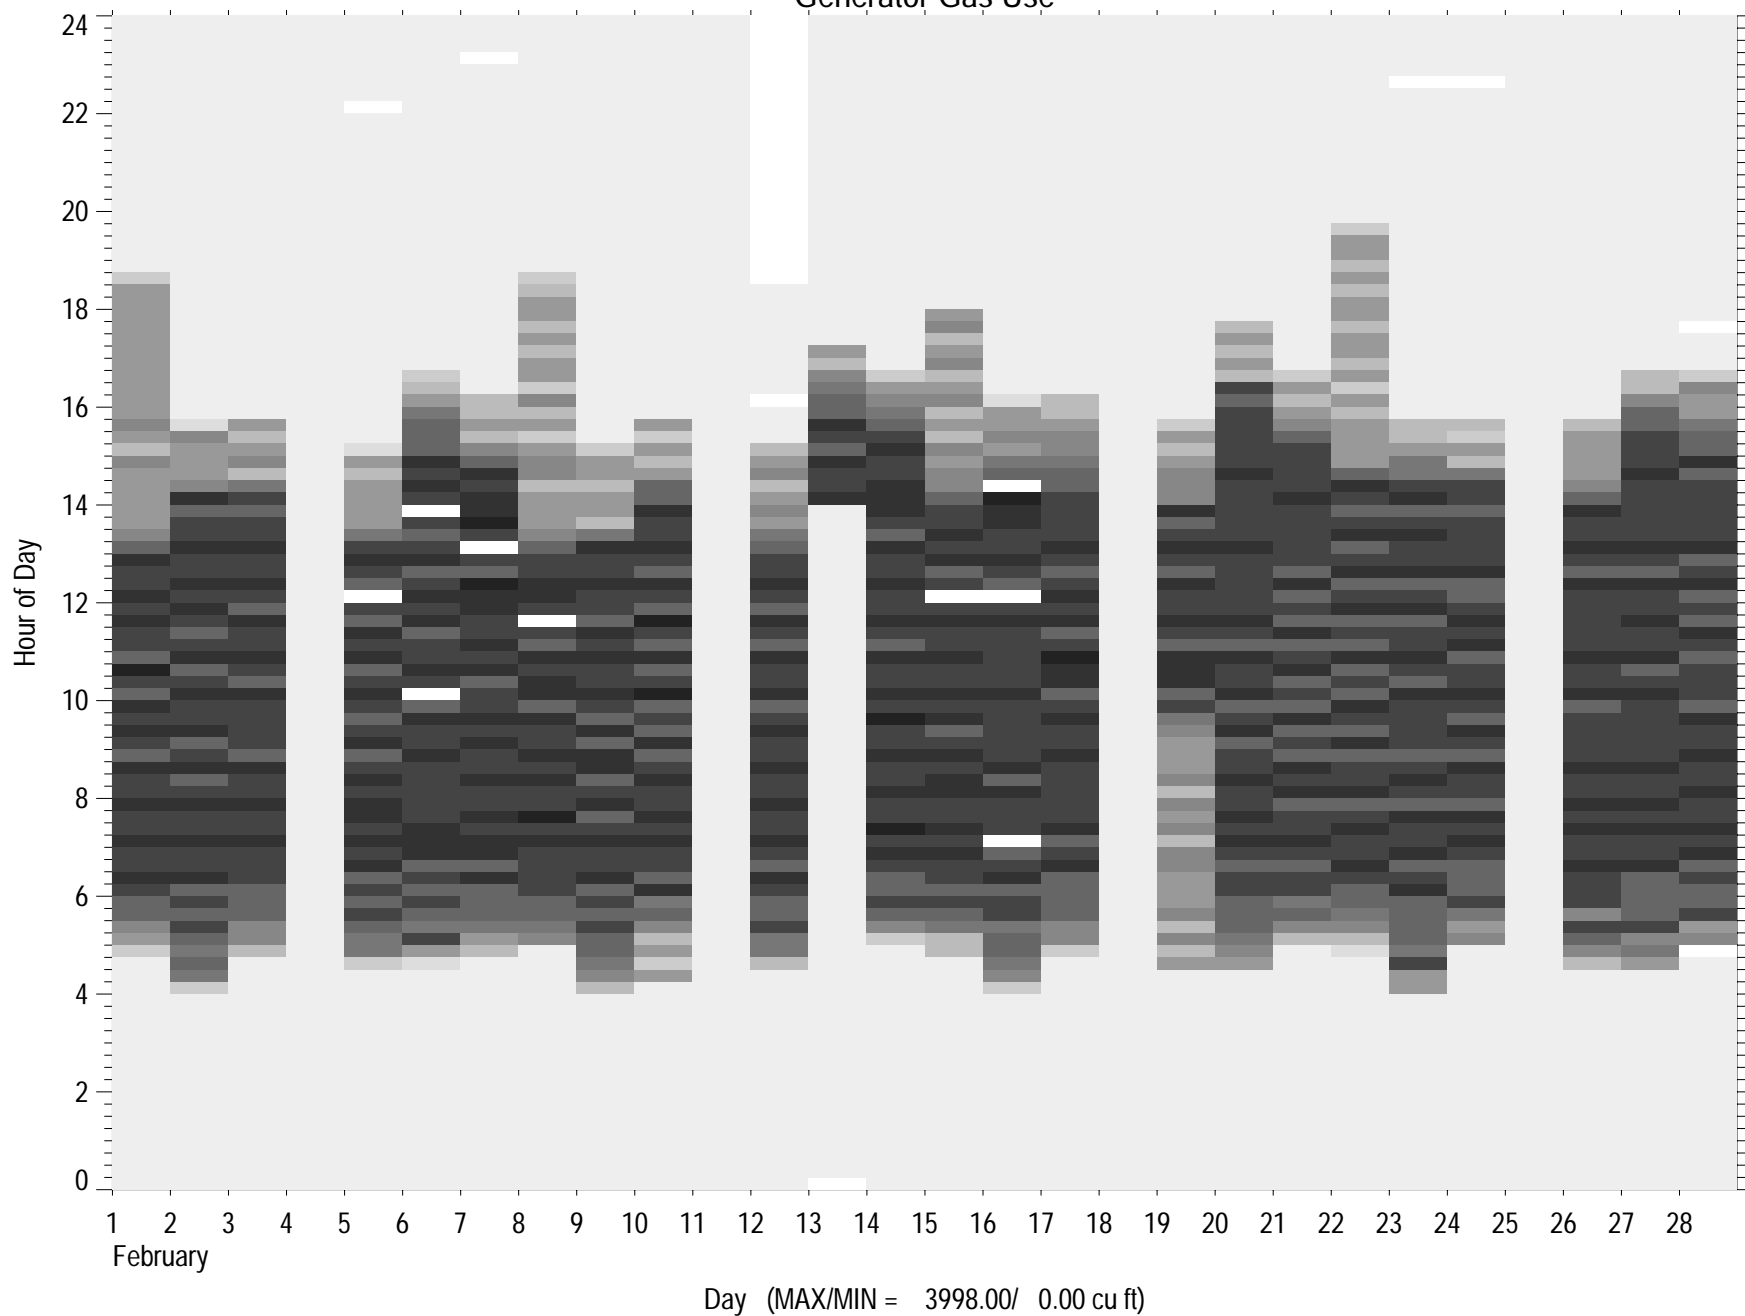

Total Useful Heat Recovery

