


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Arrow Linen
07/01/07 to 07/31/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
07/01/07	100.00	0.25	n/a	99.68	0.00	0.00	-
07/02/07	100.00	12.75	n/a	36799.22	19030.91	0.15	100.00
07/03/07	100.00	14.75	n/a	42899.92	23129.05	0.47	100.00
07/04/07	99.48	10.00	n/a	26099.42	13655.07	0.00	100.00
07/05/07	99.48	14.25	n/a	34399.02	18499.09	4.11	99.98
07/06/07	100.00	12.75	n/a	36799.22	19412.58	0.00	100.00
07/07/07	99.48	11.50	n/a	31598.92	16972.14	0.00	100.00
07/08/07	100.00	0.00	n/a	0.00	9.99	0.00	100.00
07/09/07	100.00	12.25	n/a	34499.62	18498.59	0.54	100.00
07/10/07	100.00	14.50	n/a	40998.62	22365.46	0.32	100.00
07/11/07	100.00	13.50	n/a	37598.82	20352.32	0.17	100.00
07/12/07	100.00	14.25	n/a	34998.62	18188.53	0.83	100.00
07/13/07	99.48	13.50	n/a	37998.62	20644.91	0.13	100.00
07/14/07	99.48	11.25	n/a	30999.22	16134.95	0.00	100.00
07/15/07	100.00	0.00	n/a	0.00	0.00	0.00	-
07/16/07	100.00	12.75	n/a	35699.02	18791.42	0.00	100.00
07/17/07	100.00	14.50	n/a	42098.72	22552.81	0.39	100.00
07/18/07	100.00	13.00	n/a	36899.92	19199.43	0.16	100.00
07/19/07	100.00	14.75	n/a	37598.82	19385.17	1.92	99.99
07/20/07	100.00	13.25	n/a	38399.92	20374.44	0.01	100.00
07/21/07	99.48	11.50	n/a	32200.12	17042.82	0.48	100.00
07/22/07	100.00	0.00	n/a	0.00	0.00	0.00	-
07/23/07	99.48	13.50	n/a	38499.12	18841.36	0.49	100.00
07/24/07	99.48	14.25	n/a	41599.82	21287.17	0.00	100.00
07/25/07	100.00	12.50	n/a	34598.82	18062.30	0.67	100.00
07/26/07	100.00	14.75	n/a	35399.92	18187.82	0.13	100.00
07/27/07	100.00	13.25	n/a	37899.42	19676.54	5.92	99.97
07/28/07	99.48	10.25	n/a	28399.02	14769.35	0.00	100.00
07/29/07	100.00	0.00	n/a	0.00	0.00	0.00	-
07/30/07	99.48	12.50	n/a	34699.52	18297.59	0.71	100.00
07/31/07	95.31	14.75	n/a	42699.92	23086.62	0.14	100.00
Total	99.68	341.00	n/a	942481.00	496448.44	17.74	100.00

Generator Gas Use

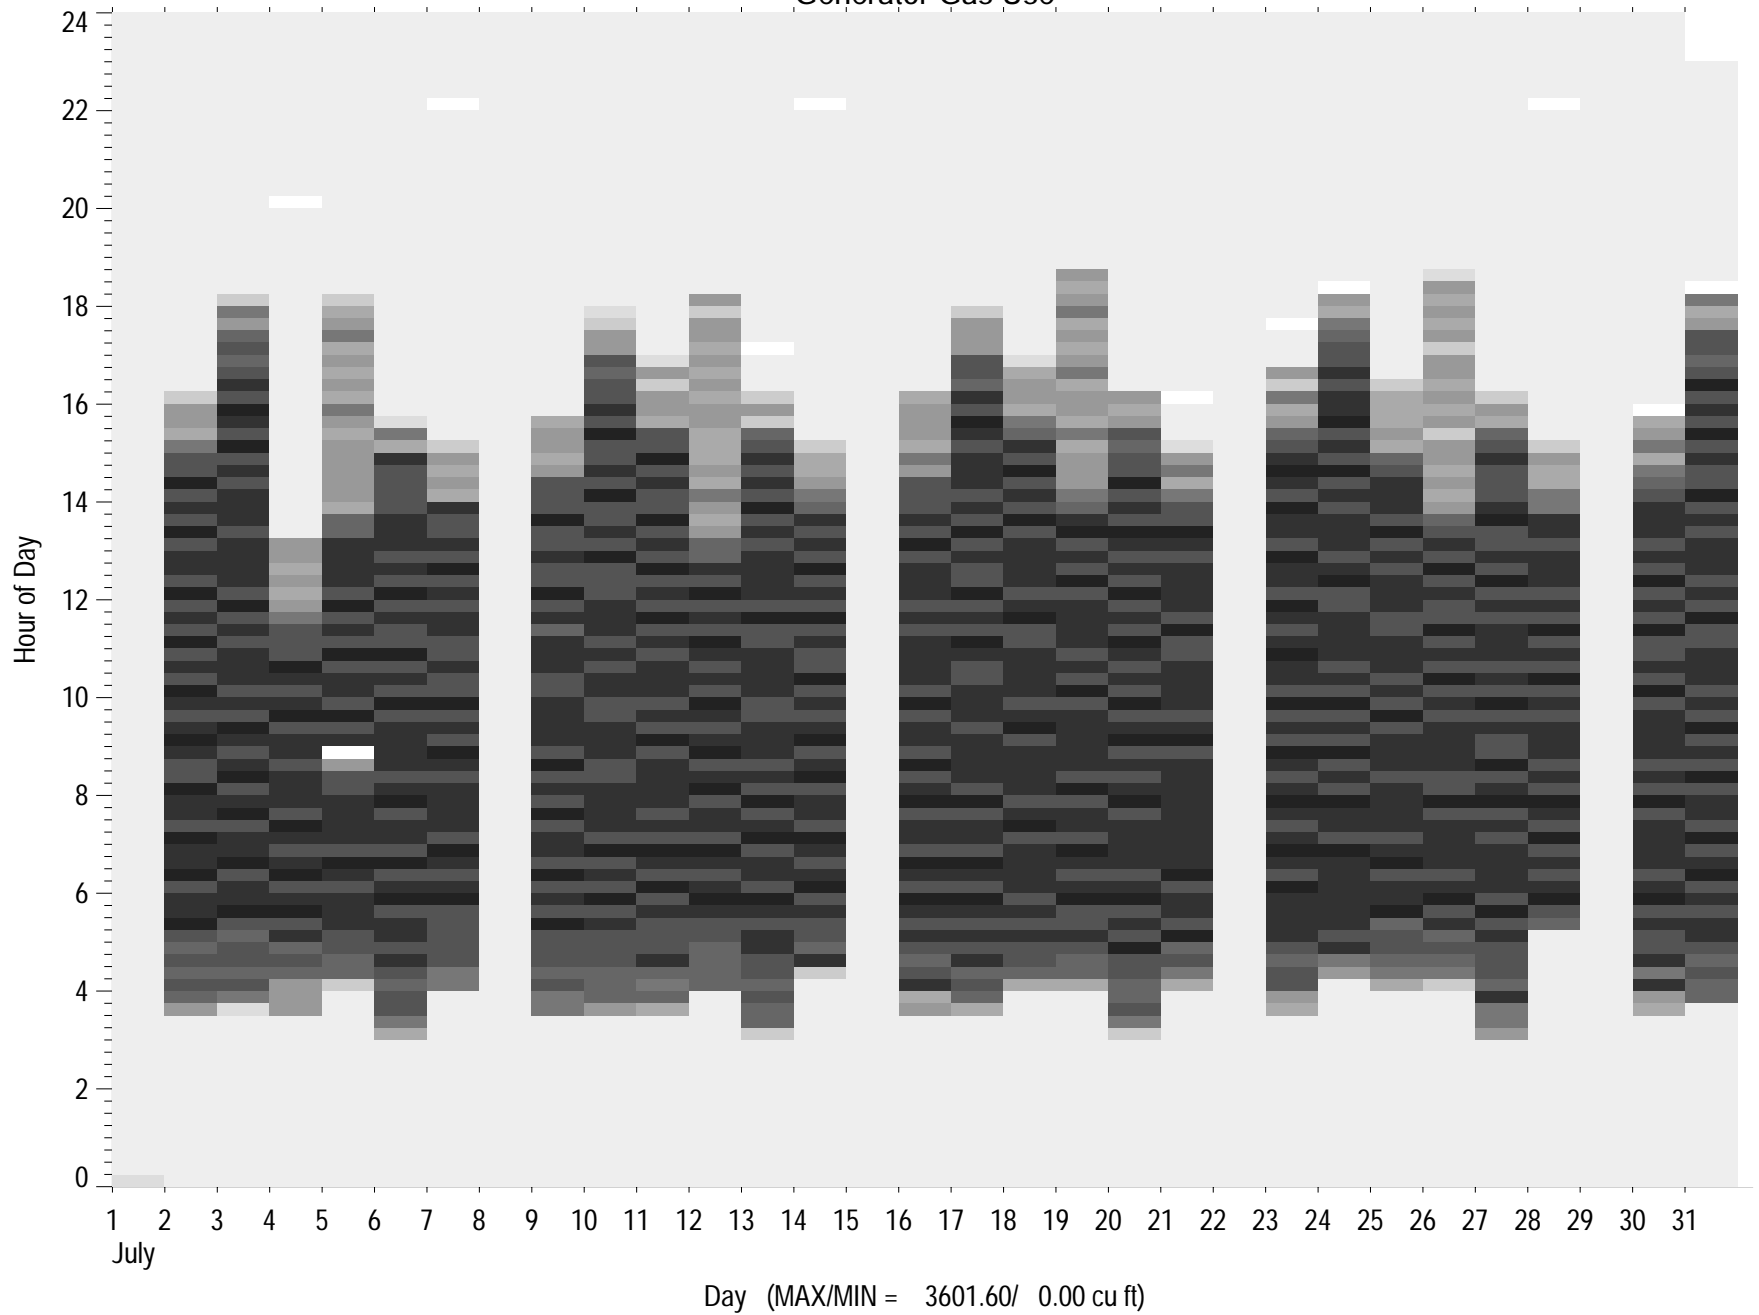

Total Unused Heat Recovery

