


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Arrow Linen


01/01/07 to 12/31/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
Jan 2007	99.73	331.75	n/a	939881.00	458417.78	37.53	99.99
Feb 2007	99.68	281.25	n/a	782094.38	389745.00	45.69	99.99
Mar 2007	99.75	308.75	n/a	781690.56	390290.25	27.42	99.99
Apr 2007	99.77	294.25	n/a	811382.00	414962.53	18.76	100.00
May 2007	99.85	356.25	n/a	885381.56	459192.13	25.25	99.99
Jun 2007	99.91	346.00	n/a	909181.75	475304.28	43.53	99.99
Jul 2007	99.82	340.75	n/a	942381.31	496448.44	17.74	100.00
Aug 2007	96.62	349.25	n/a	961280.19	501559.06	17.06	100.00
Sep 2007	99.86	317.00	n/a	833079.13	443450.34	25.24	99.99
Oct 2007	99.85	328.75	n/a	887081.56	452326.22	13.85	100.00
Nov 2007	99.81	313.00	n/a	864082.56	430321.78	60.87	99.99
Dec 2007	99.85	310.25	n/a	871984.44	459911.25	24.68	99.99
Total	99.54	3877.25	n/a	10469500.00	5371929.00	357.60	99.99

Generator Gas Use

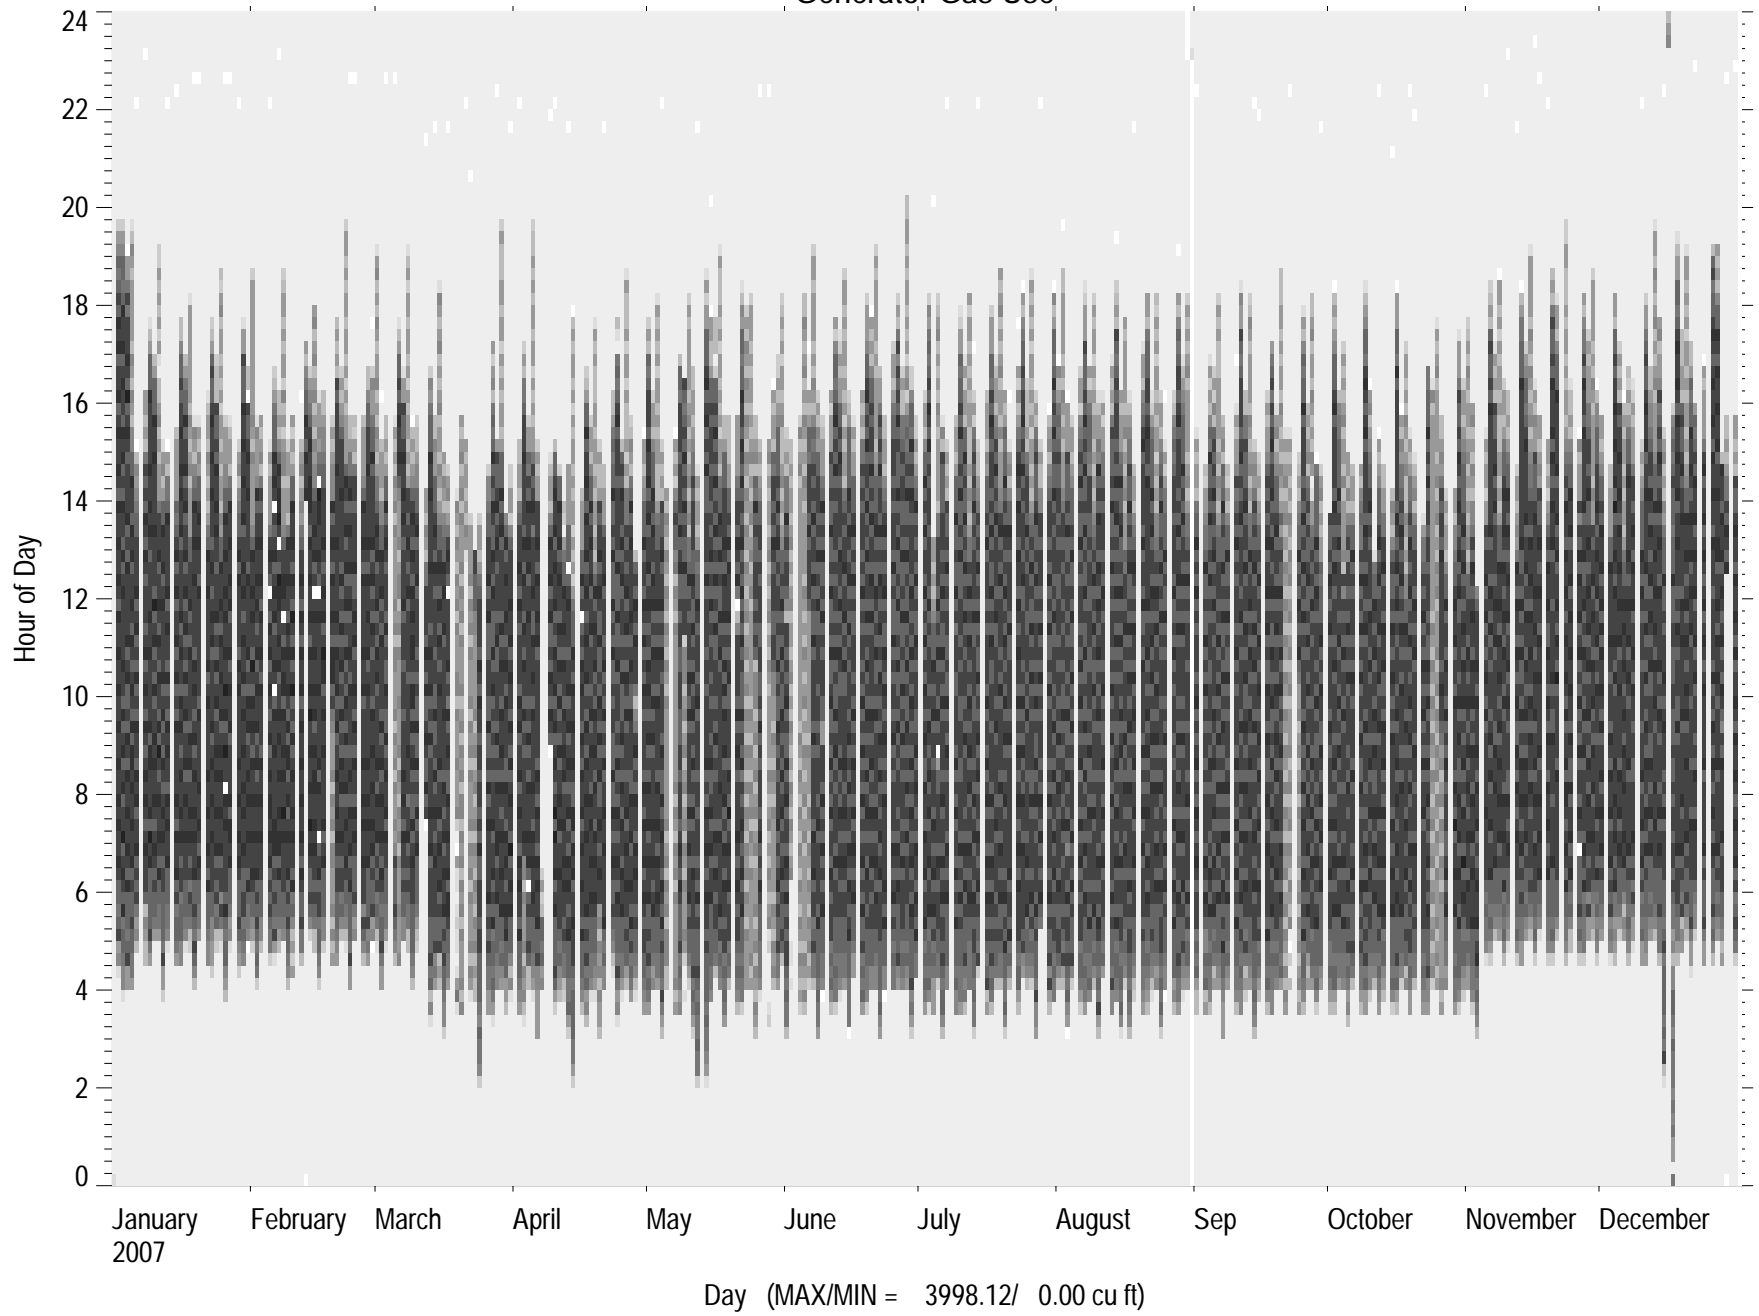

Total Useful Heat Recovery

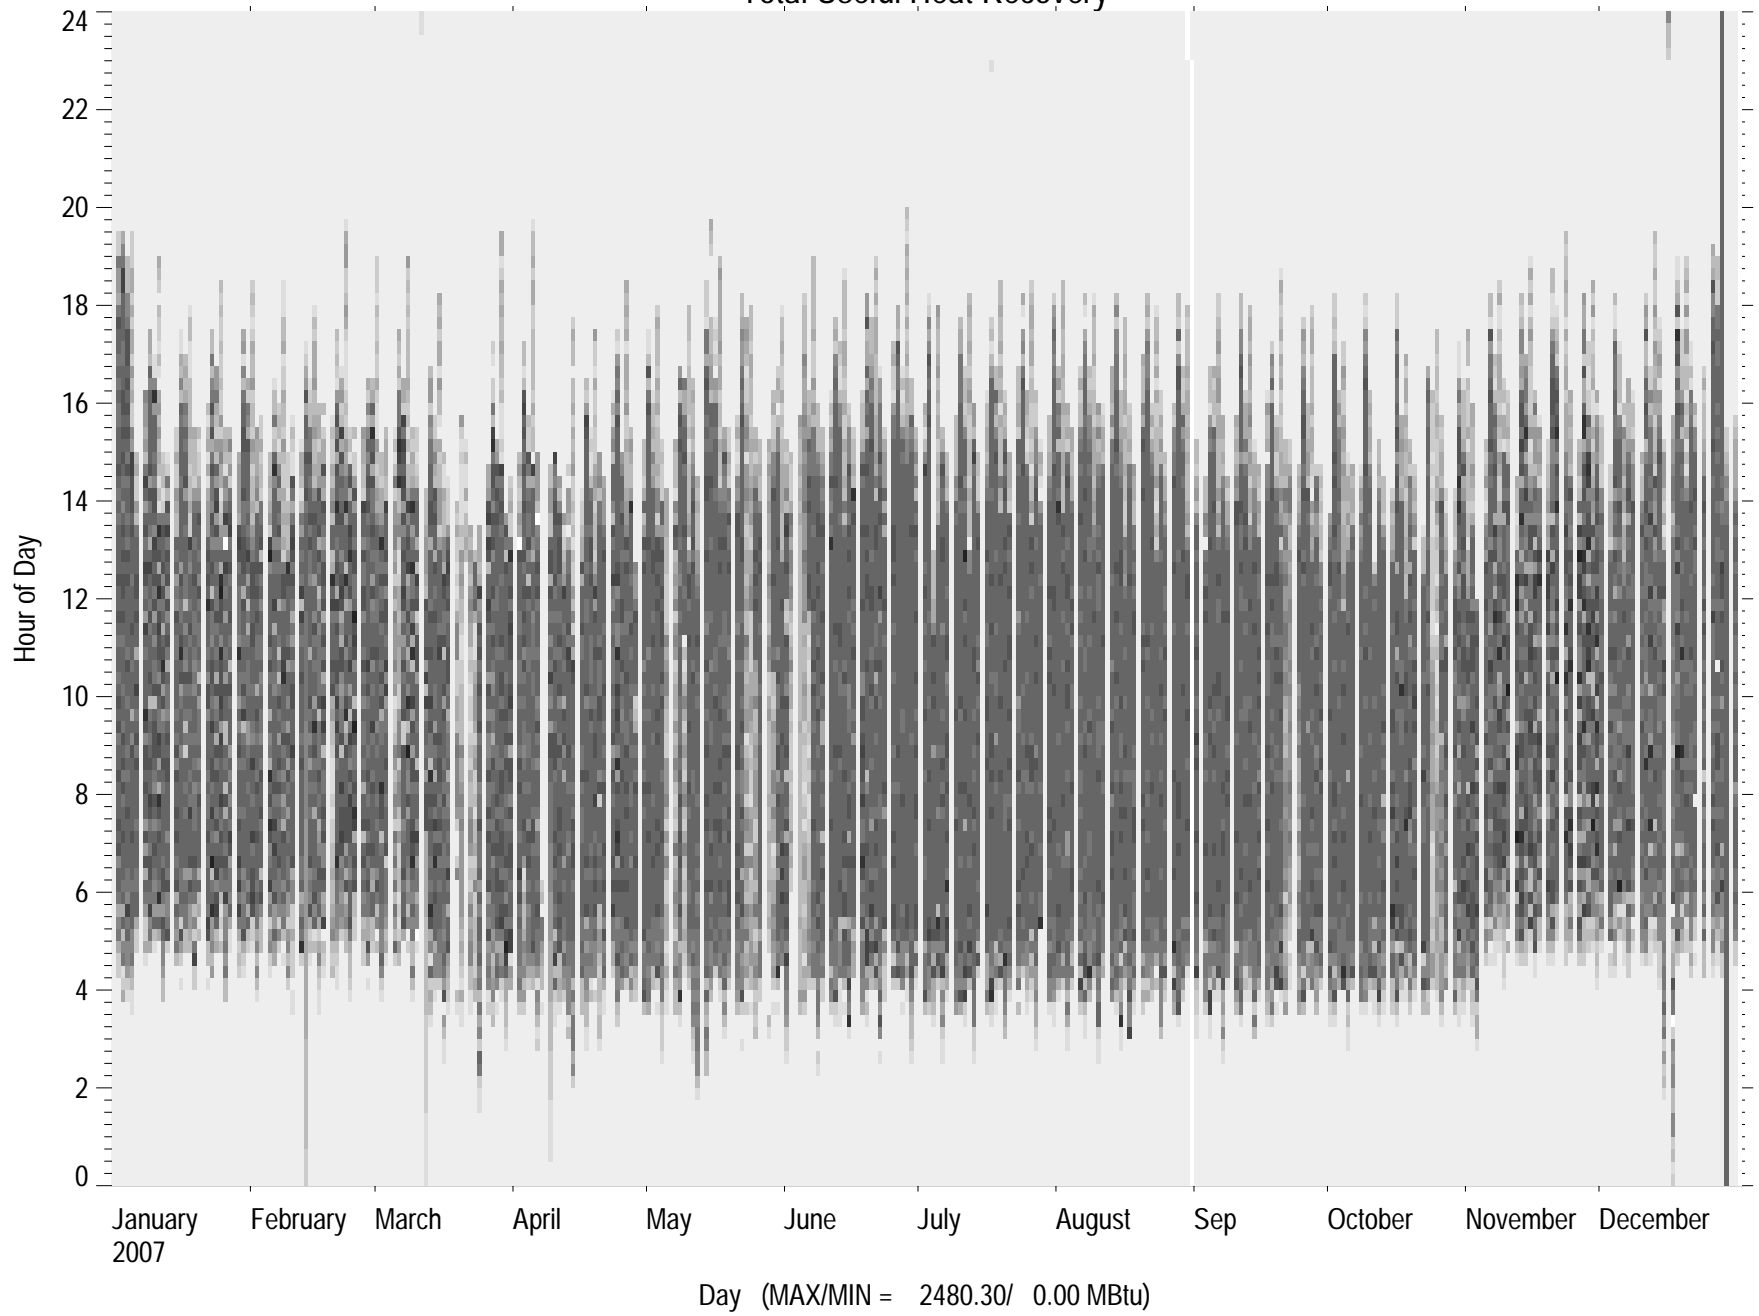

Total Unused Heat Recovery

