


# GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Arrow Linen


11/01/08 to 11/30/08

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
11/01/08	100.00	0.00	n/a	0.00	0.00	0.00	-
11/02/08	100.00	0.00	n/a	0.00	0.00	0.00	-
11/03/08	99.48	8.75	n/a	22399.02	11291.49	0.00	100.00
11/04/08	100.00	4.50	n/a	12099.02	6241.83	0.00	100.00
11/05/08	100.00	0.00	n/a	0.68	0.00	0.00	-
11/06/08	100.00	0.00	n/a	0.00	0.00	0.00	-
11/07/08	100.00	2.75	n/a	7300.03	3661.09	0.00	100.00
11/08/08	100.00	0.00	n/a	0.00	0.00	0.00	-
11/09/08	100.00	0.00	n/a	0.00	0.00	0.00	-
11/10/08	100.00	0.00	n/a	0.00	0.00	0.00	-
11/11/08	100.00	0.00	n/a	0.00	0.00	0.00	-
11/12/08	100.00	12.00	n/a	33799.22	16350.91	9.39	99.94
11/13/08	100.00	14.25	n/a	35499.12	18116.40	9.79	99.95
11/14/08	100.00	12.50	n/a	34099.82	17509.81	13.19	99.92
11/15/08	99.48	11.50	n/a	30999.22	15841.72	0.00	100.00
11/16/08	100.00	0.00	n/a	0.00	0.00	0.00	-
11/17/08	100.00	10.75	n/a	30298.82	15161.38	0.00	100.00
11/18/08	99.48	14.00	n/a	40300.40	20495.63	2.59	99.99
11/19/08	99.48	12.25	n/a	33799.90	17306.08	0.00	100.00
11/20/08	100.00	13.75	n/a	33999.80	17577.41	2.80	99.98
11/21/08	100.00	13.00	n/a	25599.60	12781.03	3.97	99.97
11/22/08	99.48	11.75	n/a	17600.70	9398.33	23.95	99.75
11/23/08	100.00	0.00	n/a	0.68	0.00	0.00	-
11/24/08	100.00	11.50	n/a	21399.62	10615.82	9.01	99.92
11/25/08	100.00	14.25	n/a	40399.60	20330.77	1.00	100.00
11/26/08	100.00	13.50	n/a	37999.30	19594.53	0.00	100.00
11/27/08	100.00	0.00	n/a	0.00	0.00	0.00	-
11/28/08	100.00	14.75	n/a	36999.12	18481.29	0.00	100.00
11/29/08	98.96	11.25	n/a	30299.50	15416.40	0.00	100.00
11/30/08	100.00	0.00	n/a	0.68	0.00	0.00	-
<b>Total</b>	<b>99.88</b>	<b>207.00</b>	<b>n/a</b>	<b>524893.88</b>	<b>266171.91</b>	<b>75.68</b>	<b>99.97</b>

# Generator Gas Use

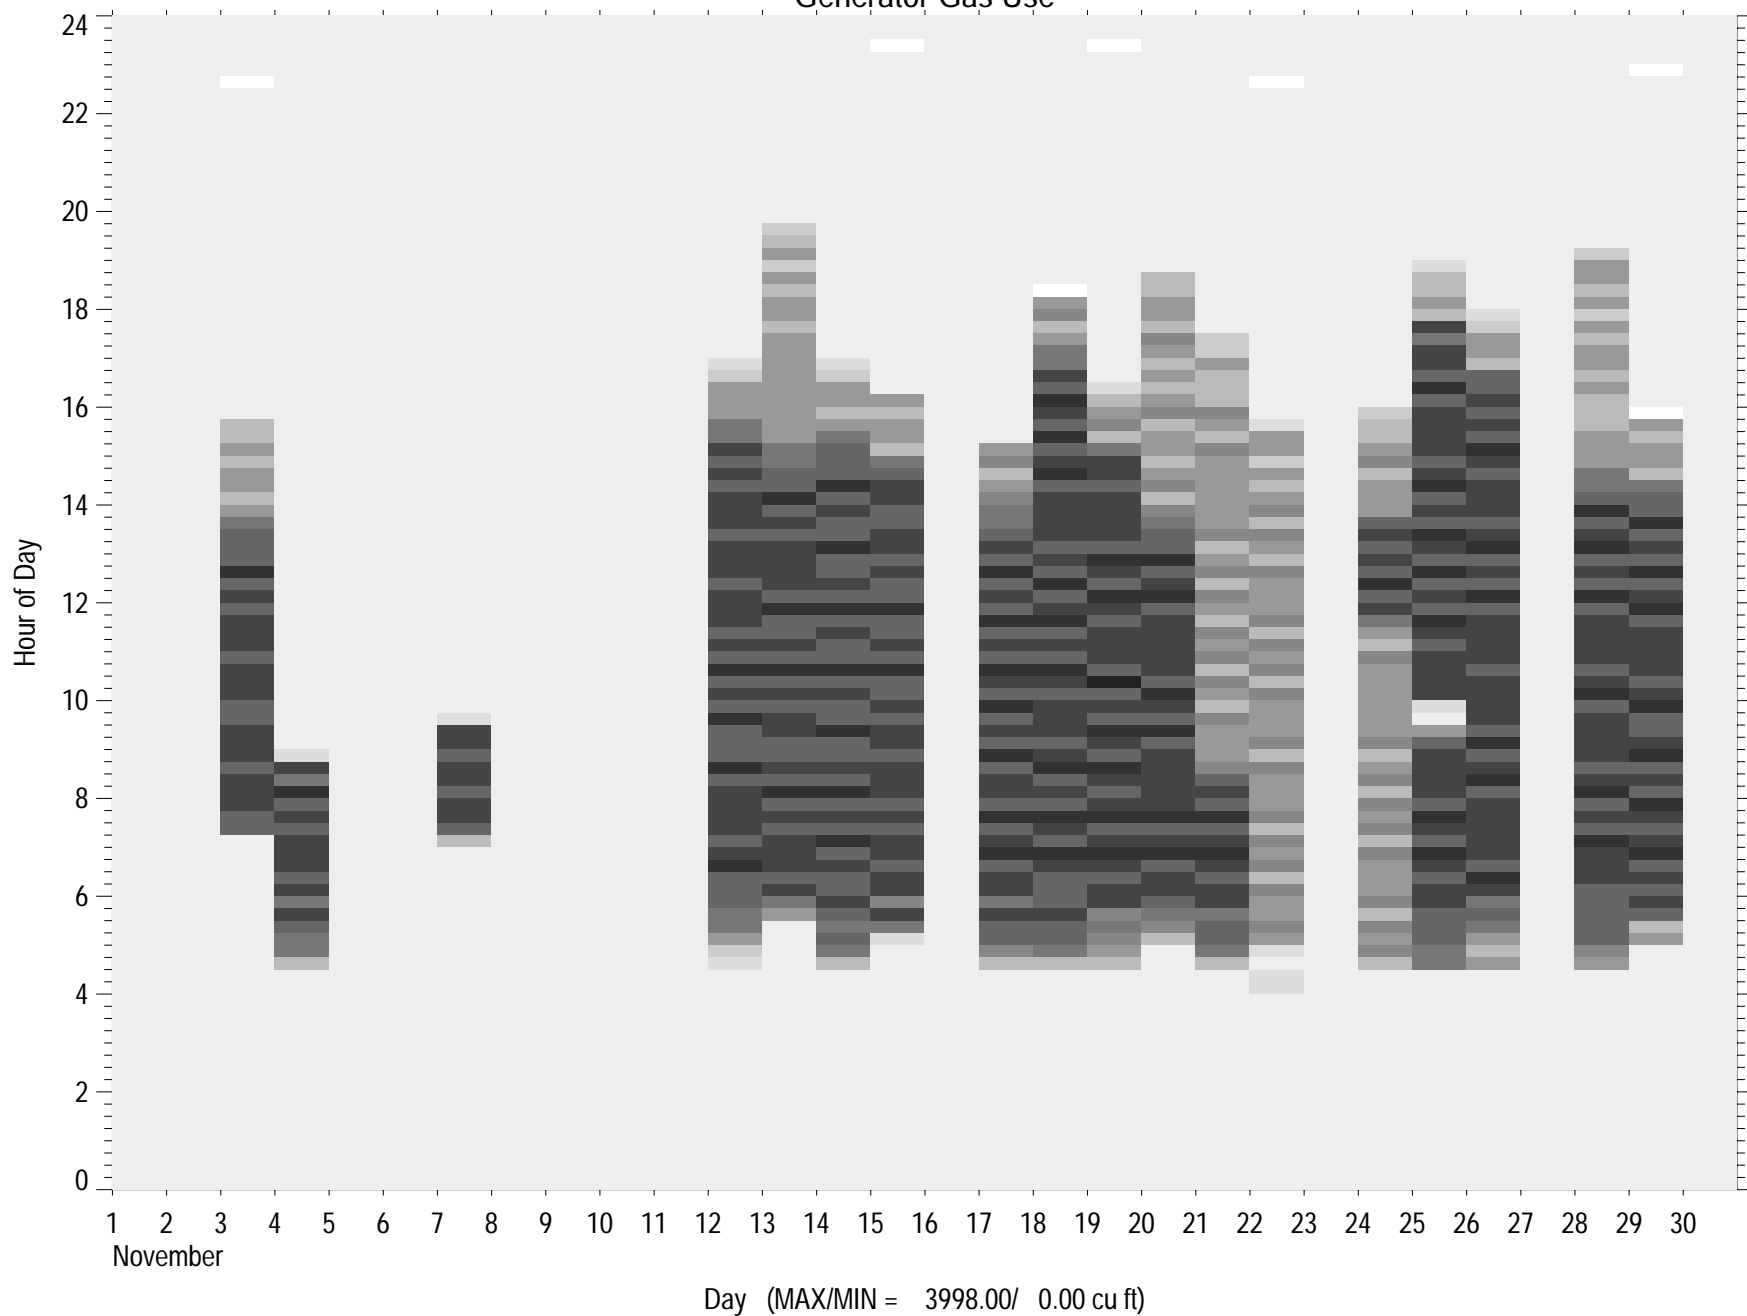

# Total Useful Heat Recovery

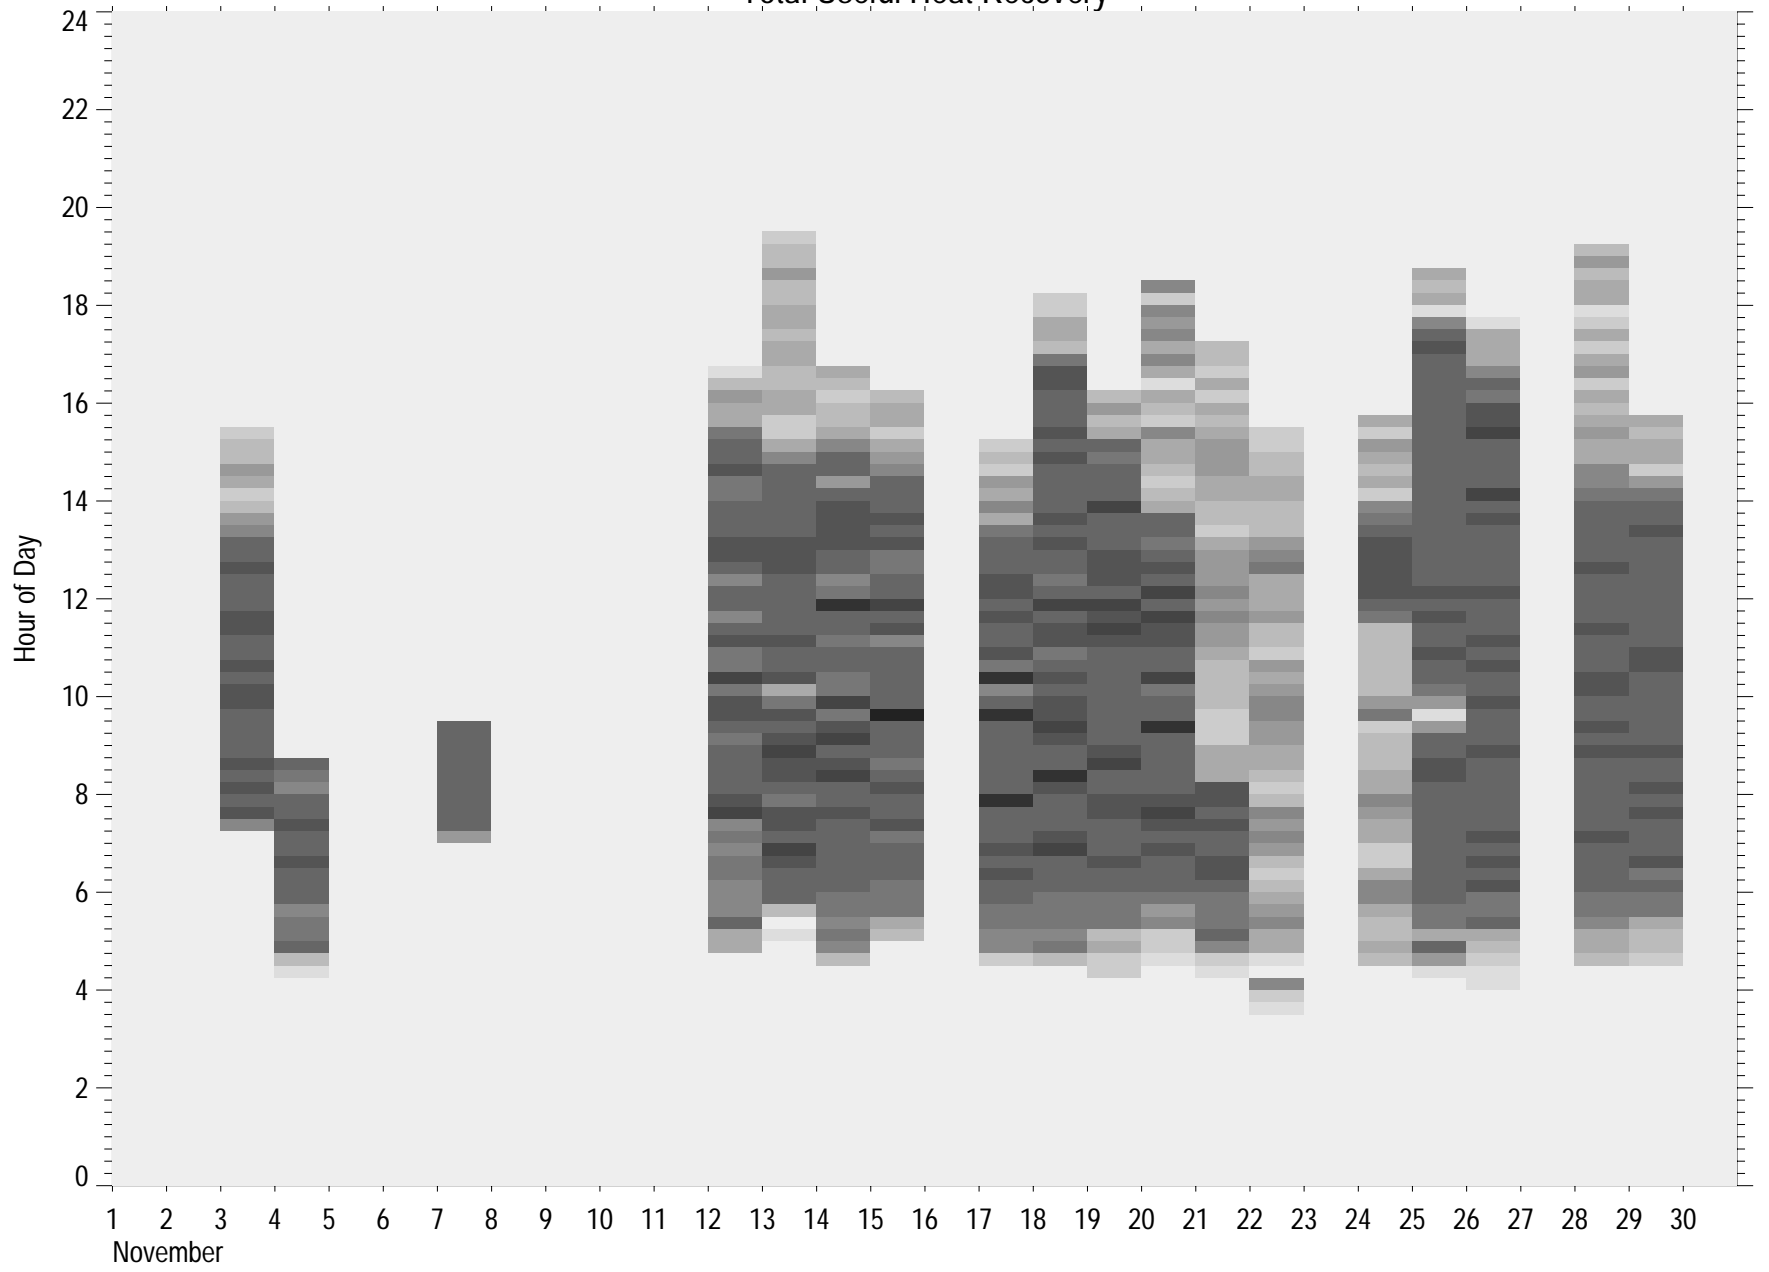

Day (MAX/MIN = 2307.18/ 0.00 MBtu)

# Total Unused Heat Recovery

