


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Arrow Linen


01/01/08 to 12/31/08

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
Jan 2008	99.75	314.25	n/a	830384.38	400496.91	20.71	99.99
Feb 2008	92.85	240.75	n/a	636582.88	306062.91	25.33	99.99
Mar 2008	99.75	315.50	n/a	828683.25	403323.25	20.19	99.99
Apr 2008	99.72	257.00	n/a	611084.81	328109.22	693.90	99.79
May 2008	99.83	280.50	n/a	749583.81	515262.81	72.67	99.99
Jun 2008	99.93	206.50	n/a	553886.69	736639.13	287.56	99.96
Jul 2008	99.83	375.50	n/a	949783.38	502732.38	144.81	99.97
Aug 2008	99.83	336.50	n/a	887783.31	457030.56	58.79	99.99
Sep 2008	99.88	339.75	n/a	877977.81	450683.41	54.50	99.99
Oct 2008	99.76	273.50	n/a	730382.81	376028.75	56.66	99.98
Nov 2008	99.88	207.00	n/a	524893.88	266171.91	75.68	99.97
Dec 2008	99.83	328.25	n/a	870302.81	437950.50	184.22	99.96
Total	99.27	3475.00	n/a	9051330.00	5180492.00	1695.02	99.97

Generator Gas Use

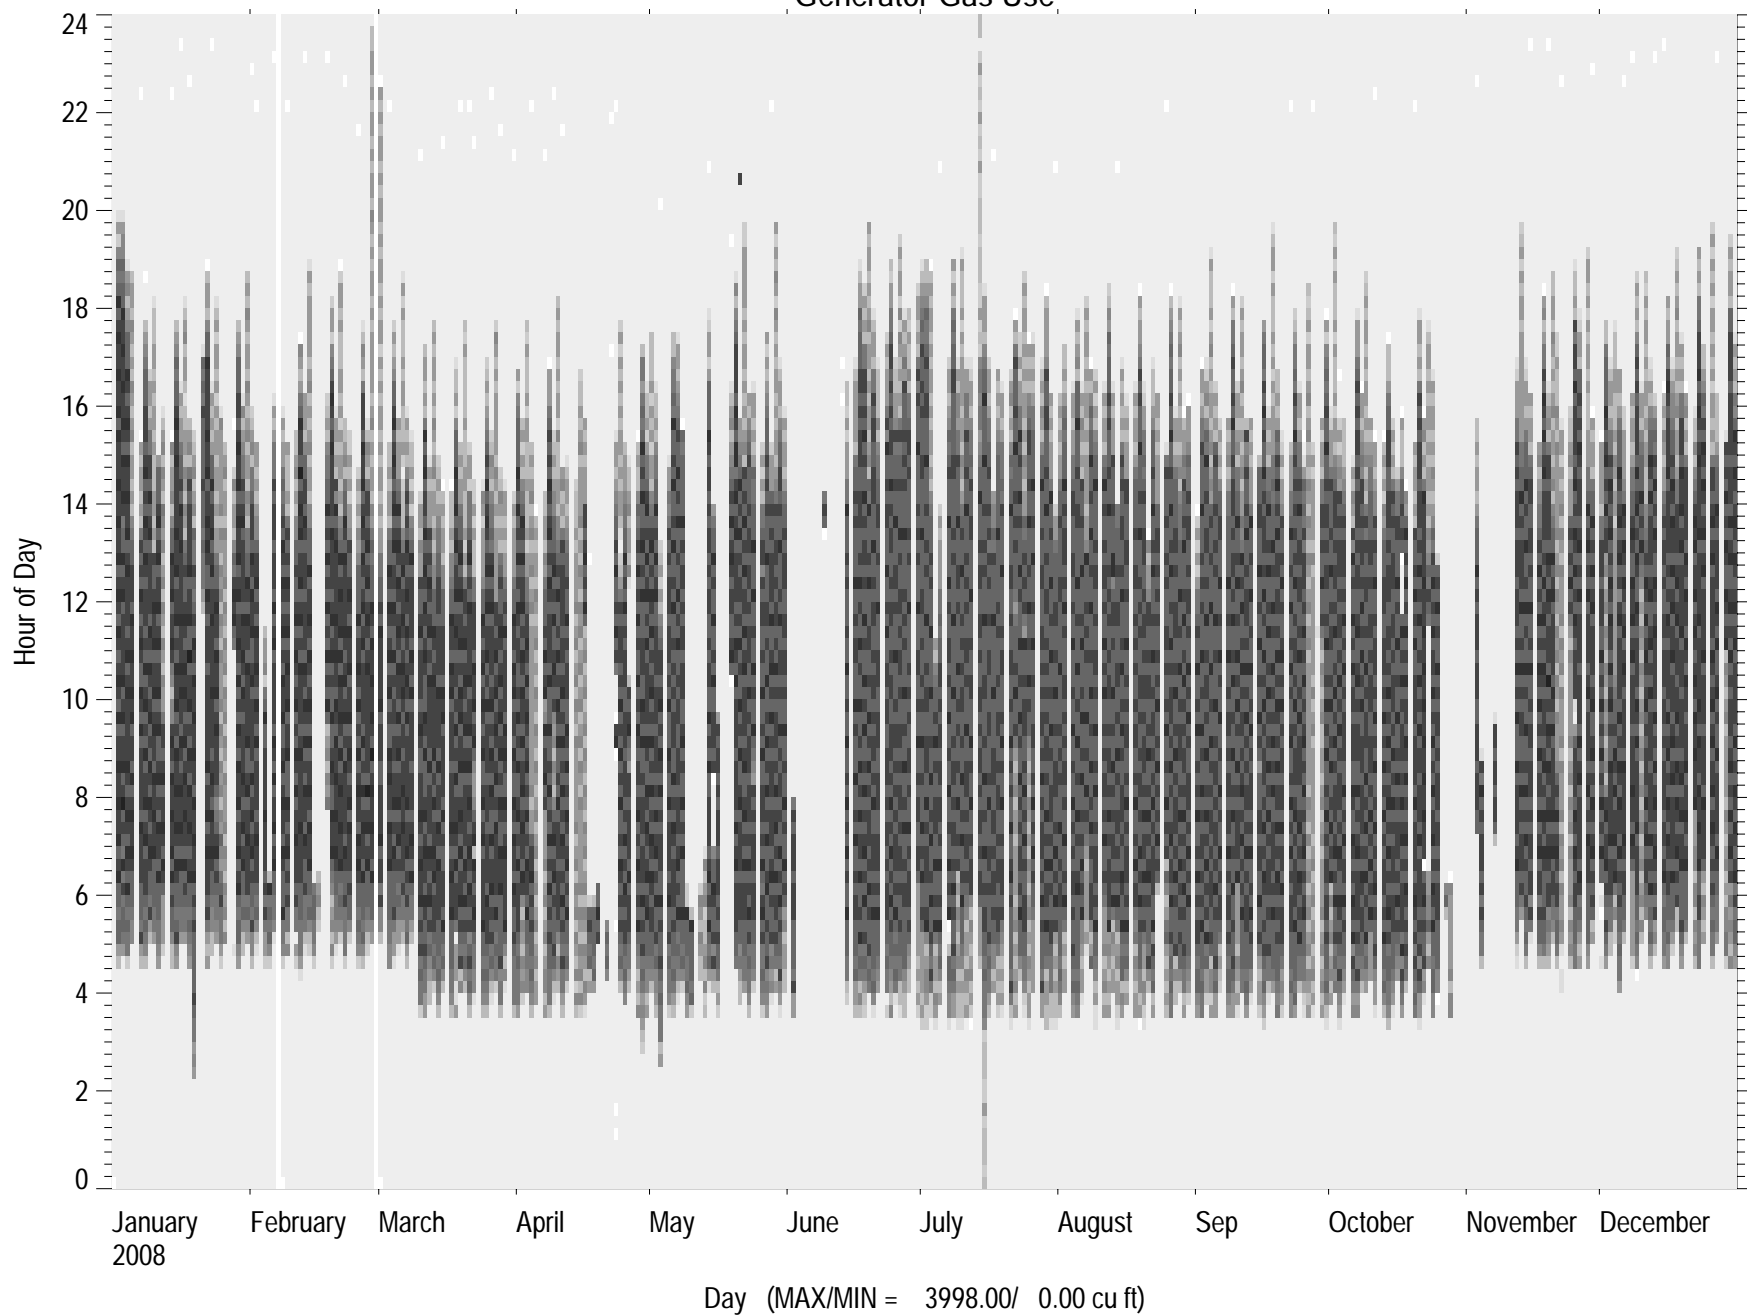

Total Useful Heat Recovery

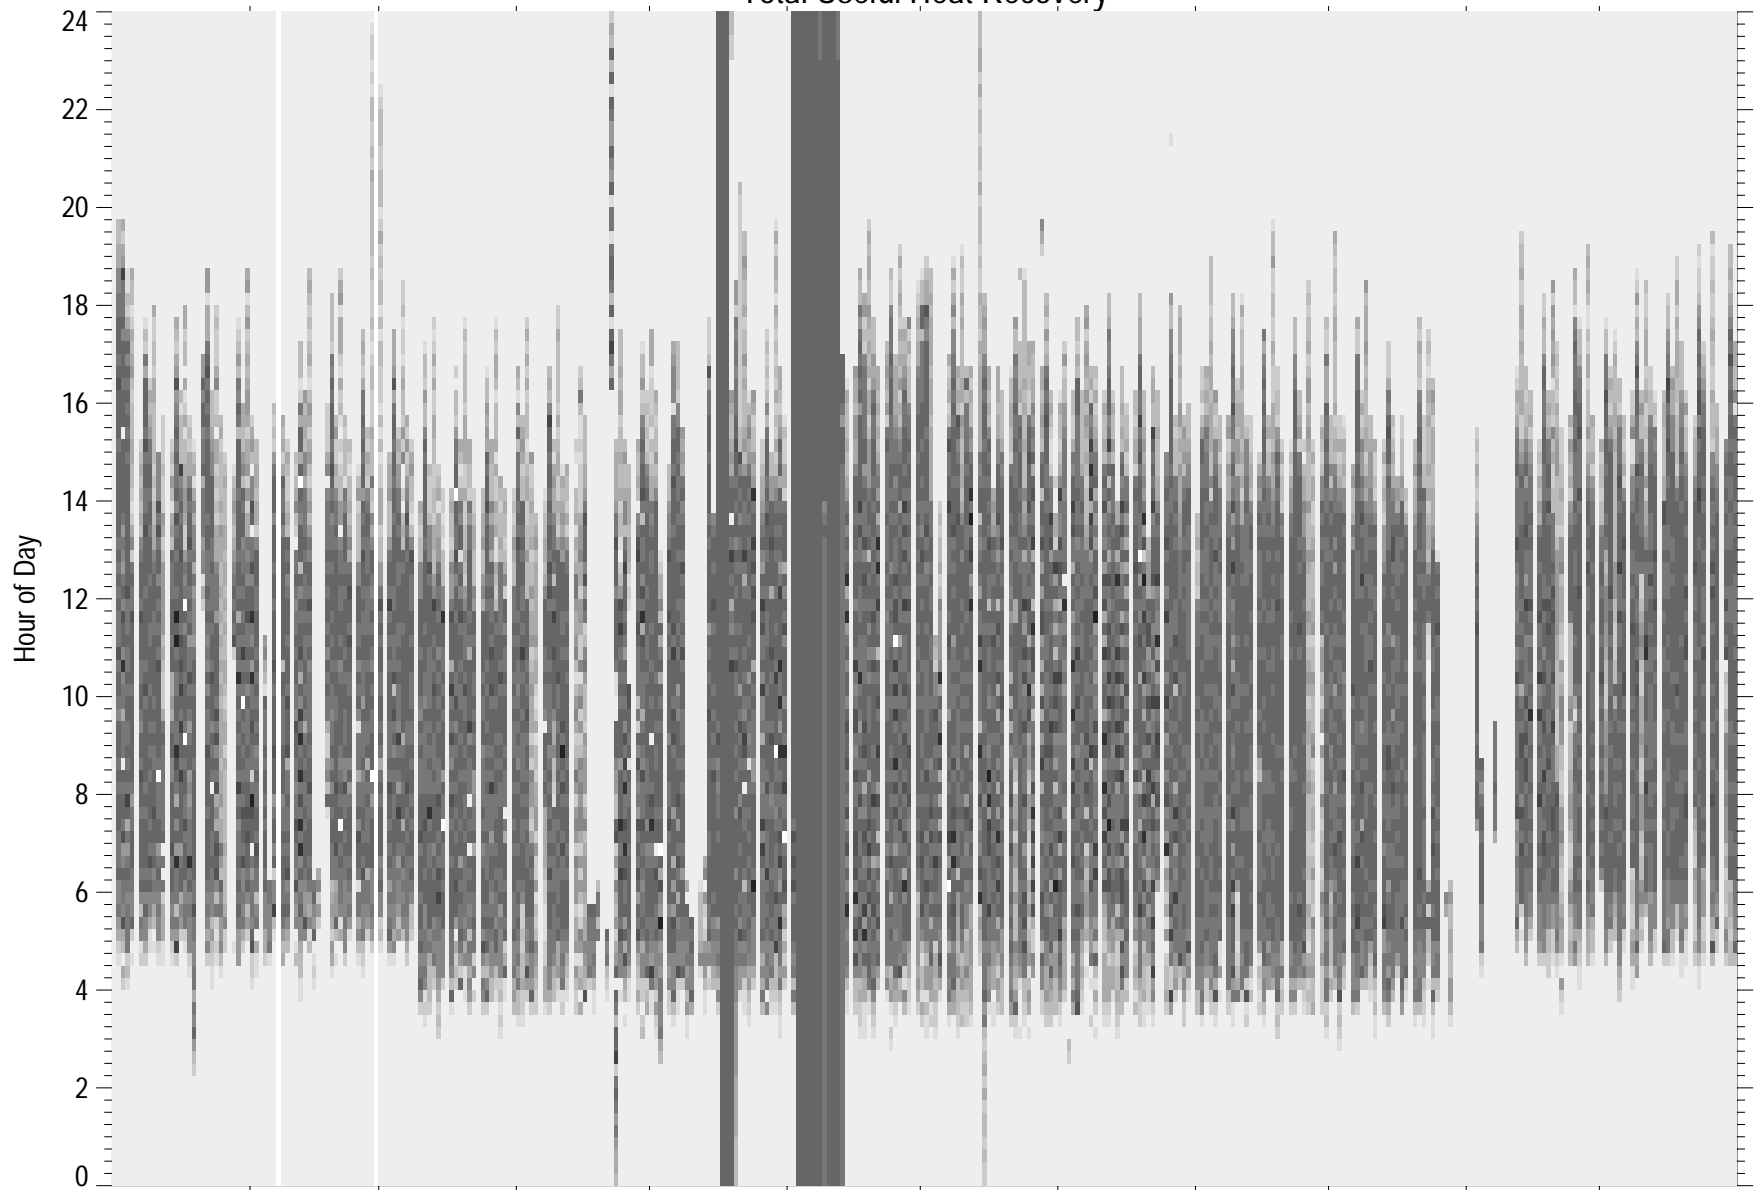

January 2008 February March April May June July August Sep October November December

Day (MAX/MIN = 2494.38/ 0.00 MBtu)

Total Unused Heat Recovery

