


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Ten West 66th St. Corp.

11/01/05 to 12/31/05

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
Nov 2005	43.02	230.23	n/a	209680.00	57745.28	n/a	n/a
Dec 2005	99.06	679.99	n/a	639740.00	168927.58	n/a	n/a
Total	71.50	910.22	n/a	849420.00	226672.86	n/a	n/a

Generator Gas Use

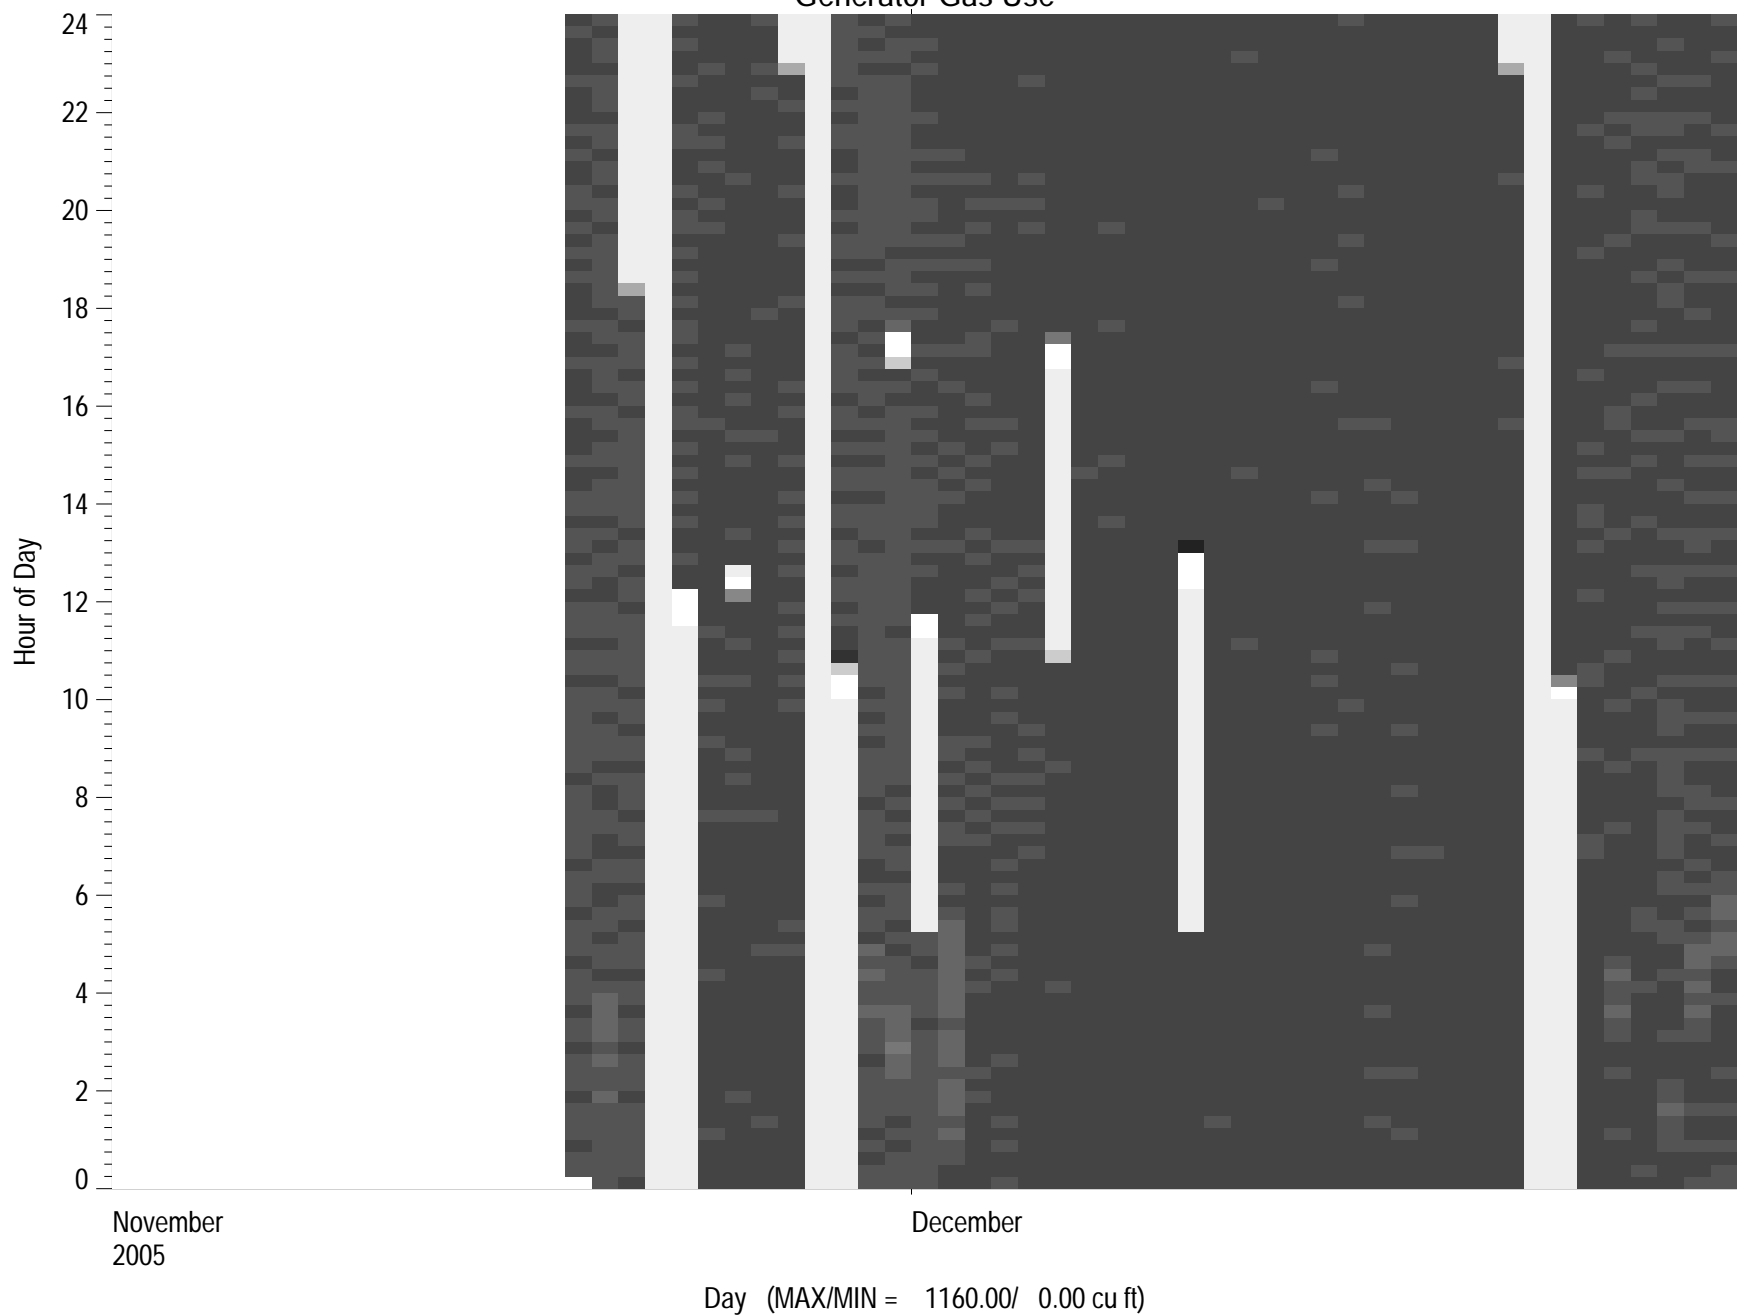

Total Useful Heat Recovery

