


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Ten West 66th St. Corp.

05/01/06 to 05/31/06

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
05/01/06	100.00	24.00	n/a	50900.00	5962.52	n/a	n/a
05/02/06	100.00	23.53	n/a	51100.00	5957.72	n/a	n/a
05/03/06	100.00	24.00	n/a	50900.00	5943.31	n/a	n/a
05/04/06	100.00	21.18	n/a	39700.00	5813.58	n/a	n/a
05/05/06	100.00	9.69	n/a	24800.00	5755.93	n/a	n/a
05/06/06	100.00	16.02	n/a	23900.00	5752.72	n/a	n/a
05/07/06	100.00	23.30	n/a	23900.00	5802.37	n/a	n/a
05/08/06	100.00	24.00	n/a	24100.00	5781.55	n/a	n/a
05/09/06	100.00	23.53	n/a	23800.00	5786.35	n/a	n/a
05/10/06	100.00	20.01	n/a	23700.00	5787.96	n/a	n/a
05/11/06	100.00	20.72	n/a	23700.00	5787.96	n/a	n/a
05/12/06	100.00	17.90	n/a	23600.00	5778.35	n/a	n/a
05/13/06	100.00	21.42	n/a	23500.00	5791.16	n/a	n/a
05/14/06	100.00	24.00	n/a	23700.00	5824.79	n/a	n/a
05/15/06	100.00	24.00	n/a	23800.00	5824.79	n/a	n/a
05/16/06	100.00	22.59	n/a	23800.00	5828.00	n/a	n/a
05/17/06	100.00	12.04	n/a	23500.00	5781.55	n/a	n/a
05/18/06	100.00	2.63	n/a	23100.00	5695.07	n/a	n/a
05/19/06	100.00	9.46	n/a	23300.00	5779.95	n/a	n/a
05/20/06	100.00	13.45	n/a	23000.00	5791.16	n/a	n/a
05/21/06	100.00	16.50	n/a	23200.00	5802.37	n/a	n/a
05/22/06	100.00	24.00	n/a	23500.00	5831.20	n/a	n/a
05/23/06	100.00	23.77	n/a	23700.00	5831.20	n/a	n/a
05/24/06	100.00	13.68	n/a	23600.00	5733.50	n/a	n/a
05/25/06	100.00	3.57	n/a	23400.00	5637.41	n/a	n/a
05/26/06	100.00	1.44	n/a	22800.00	5606.98	n/a	n/a
05/27/06	100.00	1.45	n/a	22700.00	5621.40	n/a	n/a
05/28/06	100.00	2.64	n/a	22800.00	5598.98	n/a	n/a
05/29/06	100.00	1.43	n/a	22800.00	5509.29	n/a	n/a
05/30/06	100.00	1.39	n/a	23000.00	5393.98	n/a	n/a
05/31/06	100.00	1.37	n/a	22500.00	5320.31	n/a	n/a
Total	100.00	468.72	n/a	825800.00	178113.39	n/a	n/a

Generator Gas Use

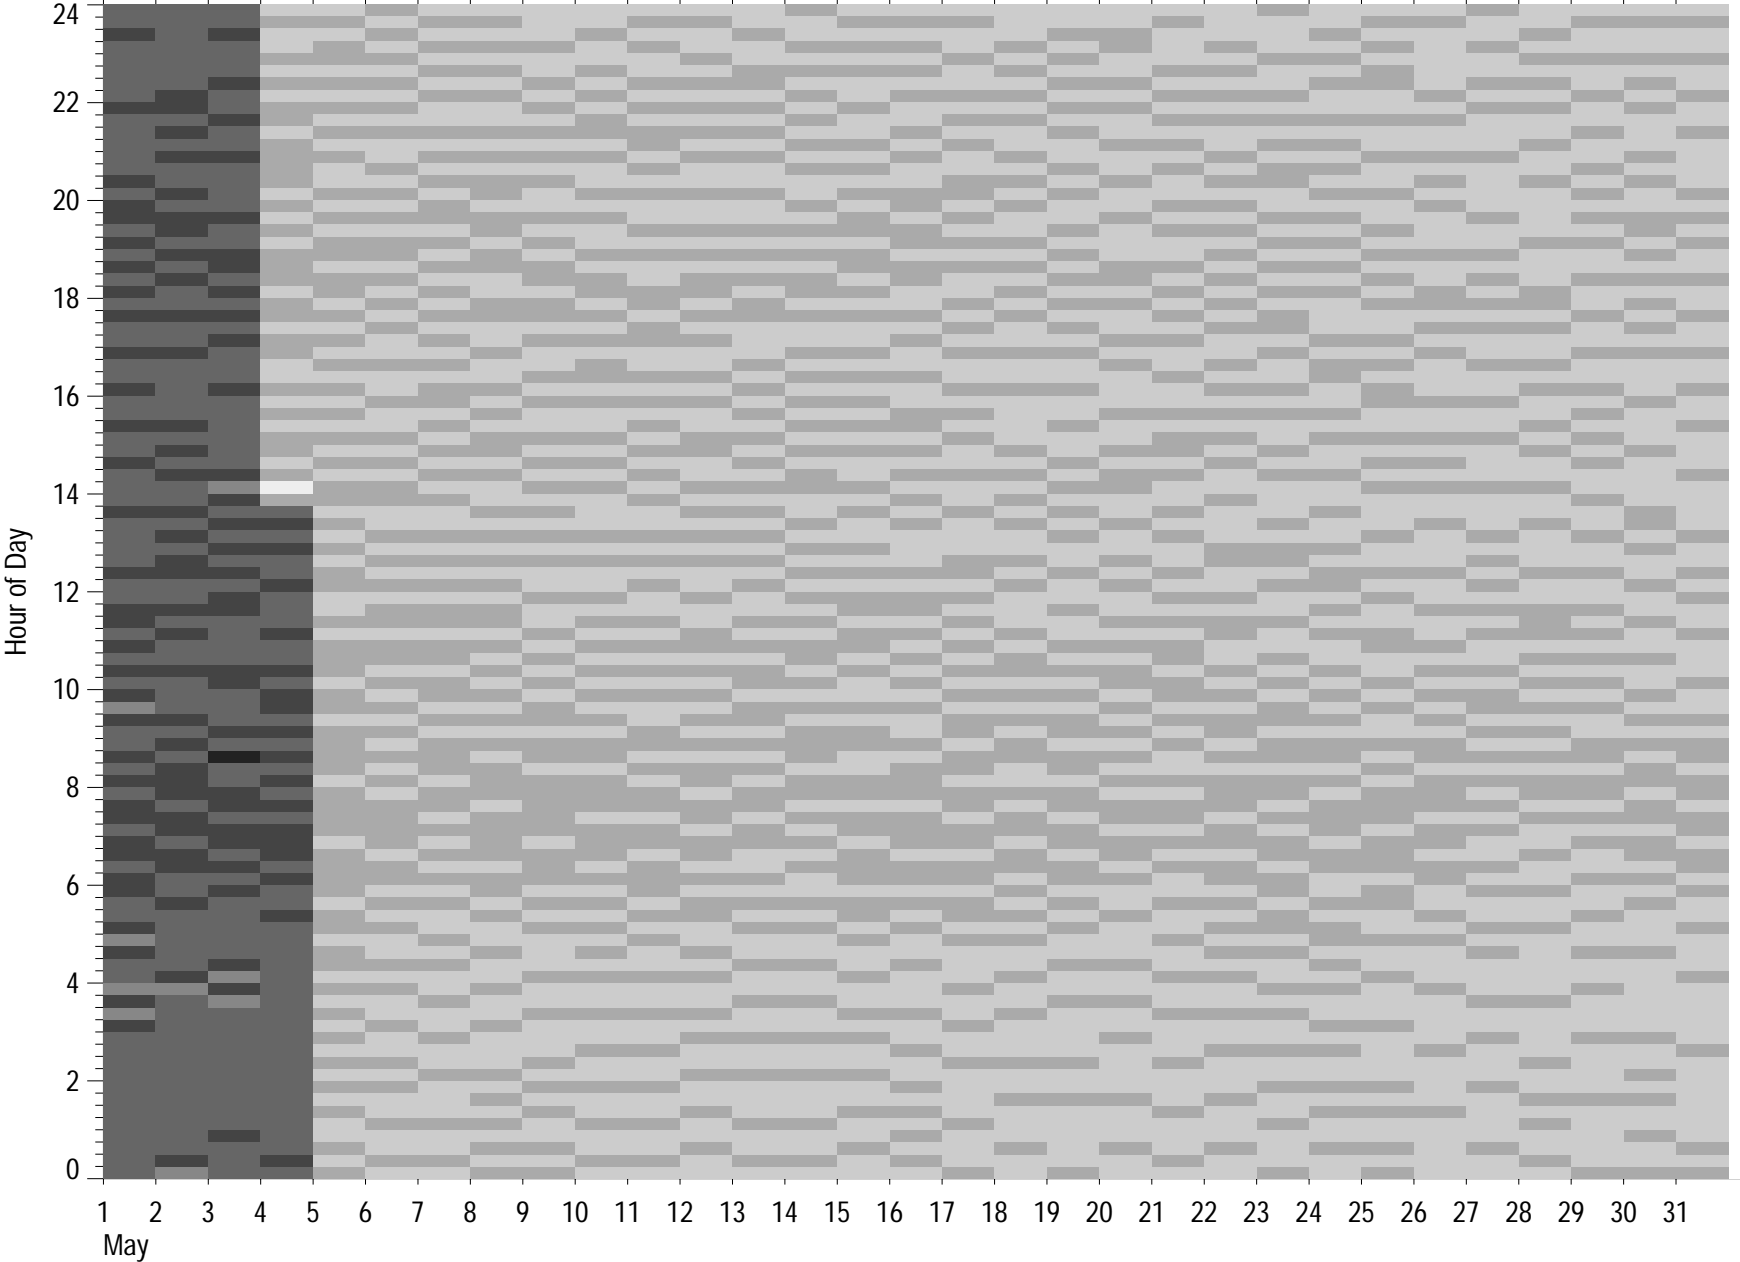

Day (MAX/MIN = 2800.00/ 400.00 cu ft)

