


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Ten West 66th St. Corp.

10/01/07 to 10/31/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
10/01/07	100.00	1.42	n/a	19450.00	0.00	n/a	n/a
10/02/07	100.00	1.39	n/a	19260.00	0.00	n/a	n/a
10/03/07	100.00	1.34	n/a	18970.00	0.00	n/a	n/a
10/04/07	100.00	1.29	n/a	18510.00	0.00	n/a	n/a
10/05/07	100.00	1.28	n/a	18100.00	0.00	n/a	n/a
10/06/07	100.00	1.24	n/a	17870.00	0.00	n/a	n/a
10/07/07	100.00	1.21	n/a	17600.00	0.00	n/a	n/a
10/08/07	100.00	1.19	n/a	17390.00	0.00	n/a	n/a
10/09/07	100.00	1.20	n/a	17550.00	0.00	n/a	n/a
10/10/07	100.00	1.35	n/a	18990.00	0.00	n/a	n/a
10/11/07	100.00	1.45	n/a	20020.00	0.00	n/a	n/a
10/12/07	100.00	13.68	n/a	20470.00	0.00	n/a	n/a
10/13/07	100.00	24.00	n/a	20650.00	0.00	n/a	n/a
10/14/07	99.31	18.39	n/a	17580.00	0.00	n/a	n/a
10/15/07	100.00	17.67	n/a	20310.00	0.00	n/a	n/a
10/16/07	100.00	12.97	n/a	20150.00	0.00	n/a	n/a
10/17/07	100.00	4.51	n/a	19770.00	0.00	n/a	n/a
10/18/07	100.00	1.42	n/a	19600.00	0.00	n/a	n/a
10/19/07	100.00	1.41	n/a	19610.00	0.00	n/a	n/a
10/20/07	100.00	1.70	n/a	20110.00	0.00	n/a	n/a
10/21/07	100.00	10.84	n/a	19900.00	0.00	n/a	n/a
10/22/07	100.00	1.45	n/a	19690.00	0.00	n/a	n/a
10/23/07	100.00	1.41	n/a	19440.00	0.00	n/a	n/a
10/24/07	99.31	6.37	n/a	16230.00	0.00	n/a	n/a
10/25/07	100.00	24.00	n/a	20740.00	0.00	n/a	n/a
10/26/07	100.00	24.00	n/a	20580.00	0.00	n/a	n/a
10/27/07	100.00	11.09	n/a	19970.00	0.00	n/a	n/a
10/28/07	100.00	24.00	n/a	20820.00	0.00	n/a	n/a
10/29/07	100.00	24.00	n/a	21150.00	0.00	n/a	n/a
10/30/07	100.00	24.00	n/a	20610.00	0.00	n/a	n/a
10/31/07	100.00	24.00	n/a	20360.00	0.00	n/a	n/a
Total	99.96	285.27	n/a	601450.00	0.00	n/a	n/a

Generator Gas Use

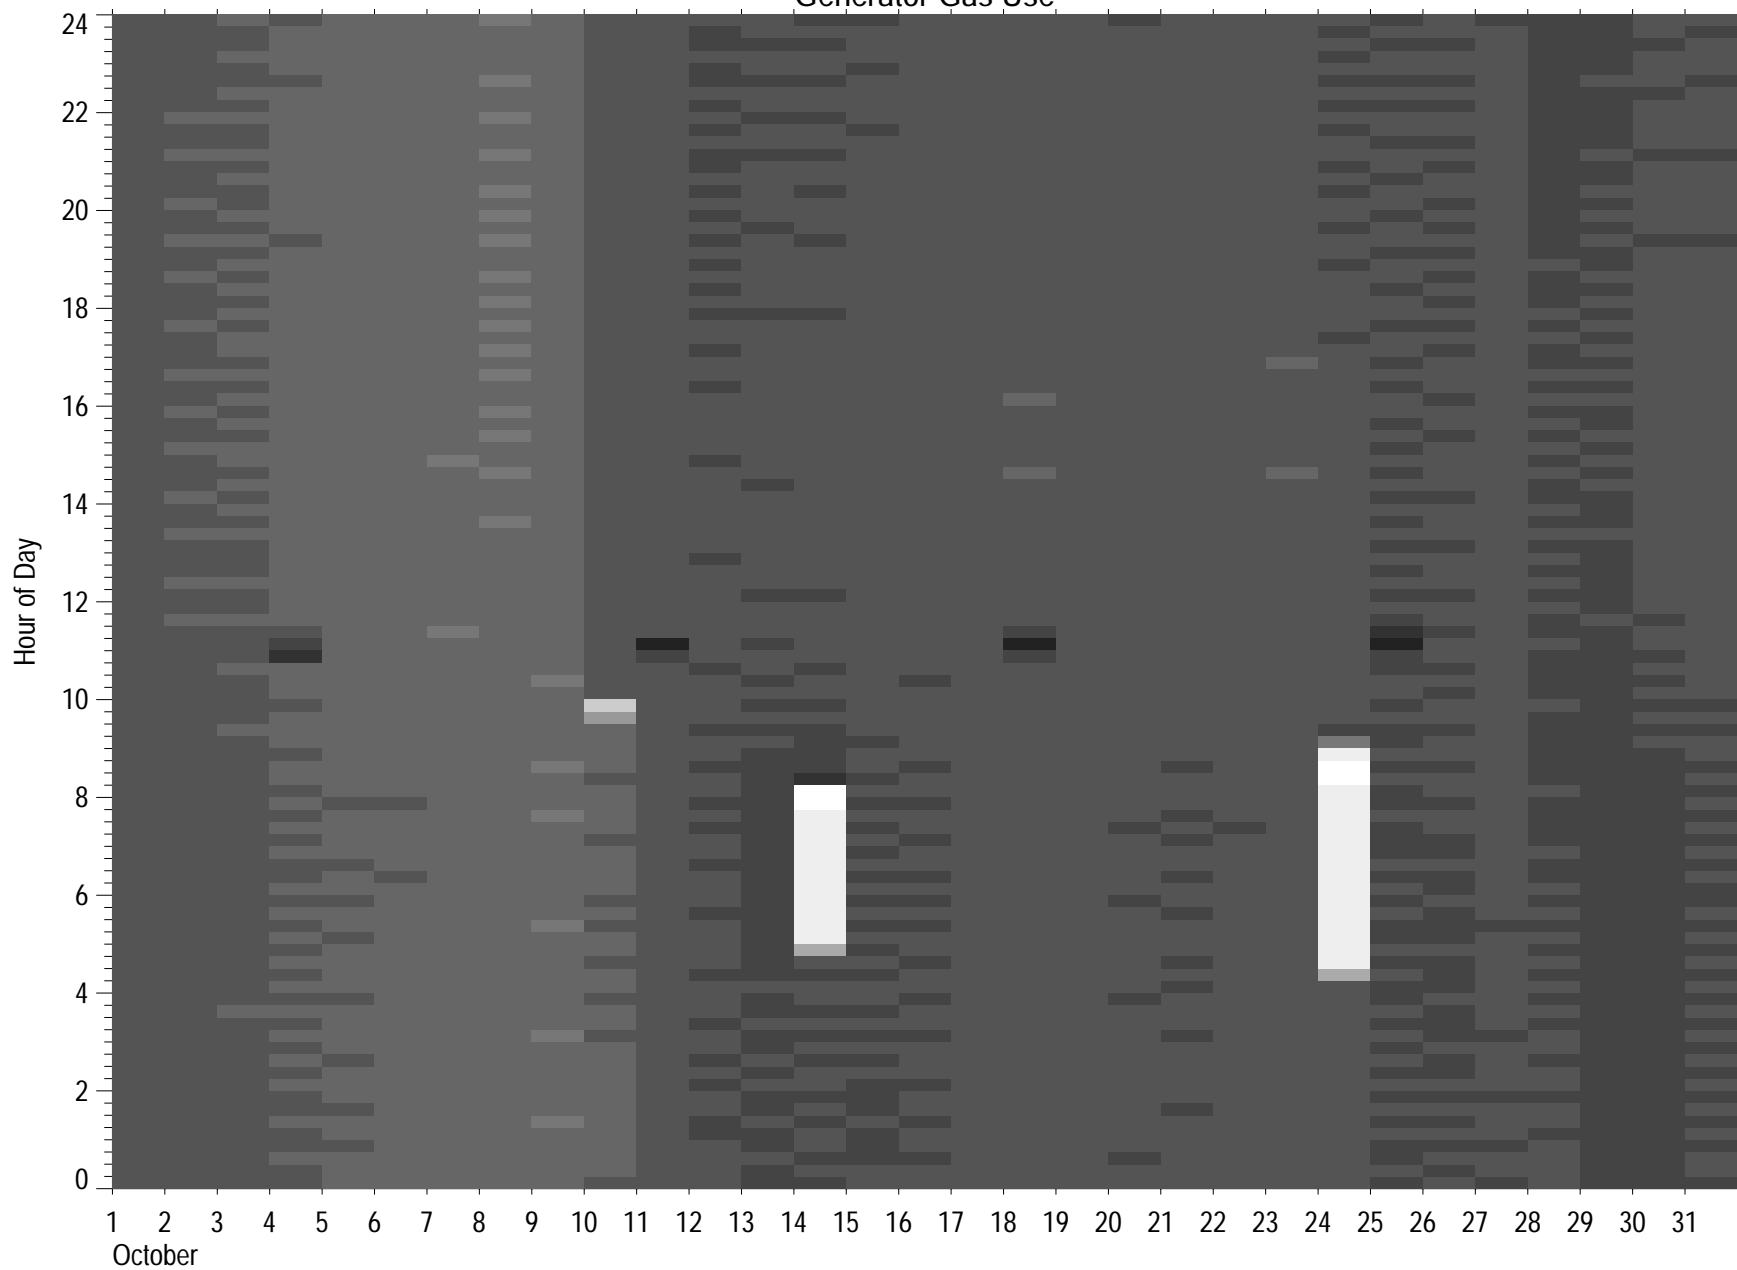

Day (MAX/MIN = 1120.00/ 0.00 cu ft)

Total Useful Heat Recovery

