


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Ten West 66th St. Corp.
02/01/08 to 02/29/08

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
02/01/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/02/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/03/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/04/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/05/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/06/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/07/08	0.00	-	n/a	-	-	n/a	n/a
02/08/08	100.00	0.00	n/a	100.00	0.00	n/a	n/a
02/09/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/10/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/11/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/12/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/13/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
02/14/08	100.00	0.00	n/a	110.00	0.00	n/a	n/a
02/15/08	99.31	12.77	n/a	11030.00	0.00	n/a	n/a
02/16/08	100.00	24.00	n/a	21760.00	0.00	n/a	n/a
02/17/08	100.00	24.00	n/a	20930.00	0.00	n/a	n/a
02/18/08	100.00	15.29	n/a	19100.00	0.00	n/a	n/a
02/19/08	100.00	24.00	n/a	20680.00	0.00	n/a	n/a
02/20/08	100.00	24.00	n/a	21590.00	0.00	n/a	n/a
02/21/08	100.00	24.00	n/a	21770.00	0.00	n/a	n/a
02/22/08	100.00	24.00	n/a	21520.00	0.00	n/a	n/a
02/23/08	100.00	24.00	n/a	21430.00	0.00	n/a	n/a
02/24/08	100.00	6.52	n/a	6550.00	0.00	n/a	n/a
02/25/08	99.31	7.02	n/a	6180.00	0.00	n/a	n/a
02/26/08	98.96	13.52	n/a	11090.00	0.00	n/a	n/a
02/27/08	100.00	24.00	n/a	20990.00	0.00	n/a	n/a
02/28/08	100.00	24.00	n/a	22530.00	0.00	n/a	n/a
02/29/08	0.00	-	n/a	-	-	n/a	n/a
Total	93.02	271.12	n/a	247360.00	0.00	n/a	n/a

Generator Gas Use

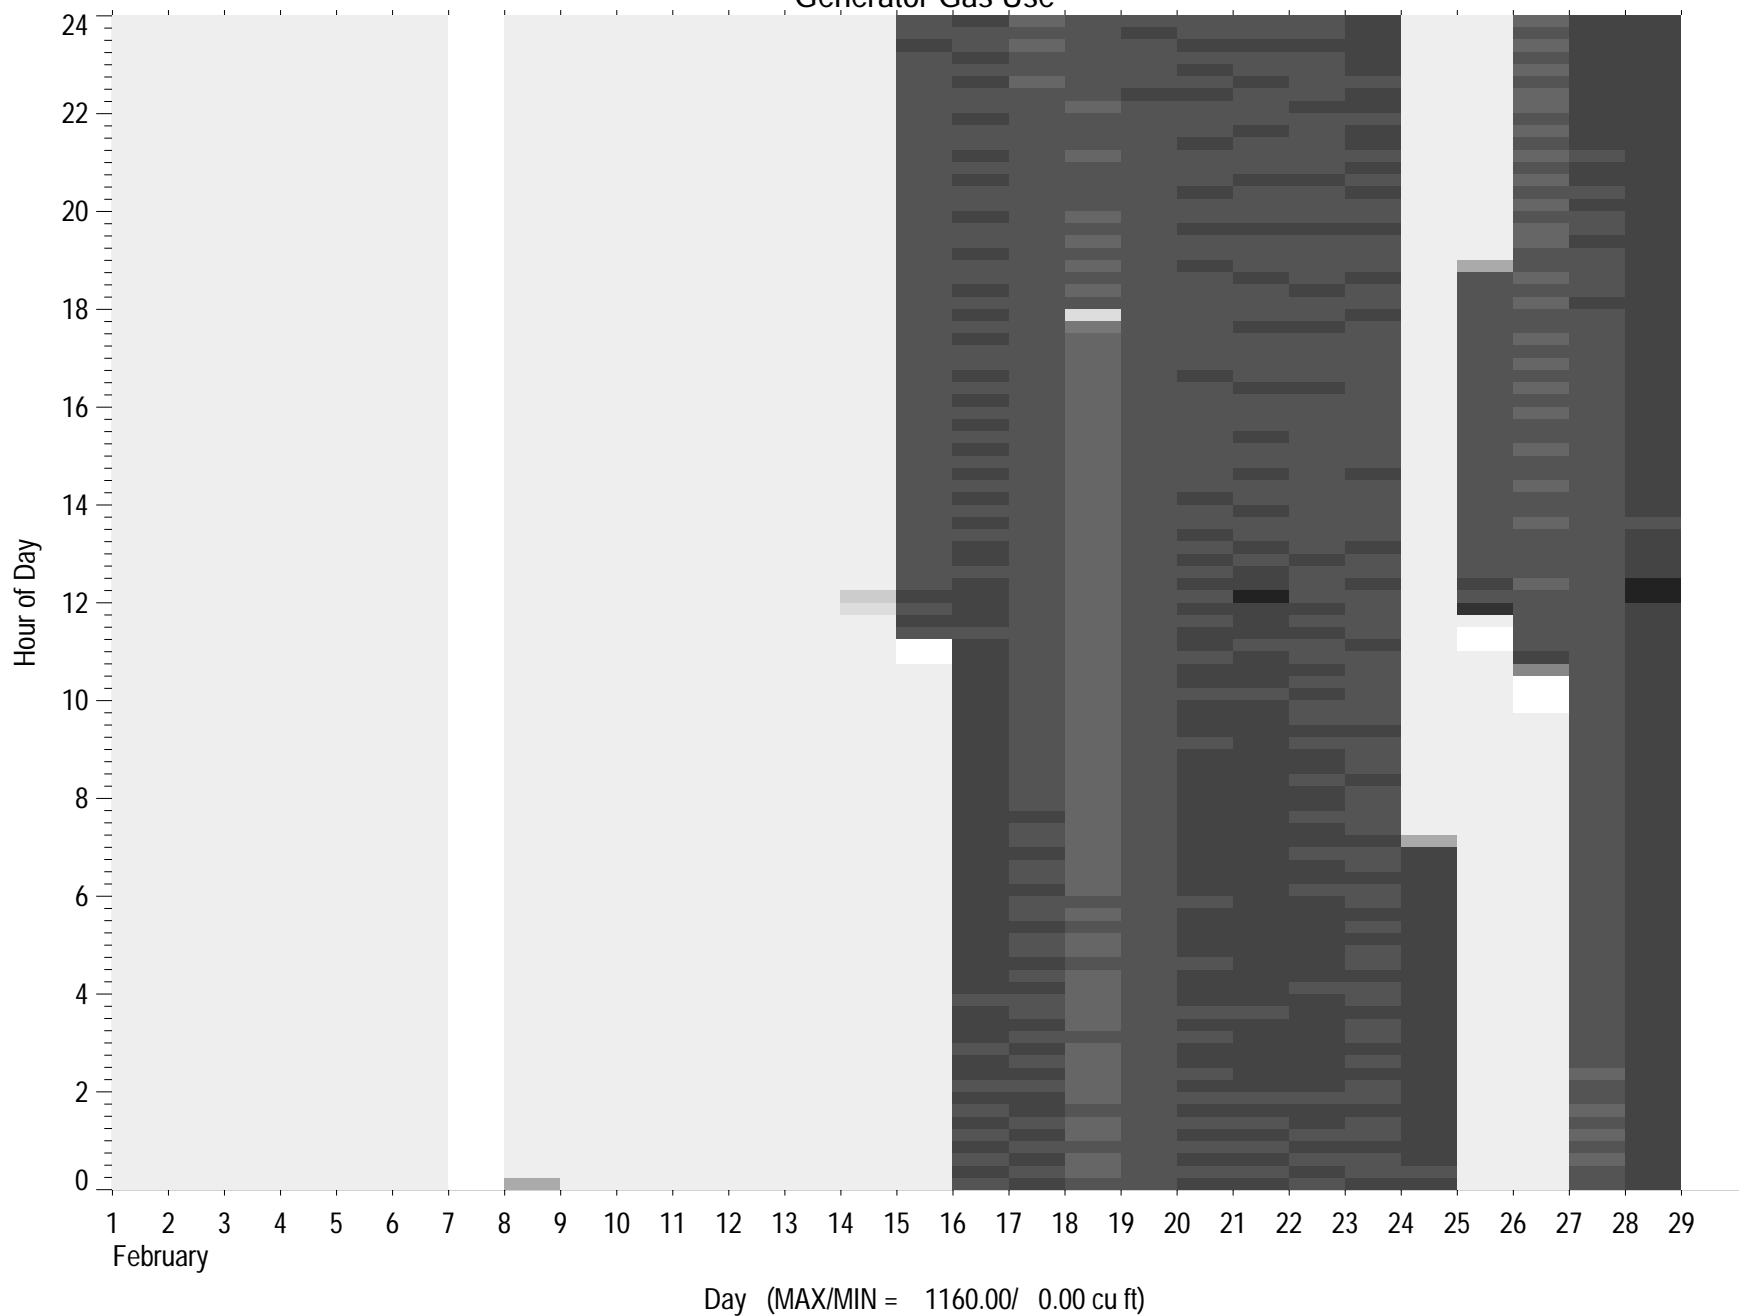

Total Useful Heat Recovery

