


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 1, Brooklyn, NY

07/01/07 to 07/31/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
07/01/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
07/02/07	100.00	24.00	n/a	16700.00	0.00	n/a	n/a
07/03/07	99.48	19.50	n/a	13300.00	0.00	n/a	n/a
07/04/07	99.48	17.75	n/a	8900.00	0.00	n/a	n/a
07/05/07	100.00	1.00	n/a	700.00	0.00	n/a	n/a
07/06/07	100.00	12.50	n/a	6200.00	0.00	n/a	n/a
07/07/07	100.00	2.50	n/a	1200.00	0.00	n/a	n/a
07/08/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
07/09/07	100.00	10.75	n/a	5900.00	0.00	n/a	n/a
07/10/07	100.00	24.00	n/a	11700.00	0.00	n/a	n/a
07/11/07	100.00	23.75	n/a	13200.00	0.00	n/a	n/a
07/12/07	100.00	17.00	n/a	10900.00	0.00	n/a	n/a
07/13/07	100.00	3.00	n/a	1600.00	0.00	n/a	n/a
07/14/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
07/15/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
07/16/07	100.00	0.25	n/a	0.00	0.00	n/a	n/a
07/17/07	100.00	3.00	n/a	2600.00	0.00	n/a	n/a
07/18/07	100.00	17.25	n/a	9100.00	0.00	n/a	n/a
07/19/07	99.48	24.00	n/a	11600.00	0.00	n/a	n/a
07/20/07	99.48	21.50	n/a	10400.00	0.00	n/a	n/a
07/21/07	100.00	24.00	n/a	11700.00	0.00	n/a	n/a
07/22/07	100.00	24.00	n/a	11500.00	0.00	n/a	n/a
07/23/07	100.00	24.00	n/a	11700.00	0.00	n/a	n/a
07/24/07	100.00	24.00	n/a	11600.00	0.00	n/a	n/a
07/25/07	100.00	21.50	n/a	10400.00	0.00	n/a	n/a
07/26/07	100.00	20.75	n/a	10000.00	0.00	n/a	n/a
07/27/07	100.00	17.75	n/a	9900.00	0.00	n/a	n/a
07/28/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
07/29/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
07/30/07	100.00	7.00	n/a	3500.00	0.00	n/a	n/a
07/31/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
Total	99.93	408.75	n/a	216500.00	0.00	n/a	n/a

Generator Gas Use

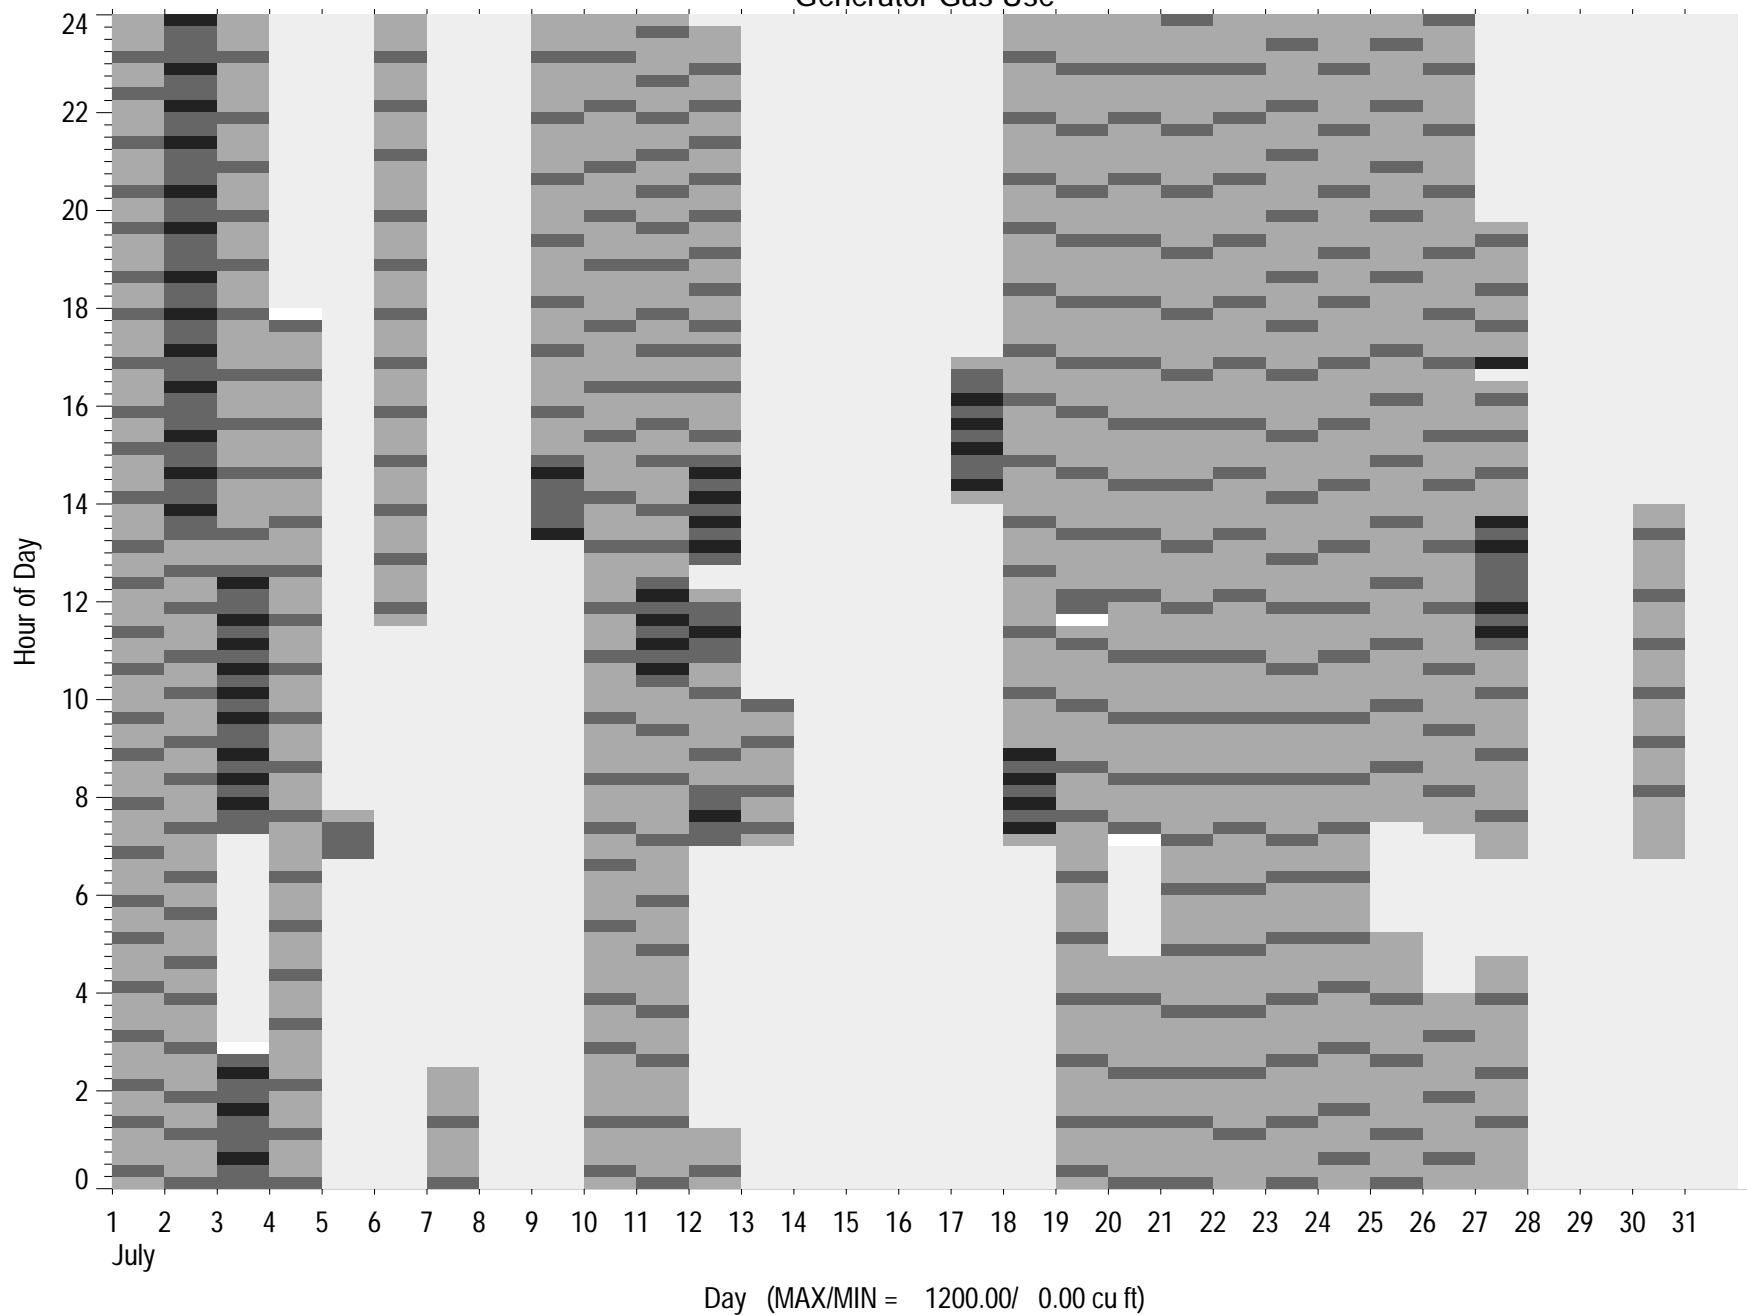

Total Useful Heat Recovery

