


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 1, Brooklyn, NY

08/01/07 to 08/31/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
08/01/07	100.00	0.75	n/a	300.00	0.00	n/a	n/a
08/02/07	100.00	0.25	n/a	200.00	0.00	n/a	n/a
08/03/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/04/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/05/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/06/07	99.48	0.25	n/a	0.00	0.00	n/a	n/a
08/07/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/08/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/09/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/10/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/11/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/12/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/13/07	100.00	9.25	n/a	4500.00	0.00	n/a	n/a
08/14/07	100.00	20.25	n/a	10100.00	0.00	n/a	n/a
08/15/07	100.00	12.50	n/a	6200.00	0.00	n/a	n/a
08/16/07	100.00	17.25	n/a	8500.00	0.00	n/a	n/a
08/17/07	100.00	18.50	n/a	9200.00	0.00	n/a	n/a
08/18/07	100.00	24.00	n/a	12000.00	0.00	n/a	n/a
08/19/07	99.48	3.75	n/a	1900.00	0.00	n/a	n/a
08/20/07	100.00	17.25	n/a	8600.00	0.00	n/a	n/a
08/21/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
08/22/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
08/23/07	100.00	24.00	n/a	12000.00	0.00	n/a	n/a
08/24/07	100.00	24.00	n/a	12000.00	0.00	n/a	n/a
08/25/07	100.00	2.00	n/a	1100.00	0.00	n/a	n/a
08/26/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
08/27/07	100.00	17.25	n/a	8600.00	0.00	n/a	n/a
08/28/07	100.00	24.00	n/a	11900.00	0.00	n/a	n/a
08/29/07	99.48	21.75	n/a	10900.00	0.00	n/a	n/a
08/30/07	95.83	18.00	n/a	9100.00	0.00	n/a	n/a
08/31/07	3.65	0.75	n/a	300.00	0.00	n/a	n/a
Total	96.71	303.75	n/a	151600.00	0.00	n/a	n/a

Generator Gas Use

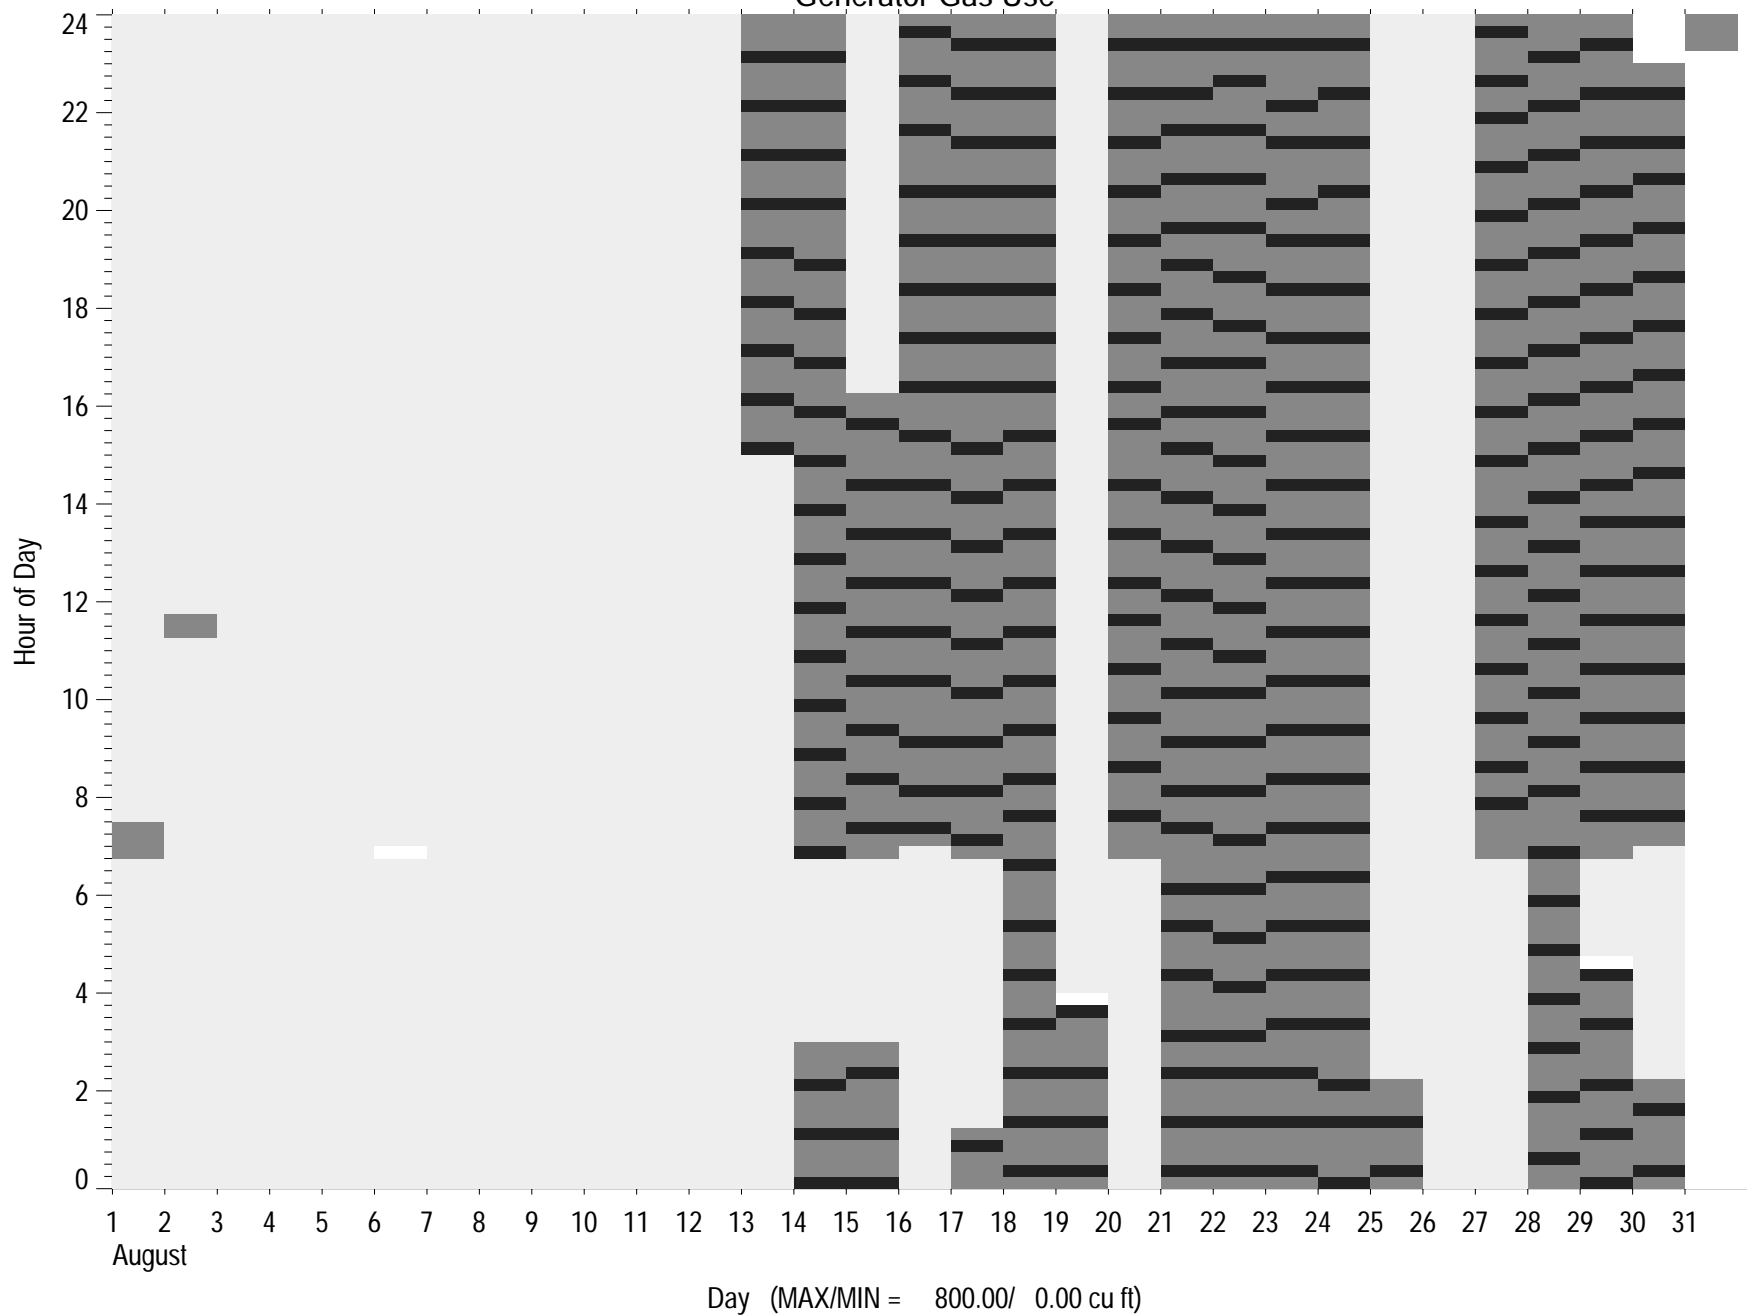

Total Useful Heat Recovery

