


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 1, Brooklyn, NY

09/01/07 to 09/30/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
09/01/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
09/02/07	100.00	3.50	n/a	1800.00	0.00	n/a	n/a
09/03/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
09/04/07	99.48	8.50	n/a	4100.00	0.00	n/a	n/a
09/05/07	100.00	7.00	n/a	3400.00	0.00	n/a	n/a
09/06/07	99.48	5.50	n/a	2700.00	0.00	n/a	n/a
09/07/07	100.00	5.00	n/a	2500.00	0.00	n/a	n/a
09/08/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
09/09/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
09/10/07	100.00	13.75	n/a	6800.00	0.00	n/a	n/a
09/11/07	100.00	17.50	n/a	8800.00	0.00	n/a	n/a
09/12/07	100.00	19.75	n/a	9900.00	0.00	n/a	n/a
09/13/07	100.00	19.75	n/a	9700.00	0.00	n/a	n/a
09/14/07	100.00	19.25	n/a	9700.00	0.00	n/a	n/a
09/15/07	100.00	2.50	n/a	1200.00	0.00	n/a	n/a
09/16/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
09/17/07	100.00	17.00	n/a	8500.00	0.00	n/a	n/a
09/18/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
09/19/07	100.00	24.00	n/a	12000.00	0.00	n/a	n/a
09/20/07	99.48	21.75	n/a	10800.00	0.00	n/a	n/a
09/21/07	99.48	14.25	n/a	6900.00	0.00	n/a	n/a
09/22/07	100.00	1.50	n/a	800.00	0.00	n/a	n/a
09/23/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
09/24/07	100.00	7.25	n/a	3500.00	0.00	n/a	n/a
09/25/07	99.48	7.00	n/a	3400.00	0.00	n/a	n/a
09/26/07	99.48	4.25	n/a	2100.00	0.00	n/a	n/a
09/27/07	100.00	4.50	n/a	2200.00	0.00	n/a	n/a
09/28/07	100.00	5.75	n/a	2800.00	0.00	n/a	n/a
09/29/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
09/30/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
Total	99.90	277.25	n/a	137800.00	0.00	n/a	n/a

Generator Gas Use

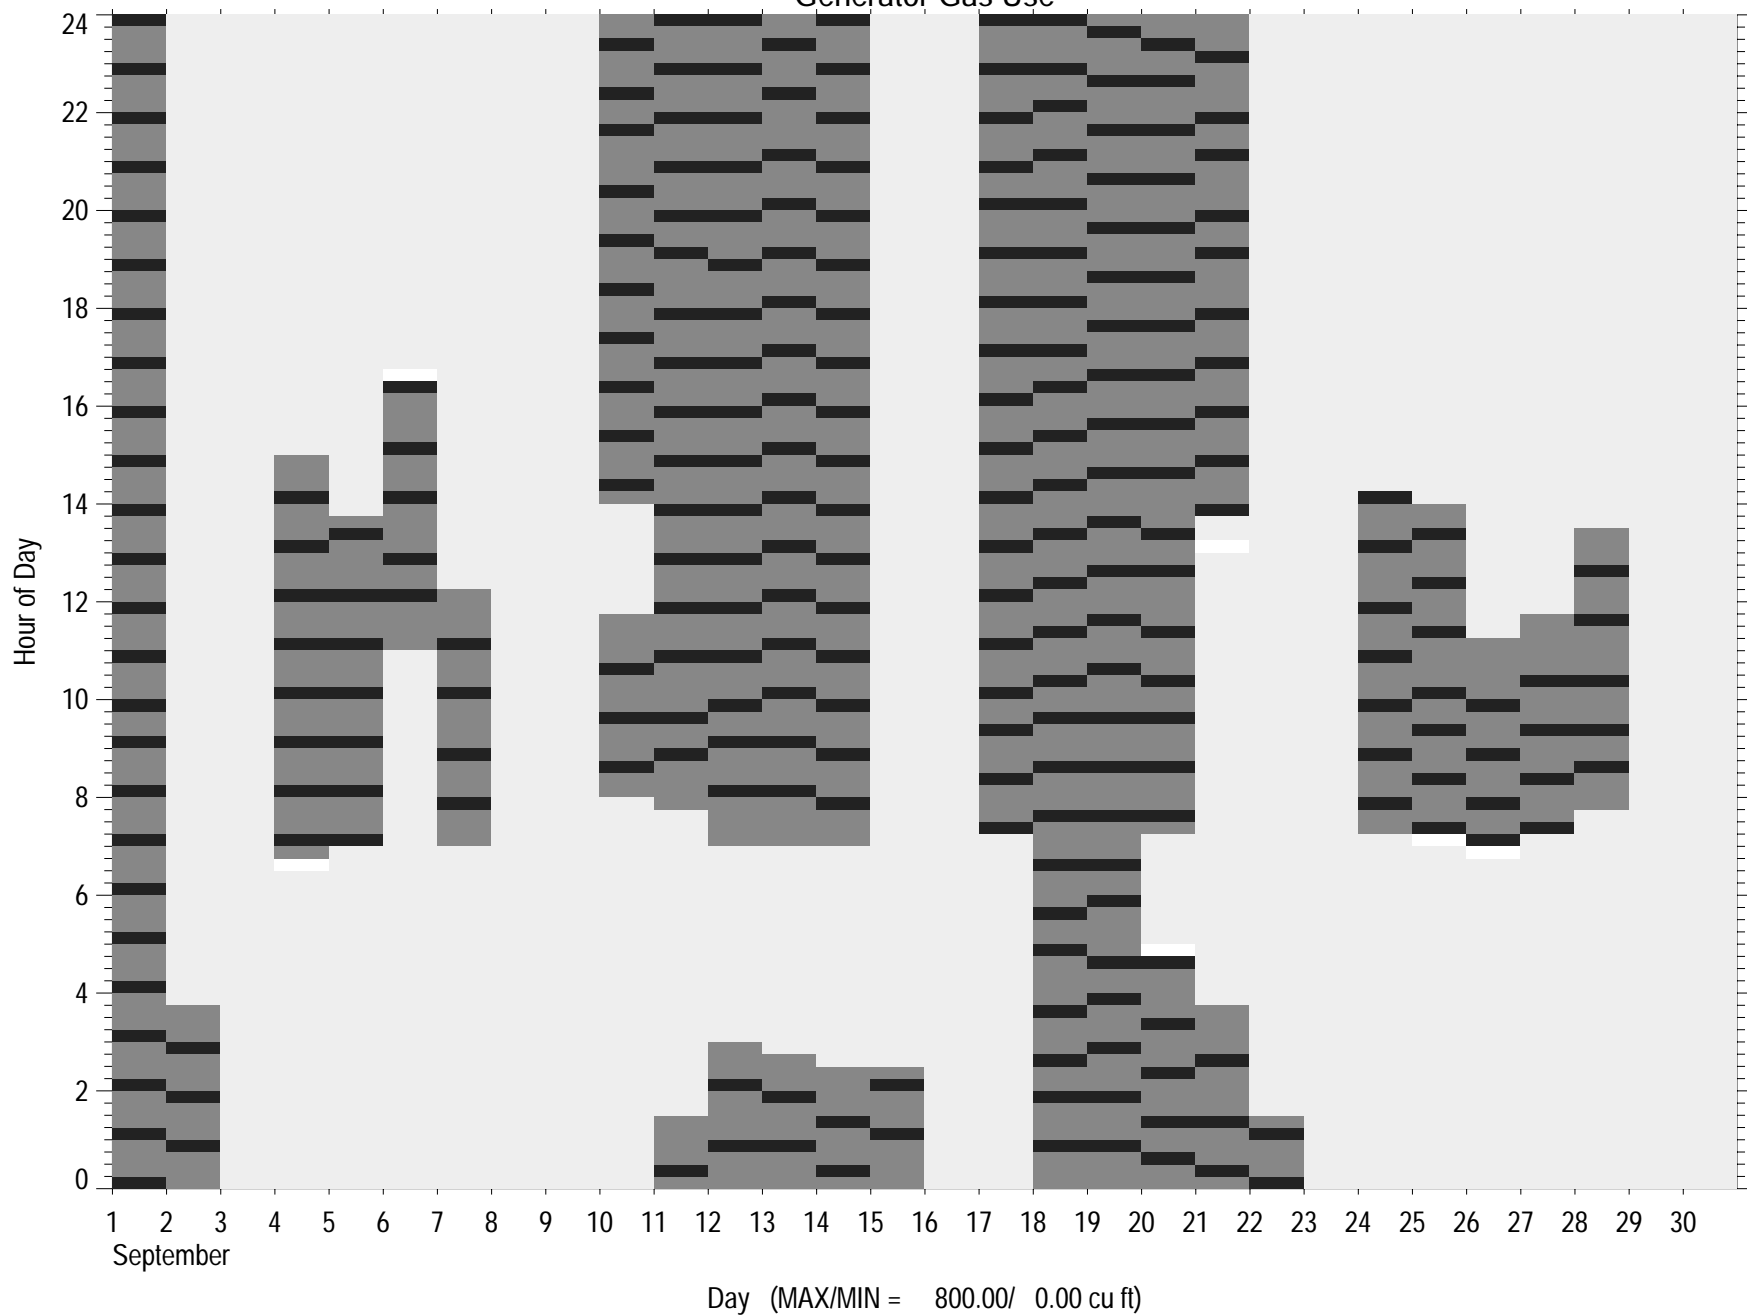

Total Useful Heat Recovery

