


**GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY**

Sea Rise 1, Brooklyn, NY

10/01/07 to 10/31/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
10/01/07	100.00	9.50	n/a	4800.00	0.00	n/a	n/a
10/02/07	99.48	17.00	n/a	8400.00	0.00	n/a	n/a
10/03/07	100.00	7.75	n/a	3800.00	0.00	n/a	n/a
10/04/07	99.48	5.00	n/a	2500.00	0.00	n/a	n/a
10/05/07	98.96	7.75	n/a	3700.00	0.00	n/a	n/a
10/06/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
10/07/07	100.00	0.00	n/a	0.00	0.00	n/a	n/a
10/08/07	99.48	4.50	n/a	2300.00	0.00	n/a	n/a
10/09/07	100.00	3.75	n/a	1800.00	0.00	n/a	n/a
10/10/07	100.00	13.75	n/a	6800.00	0.00	n/a	n/a
10/11/07	100.00	6.50	n/a	3400.00	0.00	n/a	n/a
10/12/07	98.96	14.25	n/a	7100.00	0.00	n/a	n/a
10/13/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/14/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/15/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/16/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
10/17/07	100.00	24.00	n/a	12000.00	0.00	n/a	n/a
10/18/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
10/19/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
10/20/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/21/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/22/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
10/23/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
10/24/07	100.00	24.00	n/a	12100.00	0.00	n/a	n/a
10/25/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/26/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/27/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/28/07	100.00	24.00	n/a	12300.00	0.00	n/a	n/a
10/29/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/30/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
10/31/07	100.00	24.00	n/a	12200.00	0.00	n/a	n/a
Total	99.88	545.75	n/a	275700.00	0.00	n/a	n/a

# Generator Gas Use

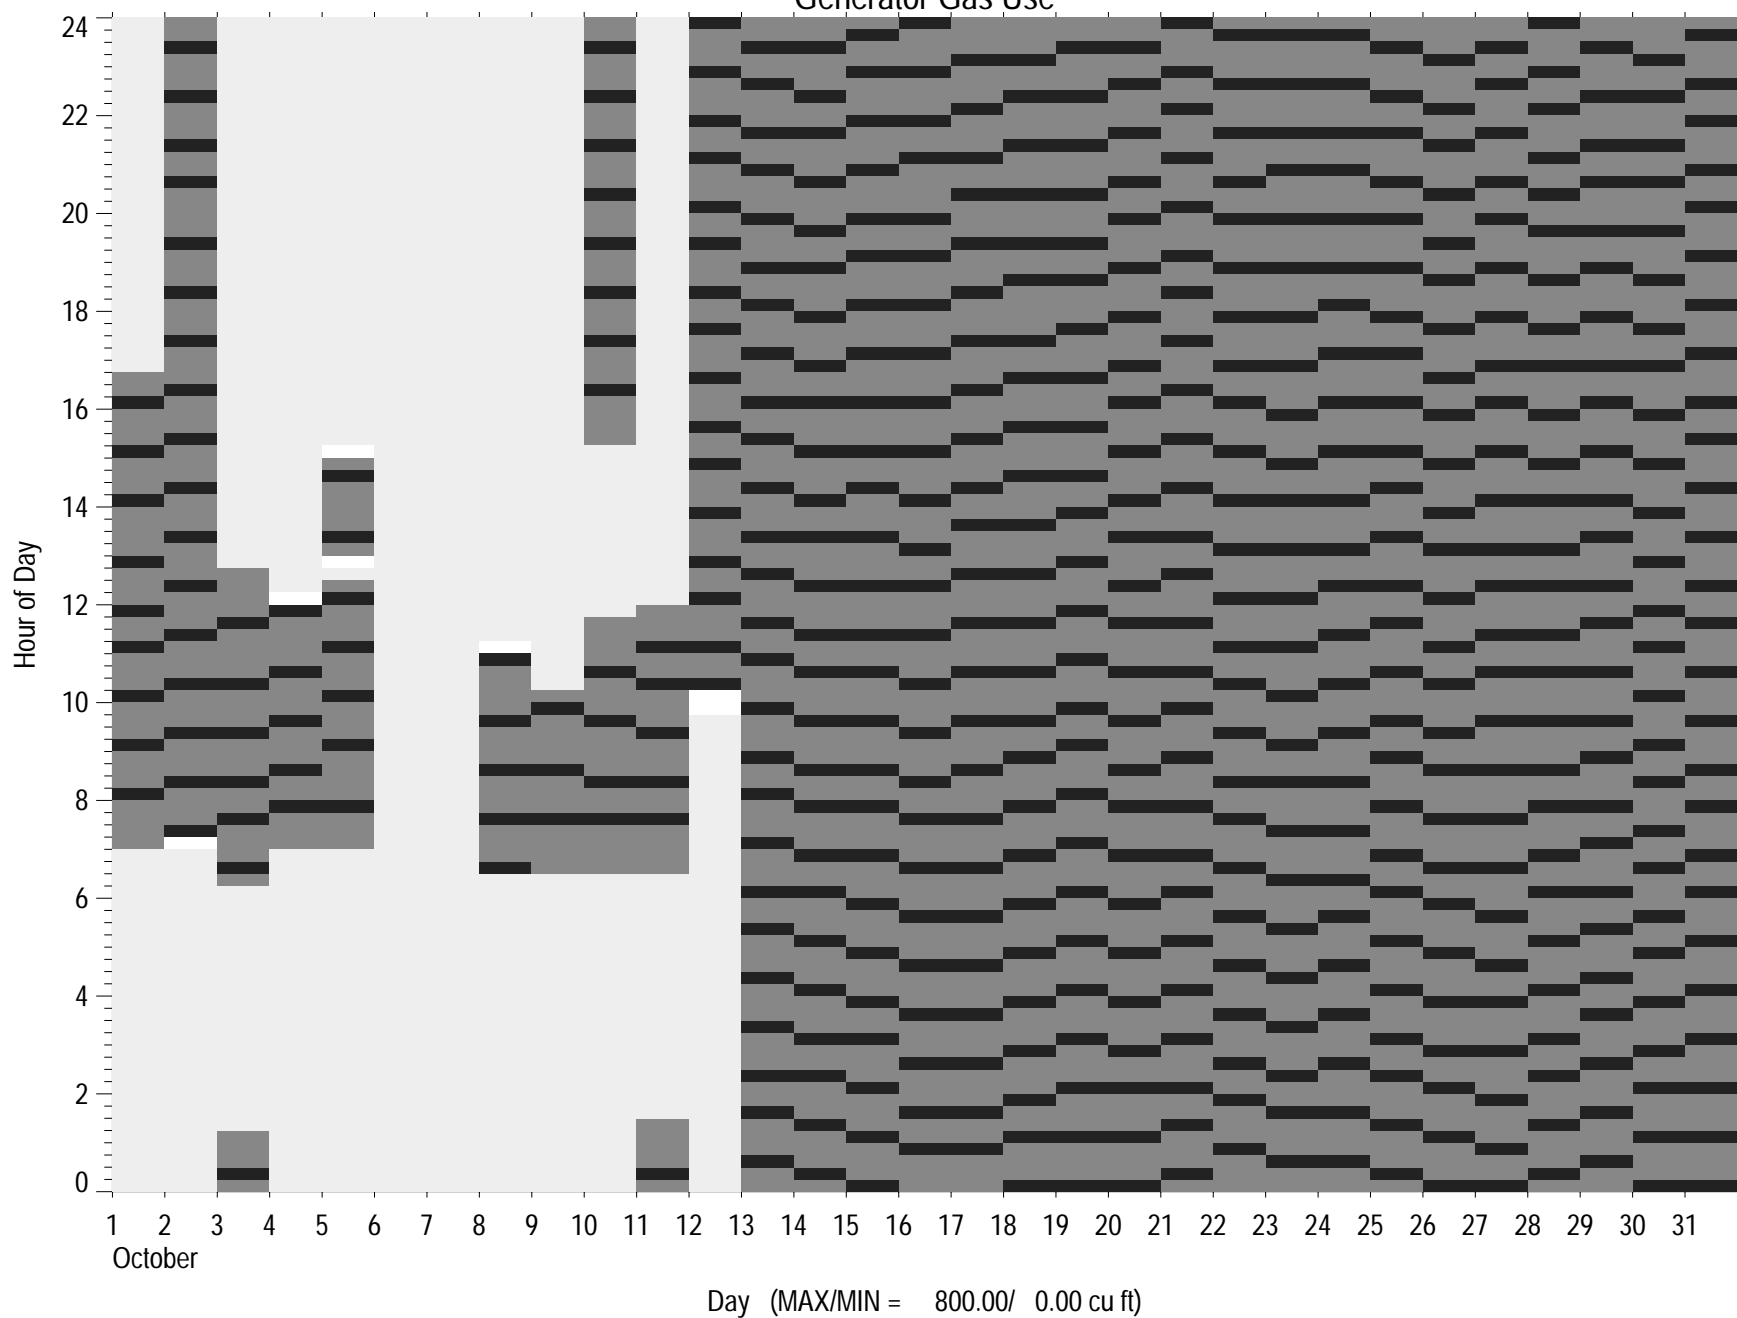

# Total Useful Heat Recovery

