


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 1, Brooklyn, NY

12/01/07 to 12/31/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
12/01/07	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
12/02/07	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
12/03/07	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
12/04/07	98.44	22.75	n/a	11800.00	0.00	n/a	n/a
12/05/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/06/07	100.00	24.00	n/a	12600.00	0.00	n/a	n/a
12/07/07	100.00	22.25	n/a	11600.00	0.00	n/a	n/a
12/08/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/09/07	100.00	24.00	n/a	12600.00	0.00	n/a	n/a
12/10/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/11/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/12/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/13/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/14/07	100.00	24.00	n/a	12600.00	0.00	n/a	n/a
12/15/07	100.00	24.00	n/a	12600.00	0.00	n/a	n/a
12/16/07	100.00	24.00	n/a	12600.00	0.00	n/a	n/a
12/17/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/18/07	100.00	24.00	n/a	12600.00	0.00	n/a	n/a
12/19/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/20/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/21/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/22/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/23/07	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
12/24/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/25/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/26/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/27/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/28/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
12/29/07	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
12/30/07	100.00	24.00	n/a	12600.00	0.00	n/a	n/a
12/31/07	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
Total	99.95	741.00	n/a	386100.00	0.00	n/a	n/a

Generator Gas Use

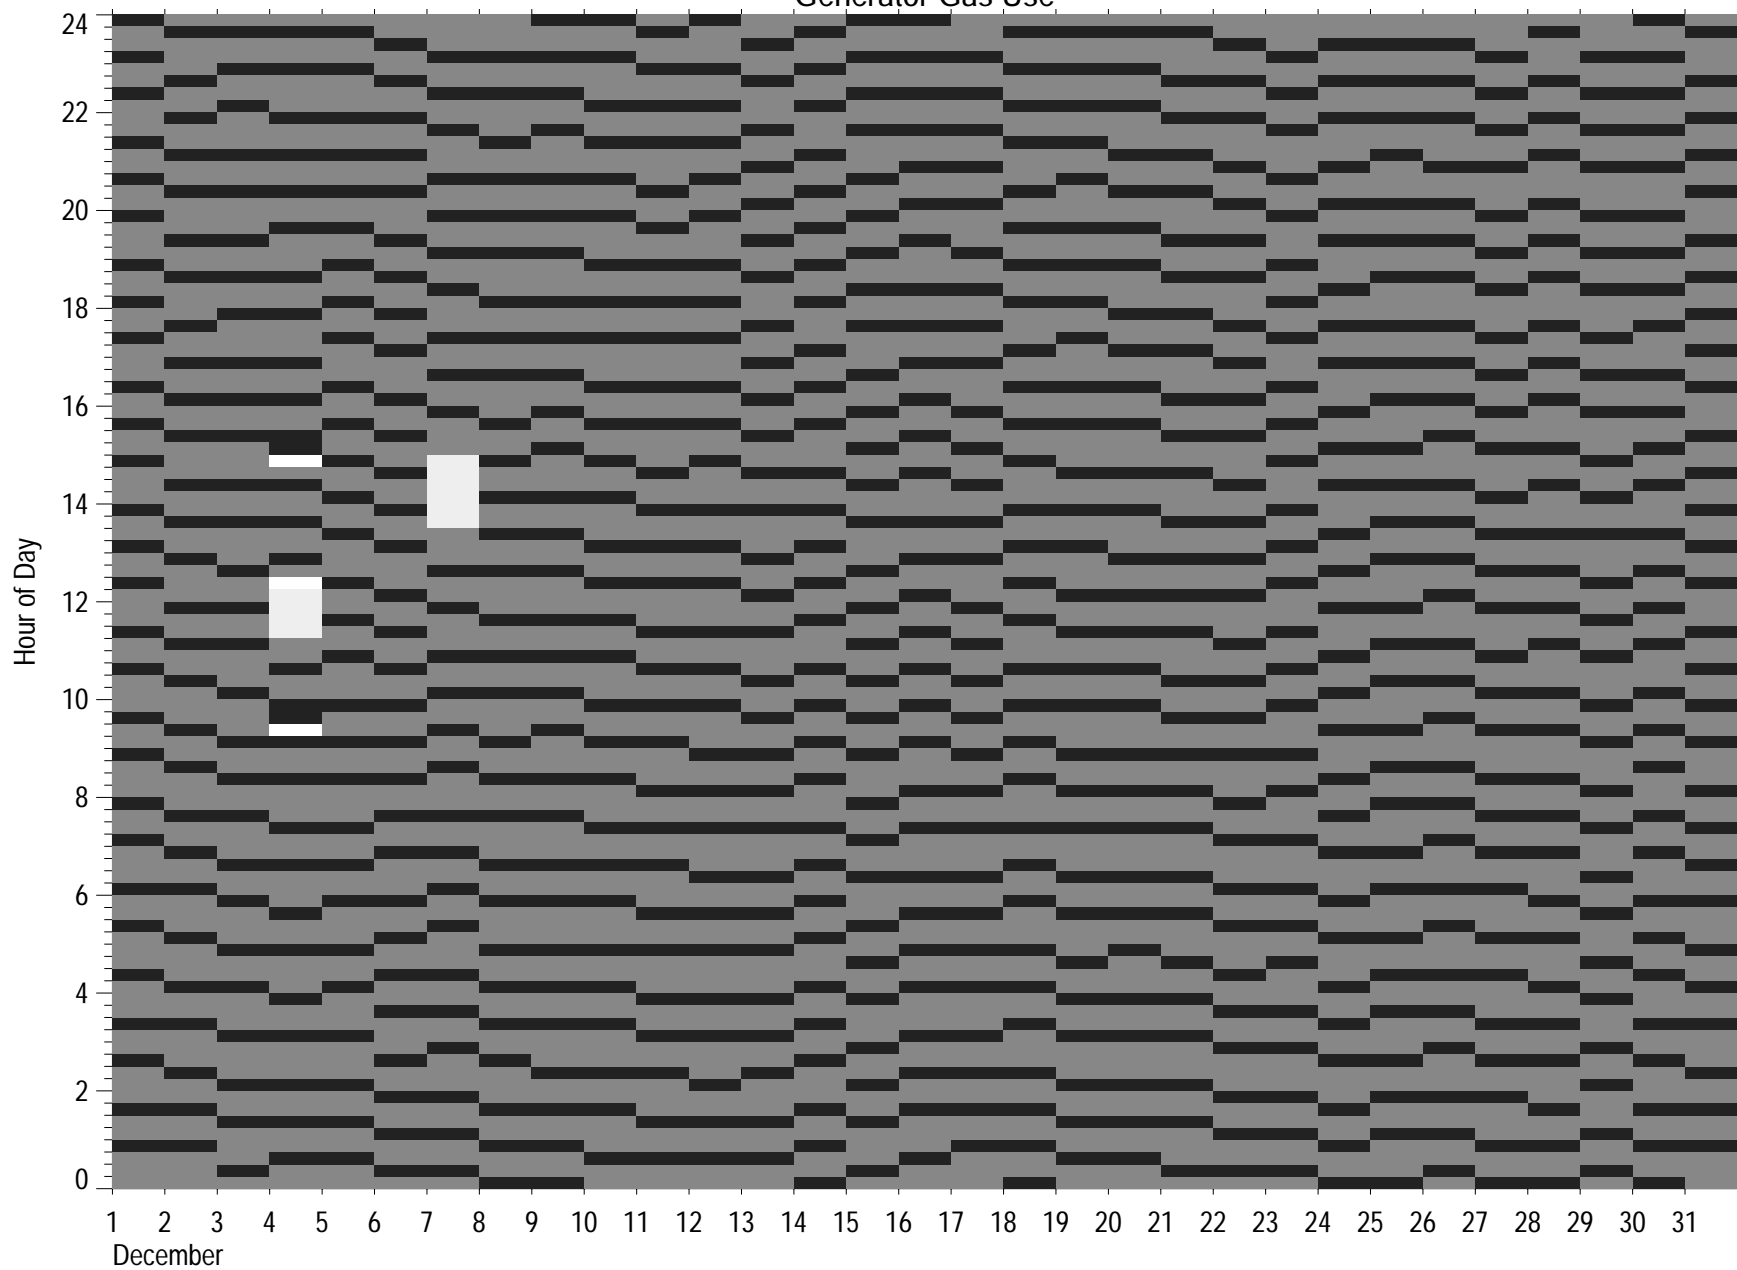

Day (MAX/MIN = 800.00/ 0.00 cu ft)

Total Useful Heat Recovery

