


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 1, Brooklyn, NY

01/01/07 to 12/31/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
Jan 2007	99.82	484.50	n/a	577200.00	0.00	n/a	n/a
Feb 2007	99.96	669.00	n/a	581500.00	0.00	n/a	n/a
Mar 2007	99.95	729.50	n/a	528000.00	0.00	n/a	n/a
Apr 2007	99.98	715.75	n/a	602000.00	0.00	n/a	n/a
May 2007	99.97	721.25	n/a	640100.00	0.00	n/a	n/a
Jun 2007	99.98	720.00	n/a	575000.00	0.00	n/a	n/a
Jul 2007	99.93	408.75	n/a	216500.00	0.00	n/a	n/a
Aug 2007	96.71	303.75	n/a	151600.00	0.00	n/a	n/a
Sep 2007	99.90	277.25	n/a	137800.00	0.00	n/a	n/a
Oct 2007	99.88	545.75	n/a	275700.00	0.00	n/a	n/a
Nov 2007	100.00	720.00	n/a	369000.00	0.00	n/a	n/a
Dec 2007	99.95	741.00	n/a	386100.00	0.00	n/a	n/a
Total	99.66	7036.50	n/a	5040500.00	0.00	n/a	n/a

Generator Gas Use

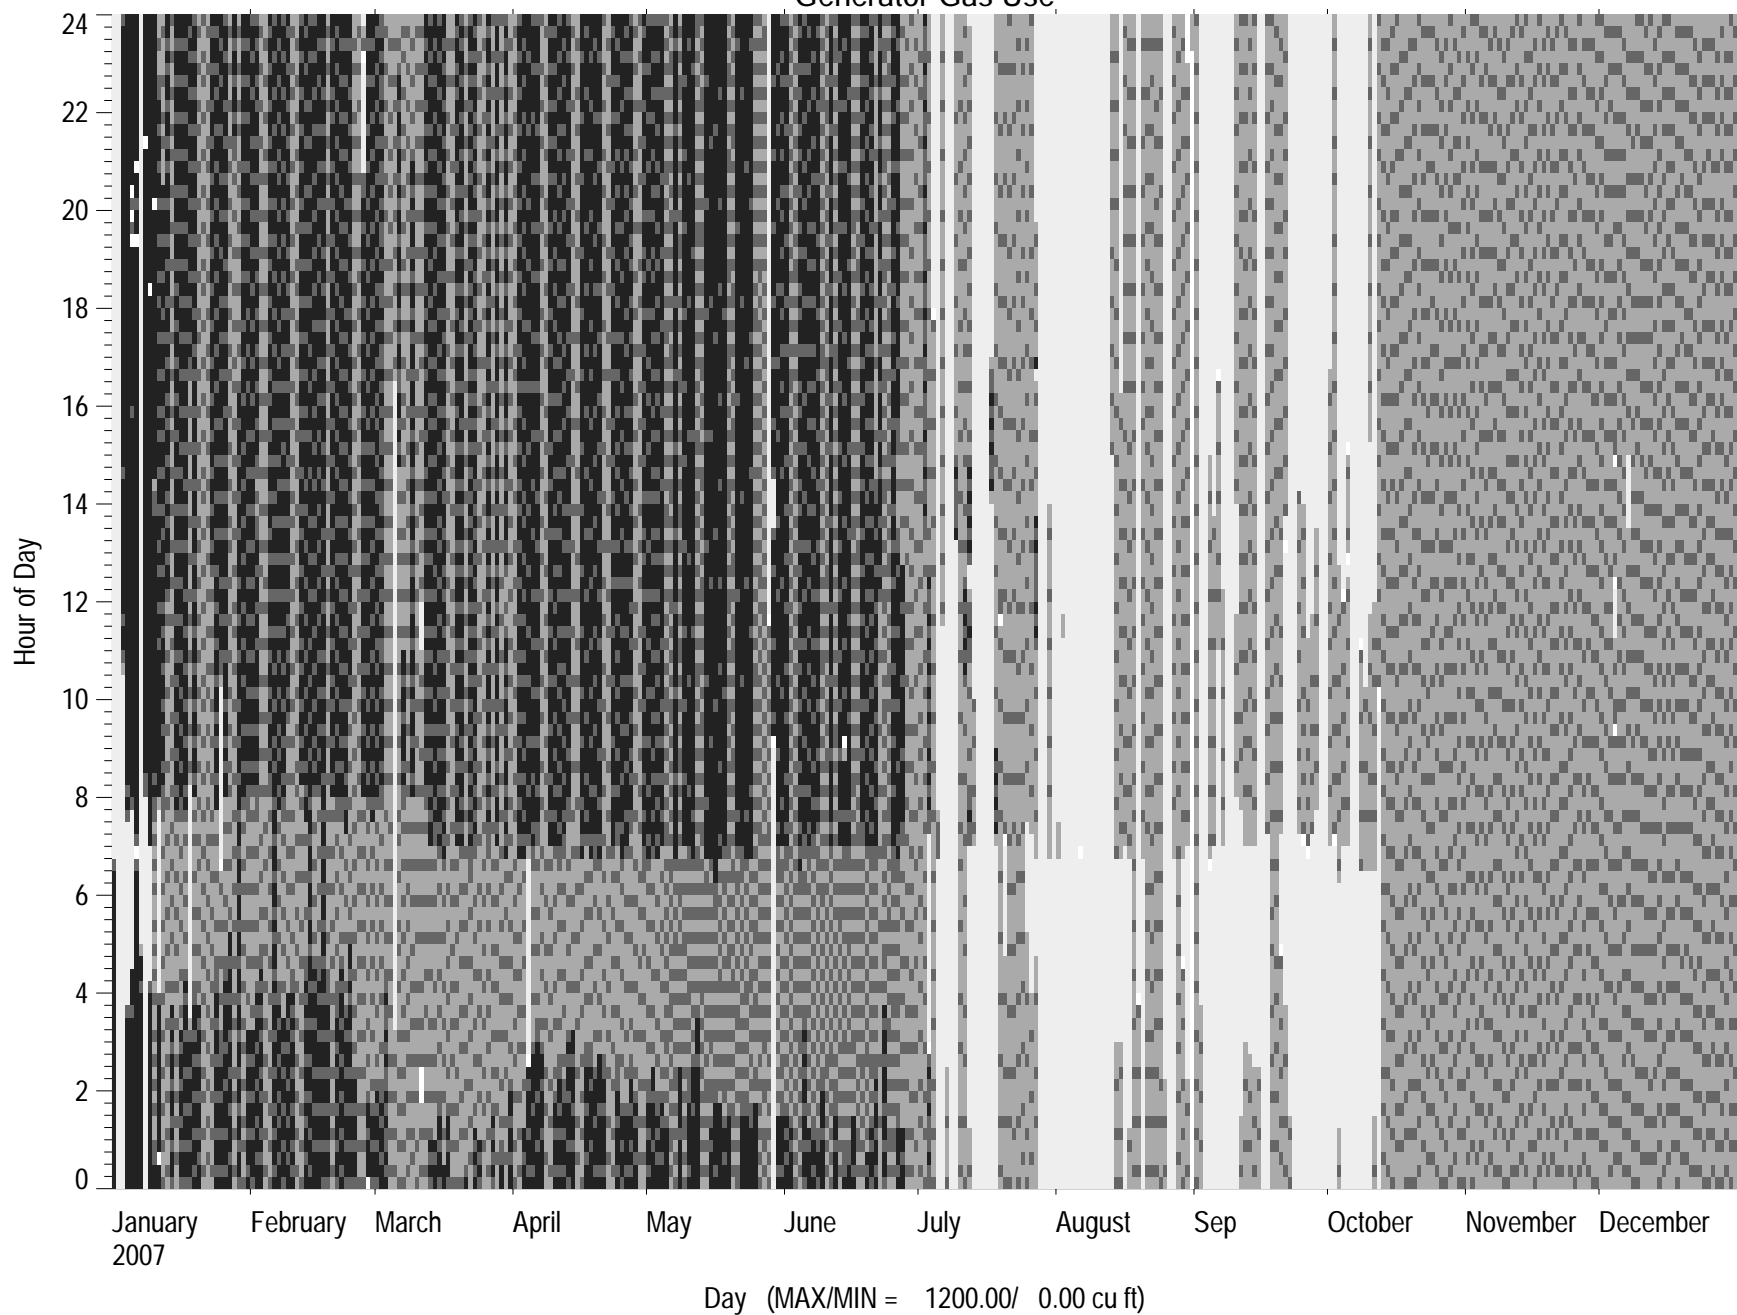

Total Useful Heat Recovery

