


# GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 1, Brooklyn, NY

03/01/08 to 03/31/08

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
03/01/08	99.48	23.75	n/a	12400.00	0.00	n/a	n/a
03/02/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/03/08	100.00	13.50	n/a	6900.00	0.00	n/a	n/a
03/04/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
03/05/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
03/06/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
03/07/08	99.48	23.75	n/a	12300.00	0.00	n/a	n/a
03/08/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/09/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/10/08	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
03/11/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/12/08	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
03/13/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/14/08	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
03/15/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/16/08	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
03/17/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/18/08	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
03/19/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/20/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/21/08	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
03/22/08	100.00	24.00	n/a	12500.00	0.00	n/a	n/a
03/23/08	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
03/24/08	100.00	24.00	n/a	12400.00	0.00	n/a	n/a
03/25/08	100.00	13.50	n/a	7100.00	0.00	n/a	n/a
03/26/08	100.00	0.00	n/a	0.00	0.00	n/a	n/a
03/27/08	99.48	0.00	n/a	0.00	0.00	n/a	n/a
03/28/08	100.00	13.00	n/a	6700.00	110.00	n/a	n/a
03/29/08	100.00	24.00	n/a	12400.00	10.00	n/a	n/a
03/30/08	100.00	24.00	n/a	12400.00	2.00	n/a	n/a
03/31/08	99.48	24.00	n/a	12300.00	0.00	n/a	n/a
Total	99.93	591.50	n/a	306700.00	122.00	n/a	n/a

# Generator Gas Use

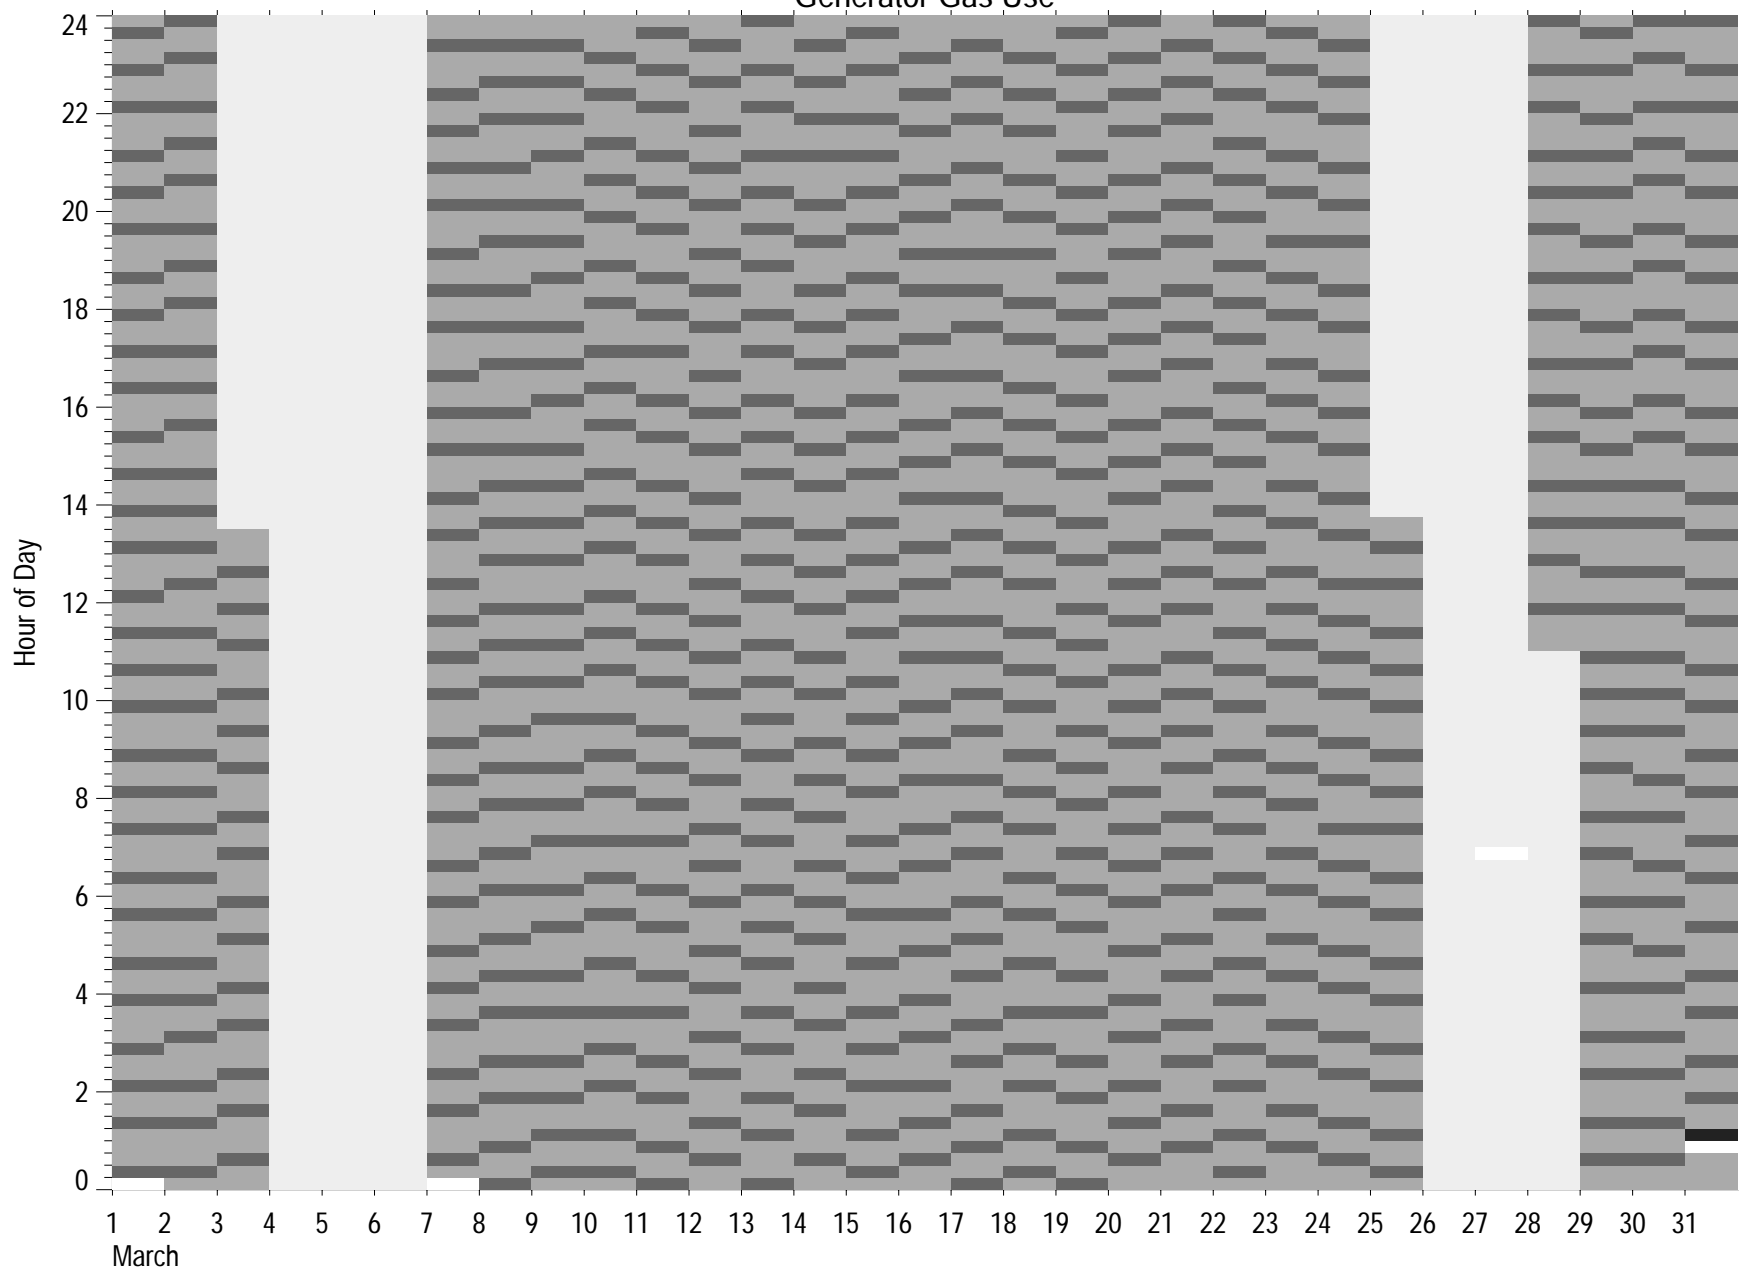

Day (MAX/MIN = 1200.00/ 0.00 cu ft)

# Total Useful Heat Recovery

