


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 1, Brooklyn, NY

01/01/08 to 12/31/08

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
Jan 2008	49.97	0.00	n/a	384700.00	-	n/a	n/a
Feb 2008	91.34	623.75	n/a	336600.00	1.00	n/a	n/a
Mar 2008	99.93	591.50	n/a	306700.00	122.00	n/a	n/a
Apr 2008	99.98	495.75	n/a	253000.00	18.00	n/a	n/a
May 2008	99.97	8.75	n/a	4300.00	66.00	n/a	n/a
Jun 2008	100.00	0.00	n/a	0.00	0.00	n/a	n/a
Jul 2008	100.00	0.00	n/a	0.00	0.00	n/a	n/a
Aug 2008	100.00	0.00	n/a	0.00	0.00	n/a	n/a
Sep 2008	100.00	0.00	n/a	0.00	0.00	n/a	n/a
Oct 2008	100.00	0.00	n/a	0.00	0.00	n/a	n/a
Nov 2008	100.00	0.00	n/a	0.00	0.00	n/a	n/a
Dec 2008	100.00	0.00	n/a	0.00	0.00	n/a	n/a
Total	95.07	1719.75	n/a	1285300.00	207.00	n/a	n/a

Generator Gas Use

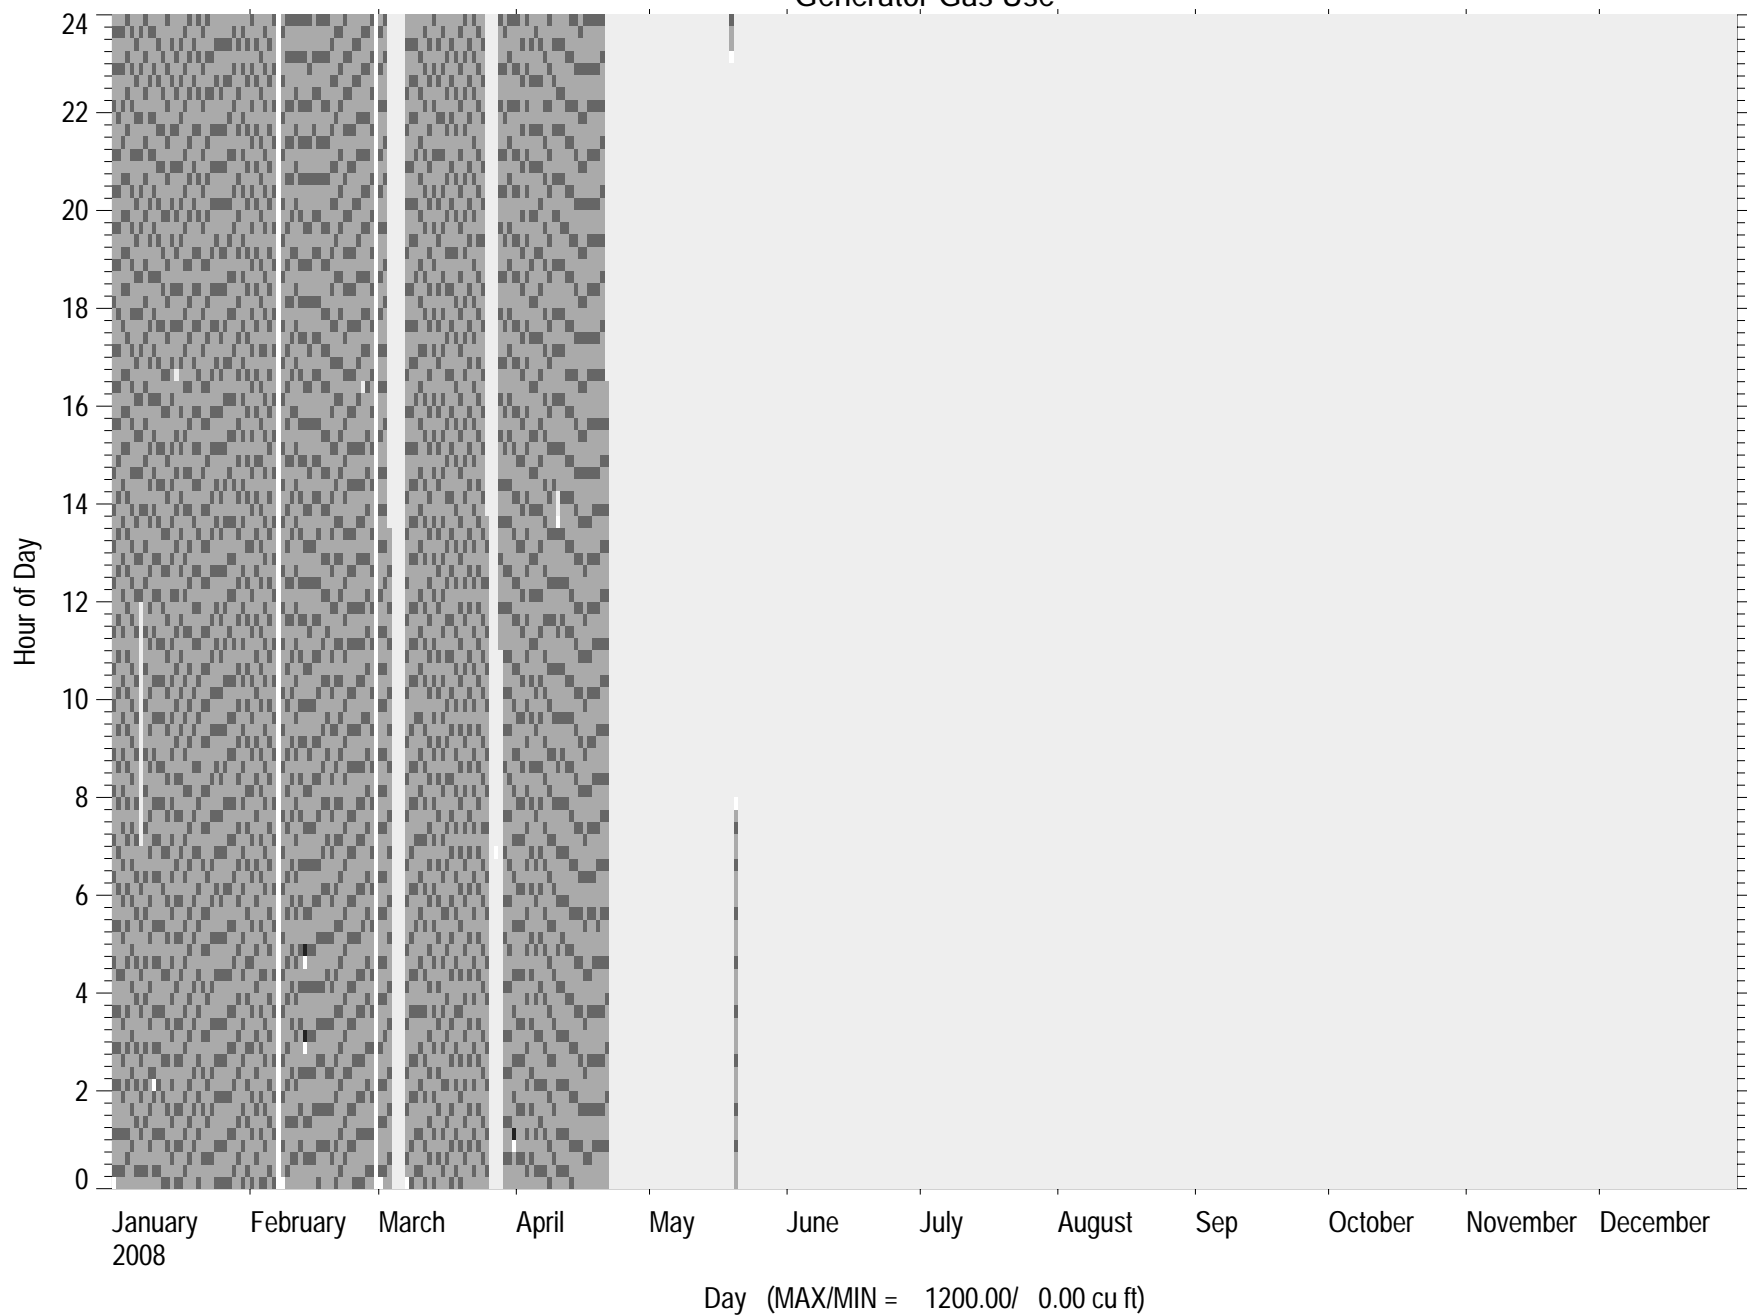

Total Useful Heat Recovery

