


# GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 2, Brooklyn, NY

10/01/06 to 10/31/06

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
10/01/06	100.00	24.00	n/a	22000.00	2712.31	n/a	n/a
10/02/06	100.00	24.00	n/a	22500.00	8175.00	n/a	n/a
10/03/06	100.00	24.00	n/a	22500.00	6233.66	n/a	n/a
10/04/06	100.00	24.00	n/a	22400.00	5180.34	n/a	n/a
10/05/06	100.00	24.00	n/a	22400.00	5854.00	n/a	n/a
10/06/06	100.00	24.00	n/a	22300.00	9668.13	n/a	n/a
10/07/06	100.00	24.00	n/a	22000.00	5380.88	n/a	n/a
10/08/06	100.00	24.00	n/a	22000.00	2249.34	n/a	n/a
10/09/06	100.00	24.00	n/a	22600.00	3820.69	n/a	n/a
10/10/06	100.00	24.00	n/a	22300.00	7634.97	n/a	n/a
10/11/06	100.00	24.00	n/a	22700.00	3345.66	n/a	n/a
10/12/06	100.00	24.00	n/a	22900.00	3827.25	n/a	n/a
10/13/06	100.00	24.00	n/a	22700.00	6764.41	n/a	n/a
10/14/06	100.00	24.00	n/a	22000.00	6321.50	n/a	n/a
10/15/06	100.00	24.00	n/a	22100.00	6270.34	n/a	n/a
10/16/06	100.00	24.00	n/a	22600.00	8649.84	n/a	n/a
10/17/06	100.00	24.00	n/a	22800.00	6014.78	n/a	n/a
10/18/06	100.00	24.00	n/a	22700.00	3092.06	n/a	n/a
10/19/06	100.00	24.00	n/a	22700.00	5670.16	n/a	n/a
10/20/06	100.00	24.00	n/a	22800.00	5662.94	n/a	n/a
10/21/06	100.00	24.00	n/a	22200.00	5767.06	n/a	n/a
10/22/06	100.00	24.00	n/a	22200.00	4074.66	n/a	n/a
10/23/06	100.00	24.00	n/a	22700.00	7061.94	n/a	n/a
10/24/06	100.00	24.00	n/a	22700.00	4231.31	n/a	n/a
10/25/06	100.00	24.00	n/a	22500.00	3198.75	n/a	n/a
10/26/06	100.00	24.00	n/a	22400.00	7295.09	n/a	n/a
10/27/06	100.00	24.00	n/a	22400.00	6053.19	n/a	n/a
10/28/06	100.00	24.00	n/a	22200.00	3022.06	n/a	n/a
10/29/06	100.00	24.00	n/a	22000.00	3979.06	n/a	n/a
10/30/06	99.48	23.75	n/a	22000.00	4476.03	n/a	n/a
10/31/06	100.00	24.00	n/a	22700.00	3786.50	n/a	n/a
<b>Total</b>	<b>99.98</b>	<b>743.75</b>	<b>n/a</b>	<b>695000.00</b>	<b>165473.91</b>	<b>n/a</b>	<b>n/a</b>

# Generator Gas Use

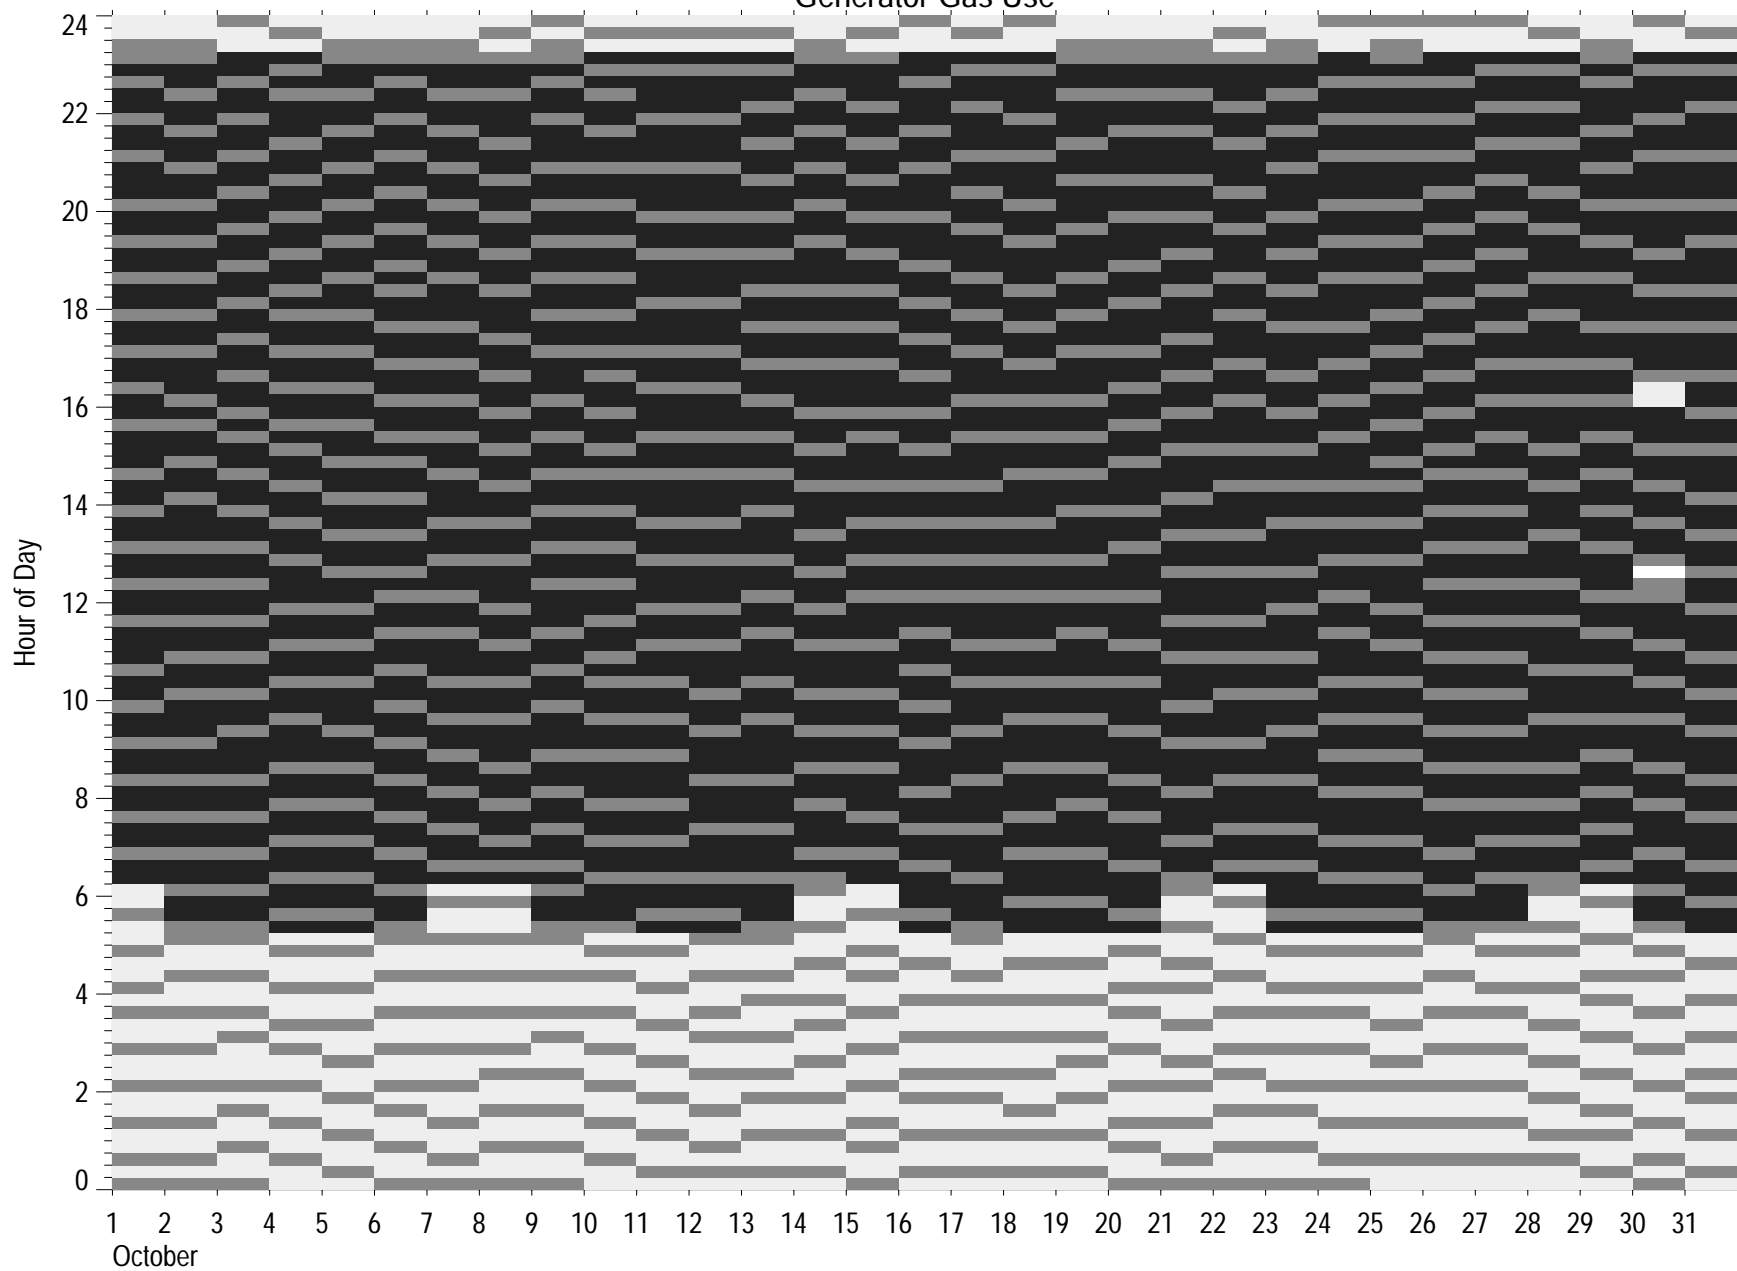

Day (MAX/MIN = 1200.00/ 400.00 cu ft)

# Total Useful Heat Recovery

