


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 2, Brooklyn, NY

02/01/07 to 02/28/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
02/01/07	100.00	24.00	n/a	23300.00	6693.88	n/a	n/a
02/02/07	100.00	22.75	n/a	22500.00	2366.13	n/a	n/a
02/03/07	100.00	24.00	n/a	23100.00	3305.00	n/a	n/a
02/04/07	100.00	24.00	n/a	23500.00	859.00	n/a	n/a
02/05/07	100.00	24.00	n/a	19300.00	2416.31	n/a	n/a
02/06/07	100.00	18.25	n/a	19200.00	721.69	n/a	n/a
02/07/07	100.00	24.00	n/a	23800.00	0.00	n/a	n/a
02/08/07	100.00	24.00	n/a	23900.00	739.00	n/a	n/a
02/09/07	100.00	24.00	n/a	23900.00	54.00	n/a	n/a
02/10/07	100.00	24.00	n/a	23300.00	0.00	n/a	n/a
02/11/07	100.00	24.00	n/a	24100.00	63.00	n/a	n/a
02/12/07	100.00	24.00	n/a	24500.00	0.00	n/a	n/a
02/13/07	100.00	24.00	n/a	24400.00	219.31	n/a	n/a
02/14/07	100.00	24.00	n/a	24300.00	27.69	n/a	n/a
02/15/07	100.00	24.00	n/a	24300.00	36.00	n/a	n/a
02/16/07	100.00	24.00	n/a	24500.00	1357.00	n/a	n/a
02/17/07	100.00	24.00	n/a	23800.00	42.00	n/a	n/a
02/18/07	100.00	24.00	n/a	23800.00	2.13	n/a	n/a
02/19/07	100.00	24.00	n/a	24500.00	292.88	n/a	n/a
02/20/07	99.48	21.25	n/a	22000.00	818.00	n/a	n/a
02/21/07	100.00	24.00	n/a	24400.00	362.00	n/a	n/a
02/22/07	100.00	24.00	n/a	24300.00	41.00	n/a	n/a
02/23/07	100.00	24.00	n/a	24200.00	0.00	n/a	n/a
02/24/07	100.00	24.00	n/a	23600.00	3.00	n/a	n/a
02/25/07	100.00	24.00	n/a	23700.00	23.00	n/a	n/a
02/26/07	100.00	23.75	n/a	23800.00	553.00	n/a	n/a
02/27/07	99.48	23.75	n/a	24000.00	88.00	n/a	n/a
02/28/07	100.00	24.00	n/a	24300.00	12.00	n/a	n/a
Total	99.96	661.75	n/a	658300.00	21095.00	n/a	n/a

Generator Gas Use

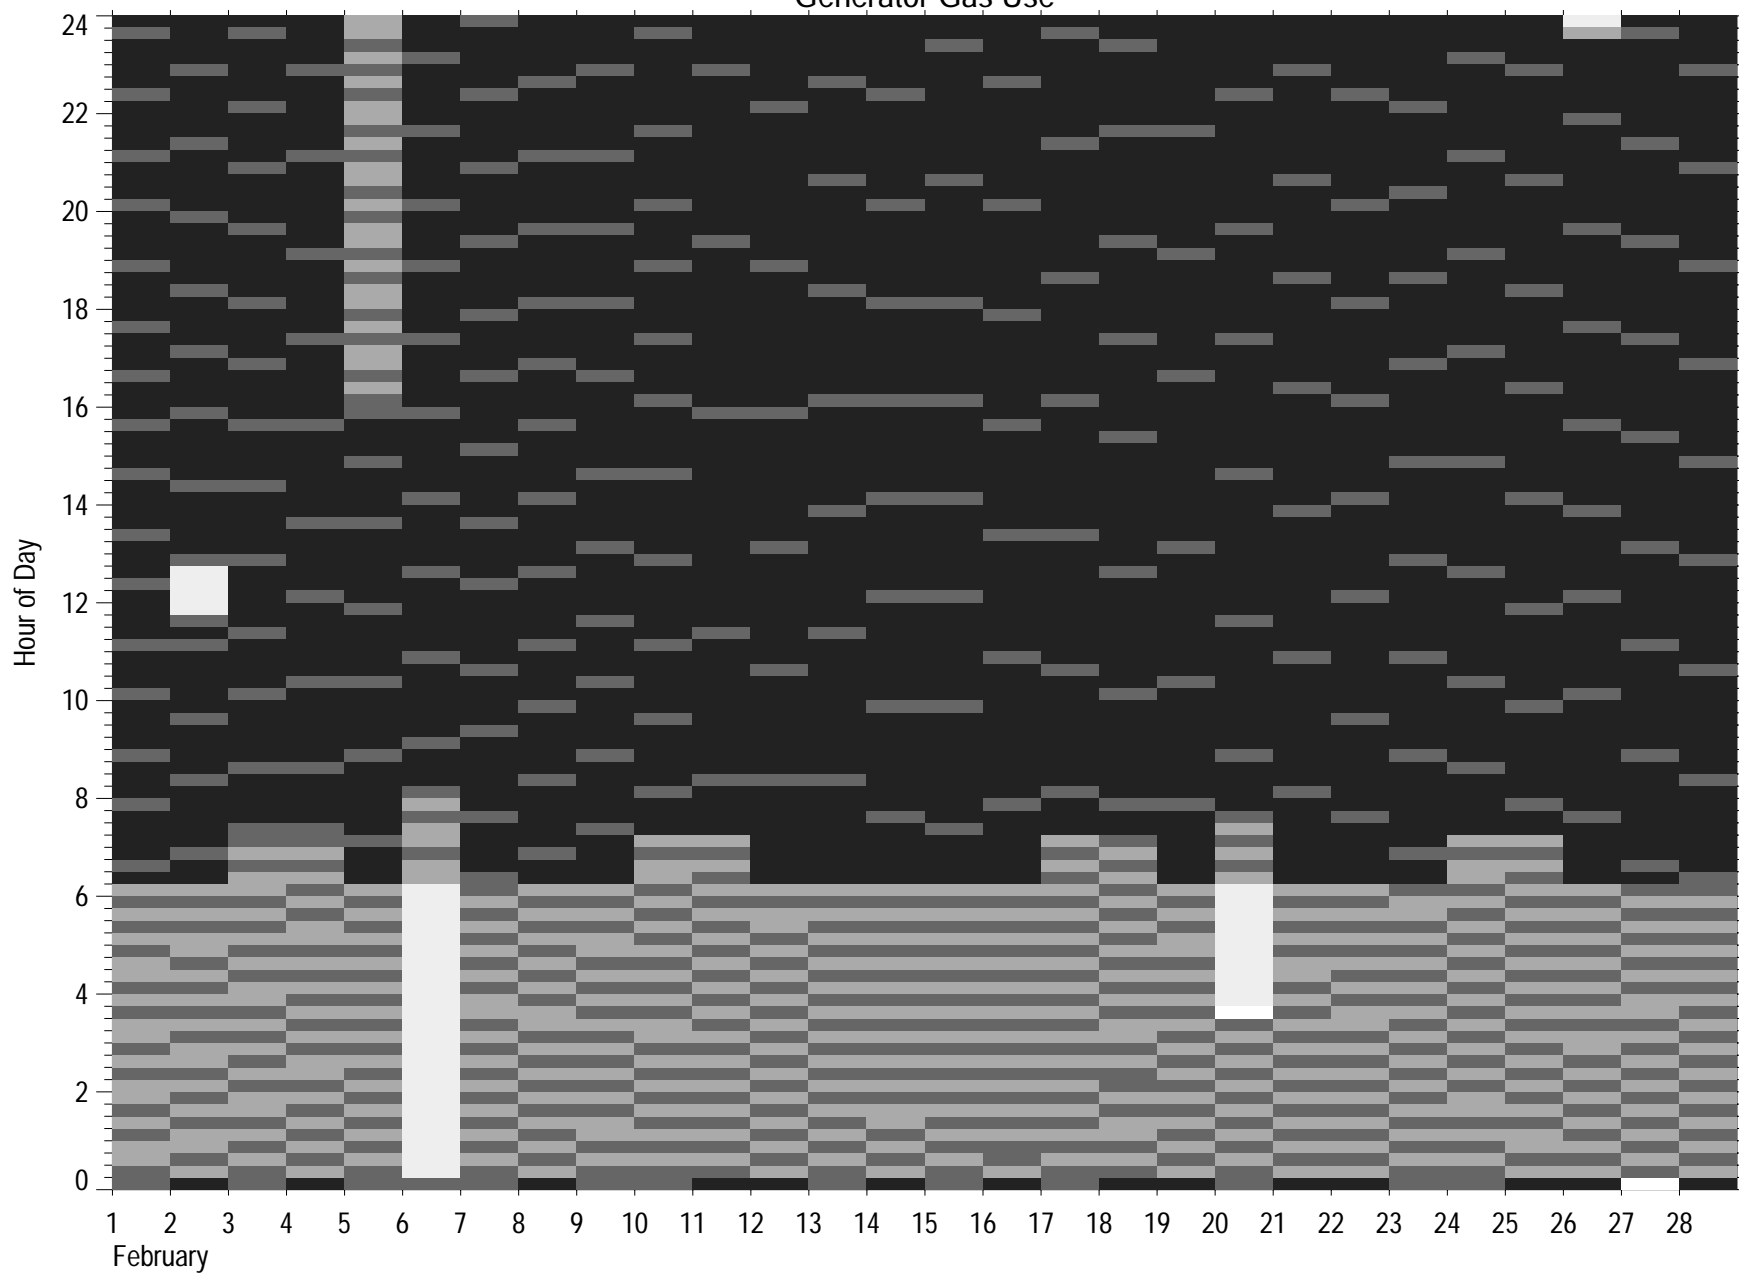

Day (MAX/MIN = 1200.00/ 0.00 cu ft)

Total Useful Heat Recovery

