


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 2, Brooklyn, NY

06/01/07 to 06/30/07

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
06/01/07	98.44	24.00	n/a	24400.00	2146.88	n/a	n/a
06/02/07	97.92	24.00	n/a	23500.00	3797.38	n/a	n/a
06/03/07	97.40	24.00	n/a	23200.00	7187.75	n/a	n/a
06/04/07	97.40	24.00	n/a	23900.00	6587.88	n/a	n/a
06/05/07	97.40	24.00	n/a	23900.00	3734.13	n/a	n/a
06/06/07	96.88	24.00	n/a	23600.00	1589.63	n/a	n/a
06/07/07	95.83	24.00	n/a	23000.00	2.00	n/a	n/a
06/08/07	95.83	24.00	n/a	23000.00	2.00	n/a	n/a
06/09/07	95.31	24.00	n/a	22200.00	114.00	n/a	n/a
06/10/07	94.27	24.00	n/a	21600.00	217.38	n/a	n/a
06/11/07	94.79	24.00	n/a	22600.00	2814.25	n/a	n/a
06/12/07	94.79	24.00	n/a	22500.00	866.38	n/a	n/a
06/13/07	94.79	24.00	n/a	22500.00	2048.00	n/a	n/a
06/14/07	93.23	24.00	n/a	21700.00	350.00	n/a	n/a
06/15/07	93.23	24.00	n/a	21700.00	512.00	n/a	n/a
06/16/07	92.71	24.00	n/a	20800.00	821.50	n/a	n/a
06/17/07	92.71	24.00	n/a	20800.00	1940.38	n/a	n/a
06/18/07	92.71	24.00	n/a	21400.00	3154.75	n/a	n/a
06/19/07	92.19	24.00	n/a	21100.00	5724.00	n/a	n/a
06/20/07	92.19	24.00	n/a	21100.00	10057.00	n/a	n/a
06/21/07	94.27	24.00	n/a	19400.00	8127.75	n/a	n/a
06/22/07	92.19	18.00	n/a	16500.00	814.63	n/a	n/a
06/23/07	91.15	24.00	n/a	20000.00	353.00	n/a	n/a
06/24/07	91.15	24.00	n/a	20100.00	602.00	n/a	n/a
06/25/07	91.15	24.00	n/a	20500.00	22.00	n/a	n/a
06/26/07	93.75	24.00	n/a	19300.00	598.00	n/a	n/a
06/27/07	100.00	23.50	n/a	15300.00	4774.38	n/a	n/a
06/28/07	100.00	18.00	n/a	11500.00	4695.13	n/a	n/a
06/29/07	100.00	18.00	n/a	11600.00	4701.88	n/a	n/a
06/30/07	100.00	17.00	n/a	11000.00	4502.63	n/a	n/a
Total	95.12	694.50	n/a	613700.00	82858.63	n/a	n/a

Generator Gas Use

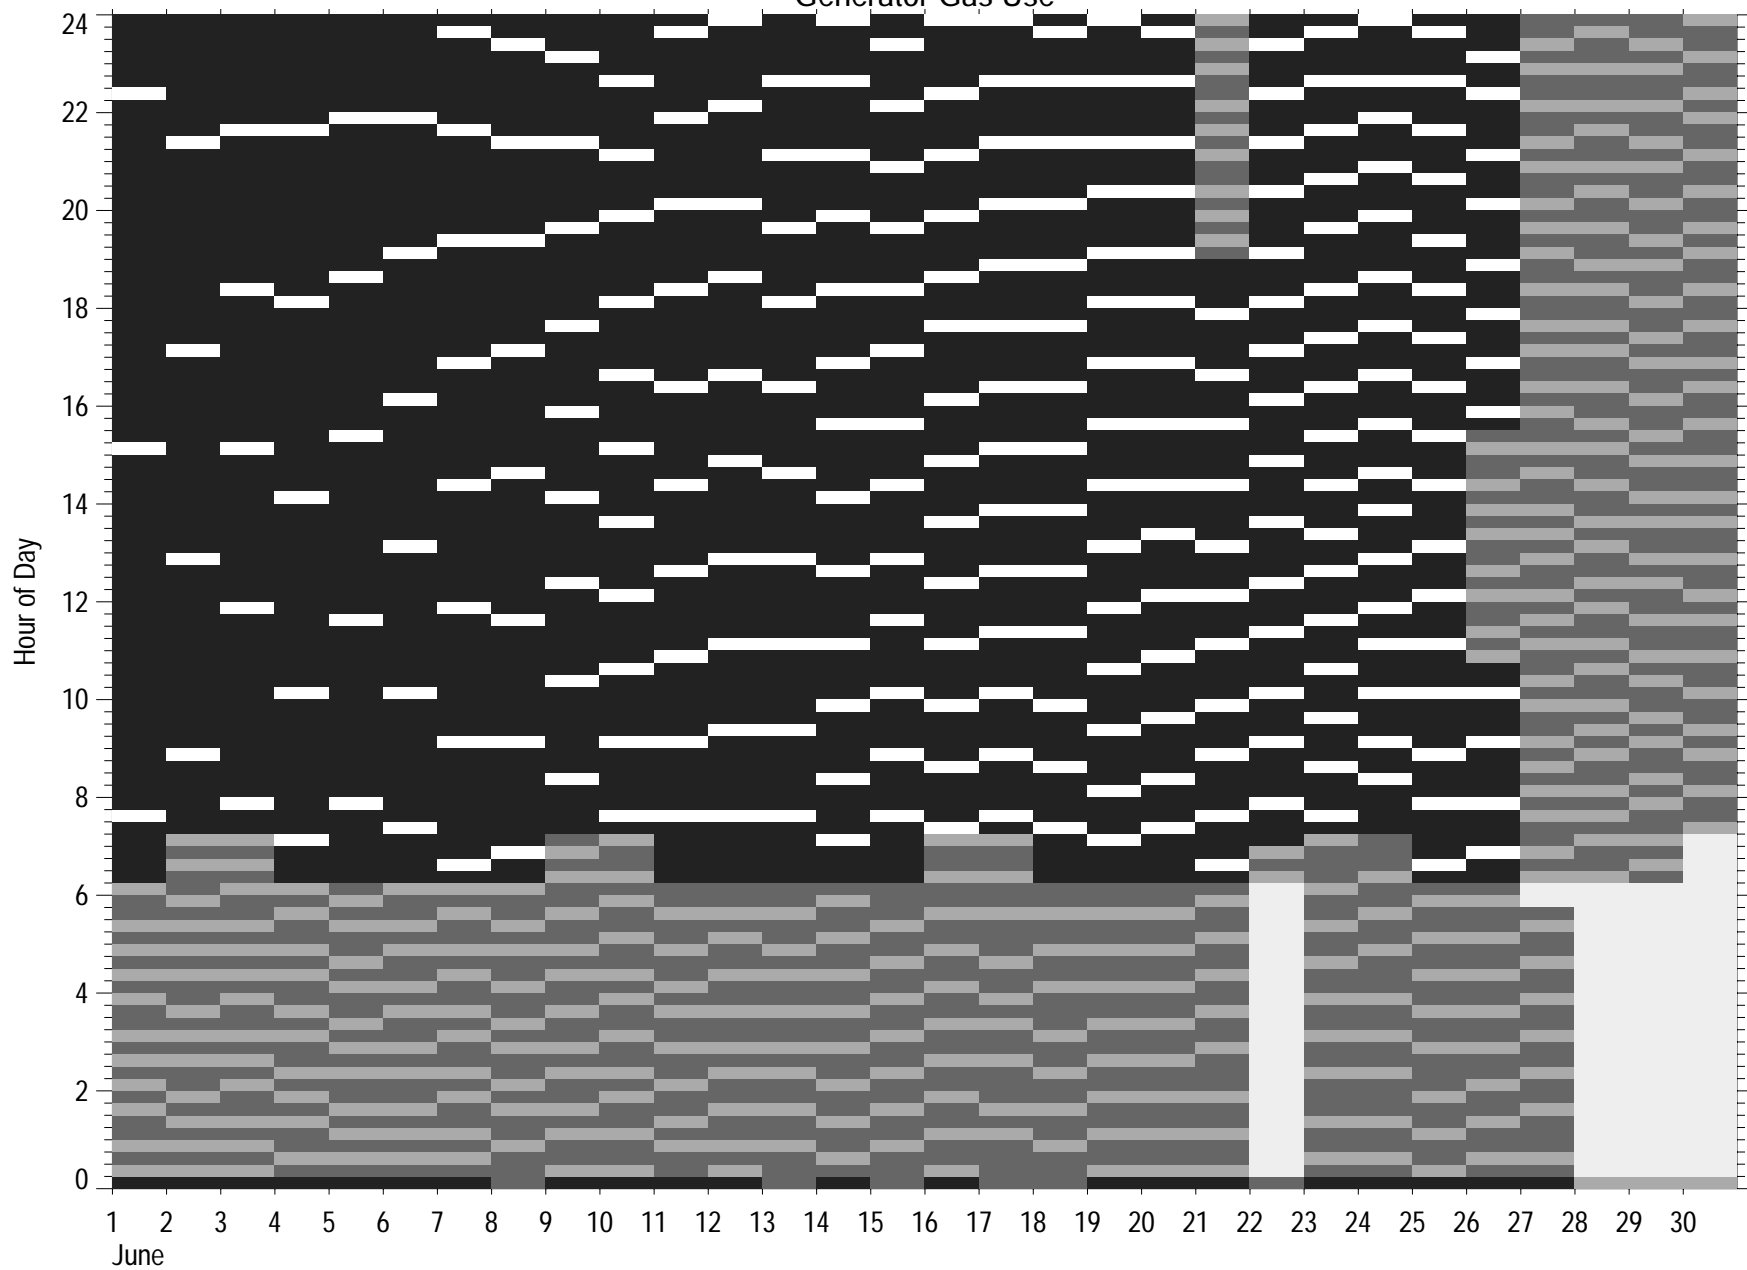

Day (MAX/MIN = 1200.00/ 0.00 cu ft)

Total Useful Heat Recovery

