


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Sea Rise 2, Brooklyn, NY

07/01/08 to 07/31/08

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
07/01/08	100.00	24.00	n/a	22000.00	0.00	n/a	n/a
07/02/08	100.00	24.00	n/a	22000.00	0.00	n/a	n/a
07/03/08	100.00	24.00	n/a	22000.00	0.00	n/a	n/a
07/04/08	100.00	5.50	n/a	3300.00	68.00	n/a	n/a
07/05/08	100.00	0.50	n/a	0.00	24.00	n/a	n/a
07/06/08	100.00	0.25	n/a	0.00	27.00	n/a	n/a
07/07/08	100.00	1.25	n/a	0.00	25.00	n/a	n/a
07/08/08	100.00	14.25	n/a	13000.00	12.00	n/a	n/a
07/09/08	100.00	19.00	n/a	16000.00	0.00	n/a	n/a
07/10/08	100.00	24.00	n/a	21600.00	0.00	n/a	n/a
07/11/08	100.00	24.00	n/a	21600.00	0.00	n/a	n/a
07/12/08	100.00	24.00	n/a	21000.00	0.00	n/a	n/a
07/13/08	100.00	24.00	n/a	21100.00	0.00	n/a	n/a
07/14/08	100.00	24.00	n/a	21500.00	0.00	n/a	n/a
07/15/08	100.00	24.00	n/a	21300.00	0.00	n/a	n/a
07/16/08	100.00	24.00	n/a	21300.00	0.00	n/a	n/a
07/17/08	100.00	24.00	n/a	21100.00	0.00	n/a	n/a
07/18/08	100.00	24.00	n/a	21200.00	0.00	n/a	n/a
07/19/08	100.00	24.00	n/a	20800.00	0.00	n/a	n/a
07/20/08	100.00	24.00	n/a	20700.00	0.00	n/a	n/a
07/21/08	100.00	21.75	n/a	19100.00	55.00	n/a	n/a
07/22/08	100.00	24.00	n/a	21100.00	0.00	n/a	n/a
07/23/08	100.00	22.25	n/a	19300.00	47.00	n/a	n/a
07/24/08	100.00	22.25	n/a	19000.00	23.00	n/a	n/a
07/25/08	100.00	23.25	n/a	20600.00	16.00	n/a	n/a
07/26/08	100.00	24.00	n/a	20800.00	0.00	n/a	n/a
07/27/08	100.00	24.00	n/a	20700.00	0.00	n/a	n/a
07/28/08	100.00	23.50	n/a	21500.00	0.00	n/a	n/a
07/29/08	100.00	18.25	n/a	17100.00	19.00	n/a	n/a
07/30/08	100.00	24.00	n/a	21300.00	0.00	n/a	n/a
07/31/08	100.00	24.00	n/a	21300.00	0.00	n/a	n/a
Total	100.00	628.00	n/a	553300.00	316.00	n/a	n/a

Generator Gas Use

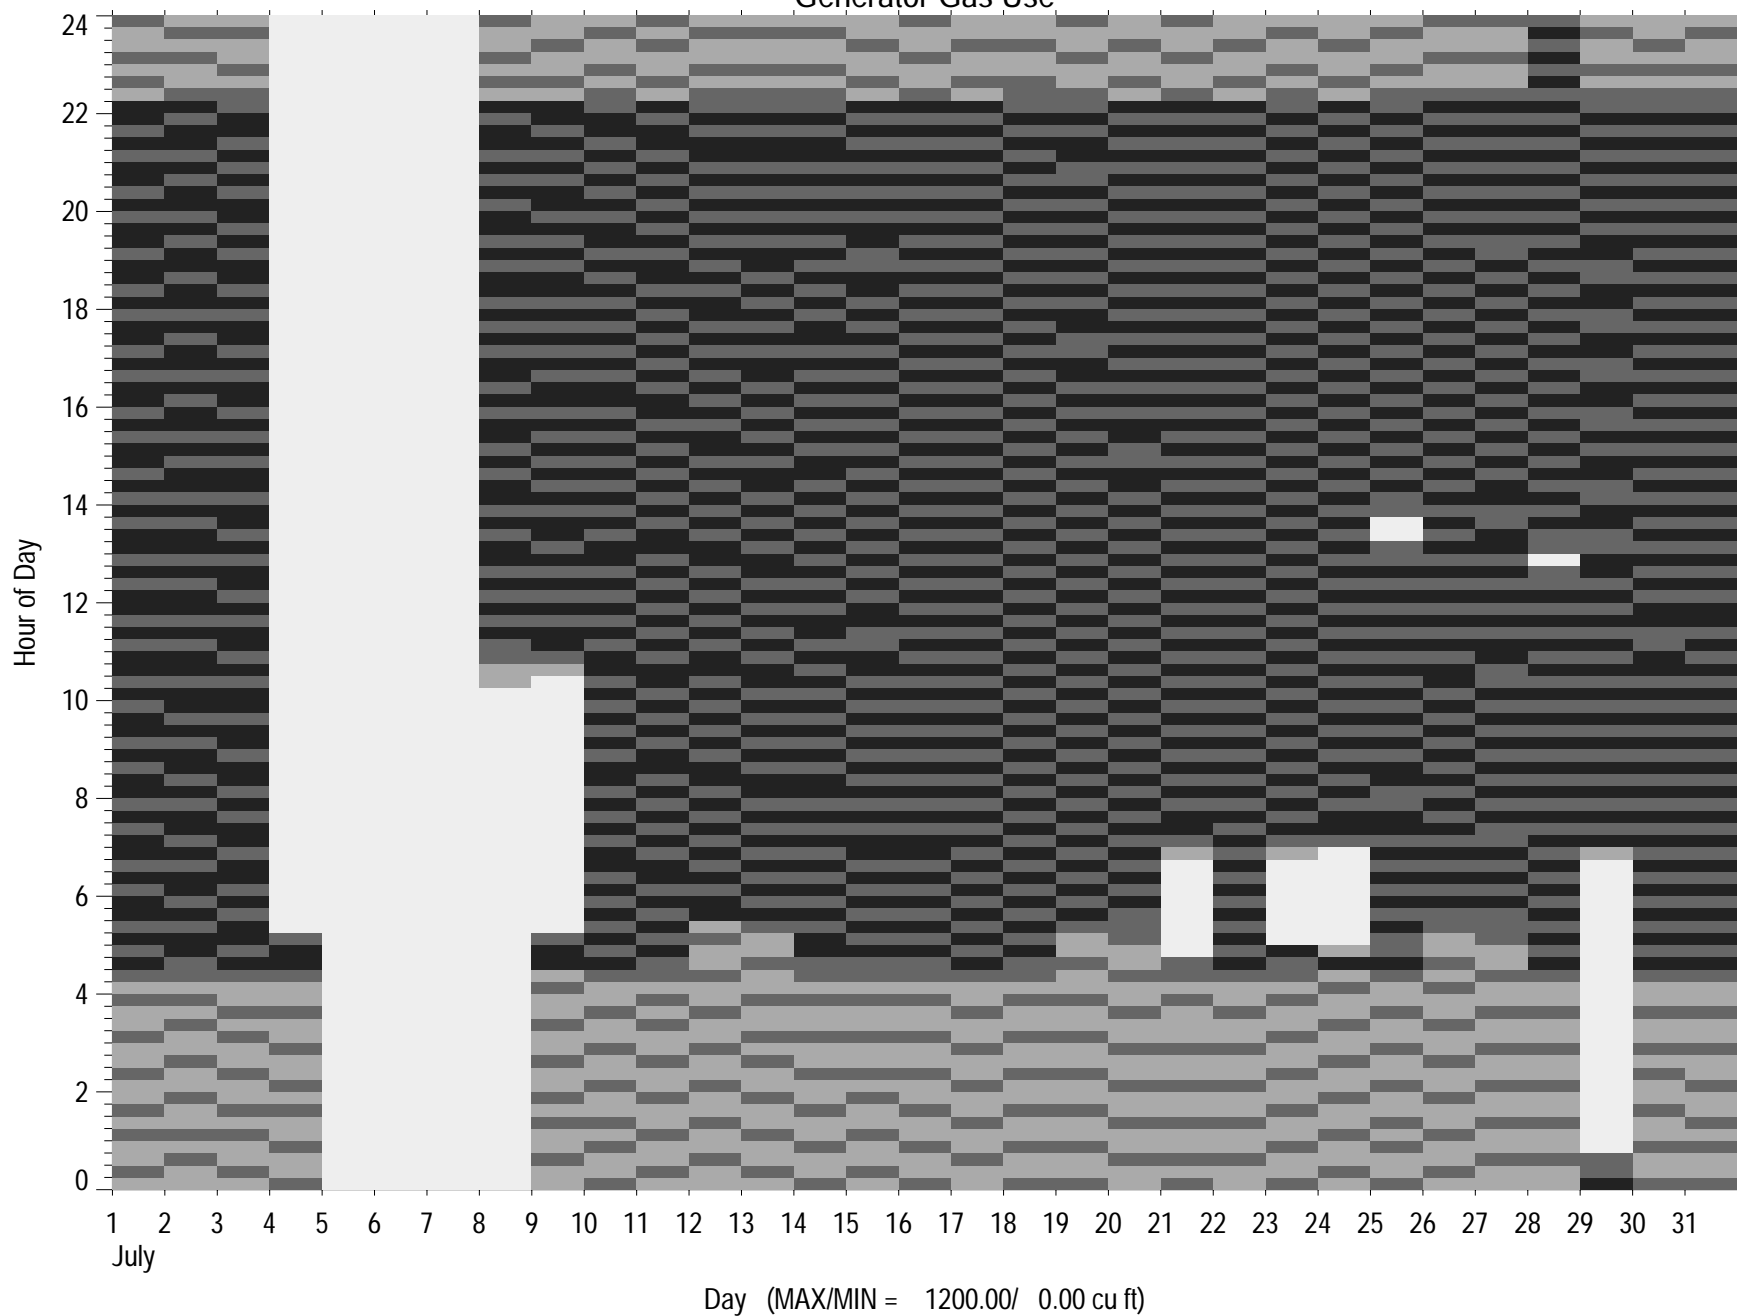

Total Useful Heat Recovery

