


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Modern Landfill - Model City, NY


01/01/08 to 01/31/08

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
01/01/08	83.33	24.00	n/a	1841.33	208026.00	n/a	n/a
01/02/08	97.92	24.00	n/a	2749.33	190476.03	n/a	n/a
01/03/08	100.00	24.00	n/a	2984.33	189072.00	n/a	n/a
01/04/08	66.67	24.00	n/a	1035.00	186498.03	n/a	n/a
01/05/08	83.33	24.00	n/a	564518.00	196325.98	n/a	n/a
01/06/08	100.00	24.00	n/a	284133.66	195389.98	n/a	n/a
01/07/08	100.00	24.00	n/a	3166.67	211535.95	n/a	n/a
01/08/08	100.00	24.00	n/a	2848.67	203346.02	n/a	n/a
01/09/08	100.00	24.00	n/a	2823.67	211068.03	n/a	n/a
01/10/08	100.00	24.00	n/a	2842.33	207791.97	n/a	n/a
01/11/08	100.00	24.00	n/a	3246.67	204984.02	n/a	n/a
01/12/08	100.00	24.00	n/a	2802.00	205685.91	n/a	n/a
01/13/08	100.00	24.00	n/a	2814.33	204282.02	n/a	n/a
01/14/08	100.00	24.00	n/a	2823.33	200070.03	n/a	n/a
01/15/08	100.00	8.00	n/a	2873.00	201707.97	n/a	n/a
01/16/08	100.00	16.00	n/a	2885.00	197729.97	n/a	n/a
01/17/08	100.00	24.00	n/a	3208.67	197027.95	n/a	n/a
01/18/08	100.00	24.00	n/a	3176.67	195389.92	n/a	n/a
01/19/08	100.00	24.00	n/a	3254.33	201474.00	n/a	n/a
01/20/08	100.00	24.00	n/a	2453.67	195155.95	n/a	n/a
01/21/08	100.00	24.00	n/a	2582.00	196794.02	n/a	n/a
01/22/08	66.67	24.00	n/a	956.33	193518.06	n/a	n/a
01/23/08	83.33	24.00	n/a	8652.00	192347.92	n/a	n/a
01/24/08	97.92	24.00	n/a	6254.00	189072.00	n/a	n/a
01/25/08	100.00	24.00	n/a	3349.33	202409.94	n/a	n/a
01/26/08	66.67	24.00	n/a	1192.67	197496.05	n/a	n/a
01/27/08	83.33	24.00	n/a	1754.67	187434.00	n/a	n/a
01/28/08	100.00	24.00	n/a	2476.00	188837.92	n/a	n/a
01/29/08	100.00	24.00	n/a	2942.00	190710.00	n/a	n/a
01/30/08	100.00	24.00	n/a	2570.67	182520.05	n/a	n/a
01/31/08	100.00	24.00	n/a	2539.67	200304.00	n/a	n/a
Total	94.49	720.00	n/a	933750.00	6124481.50	n/a	n/a

Generator Gas Use

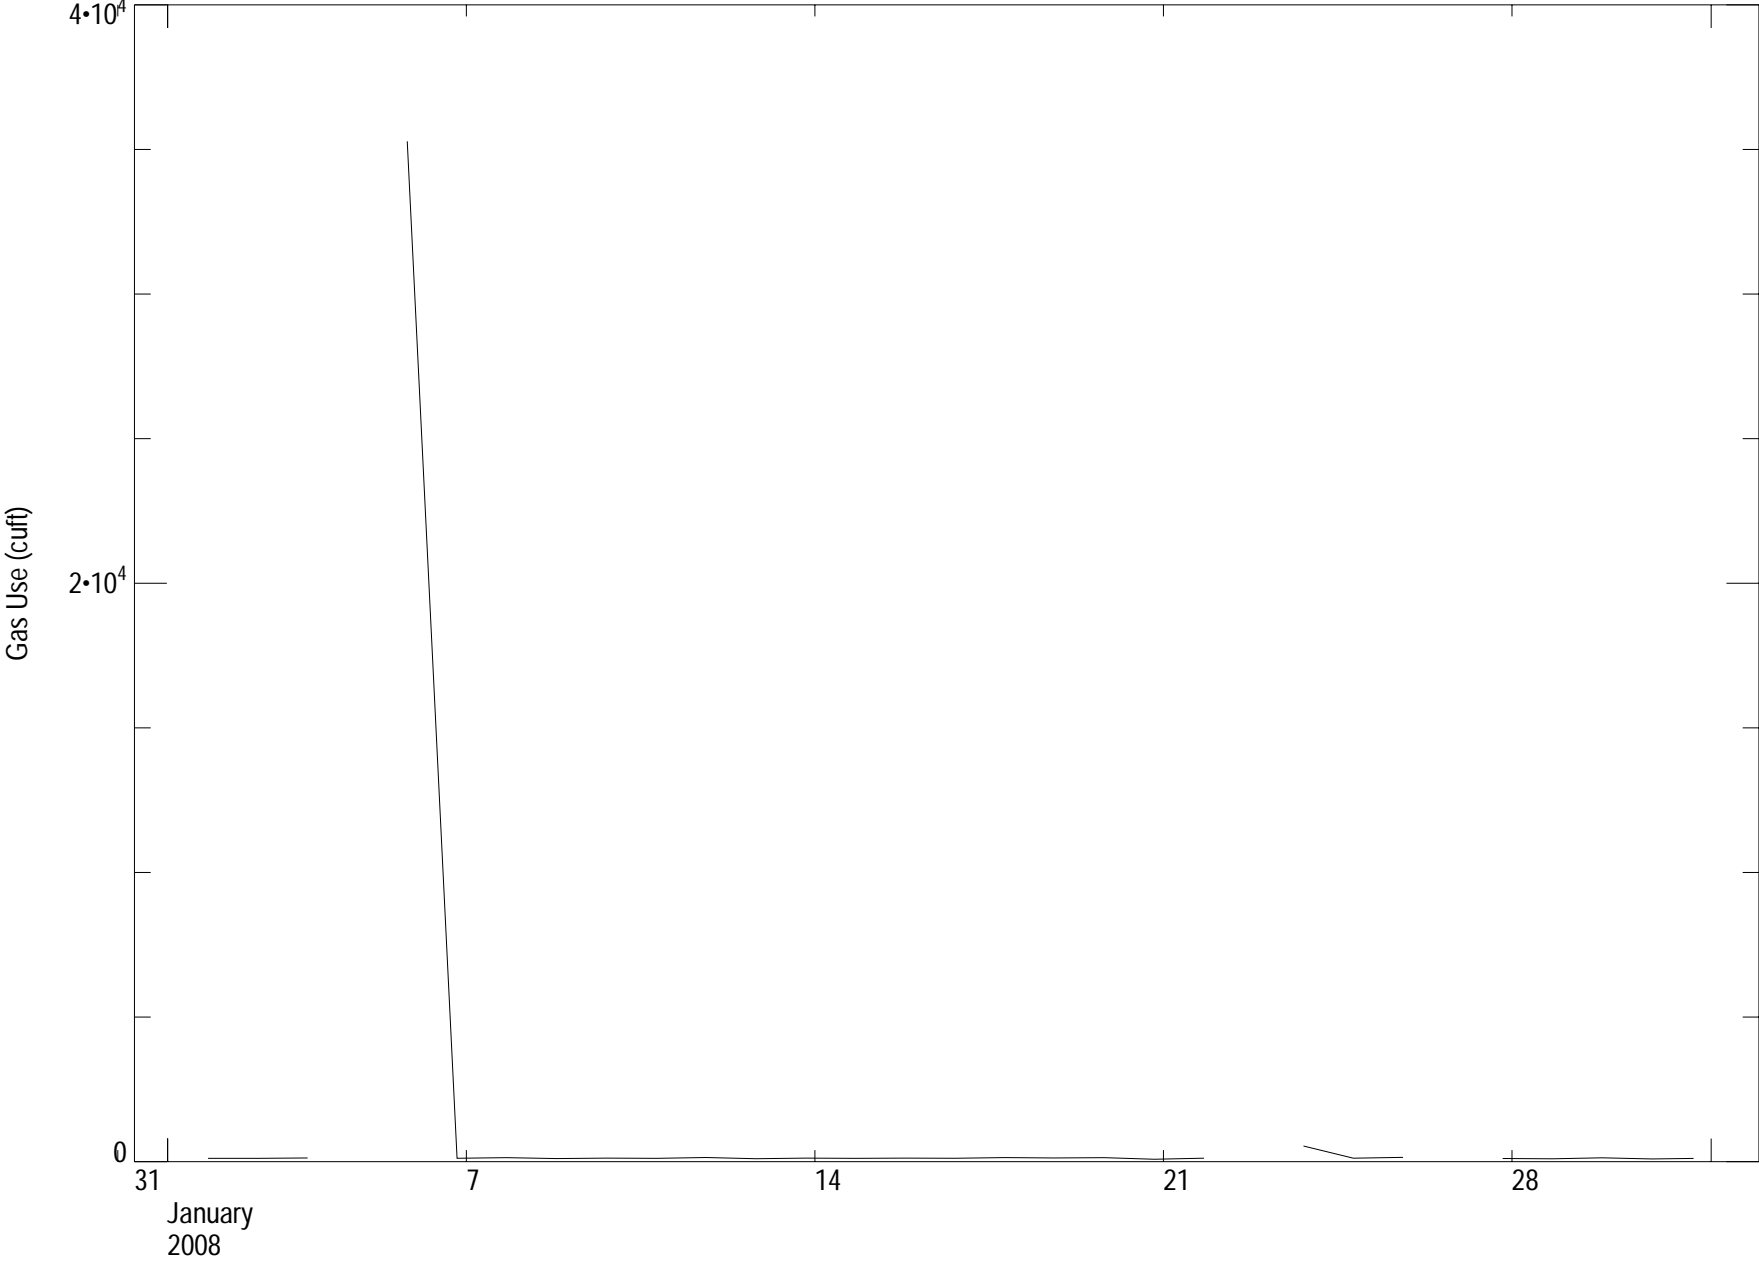

Total Useful Heat Recovery

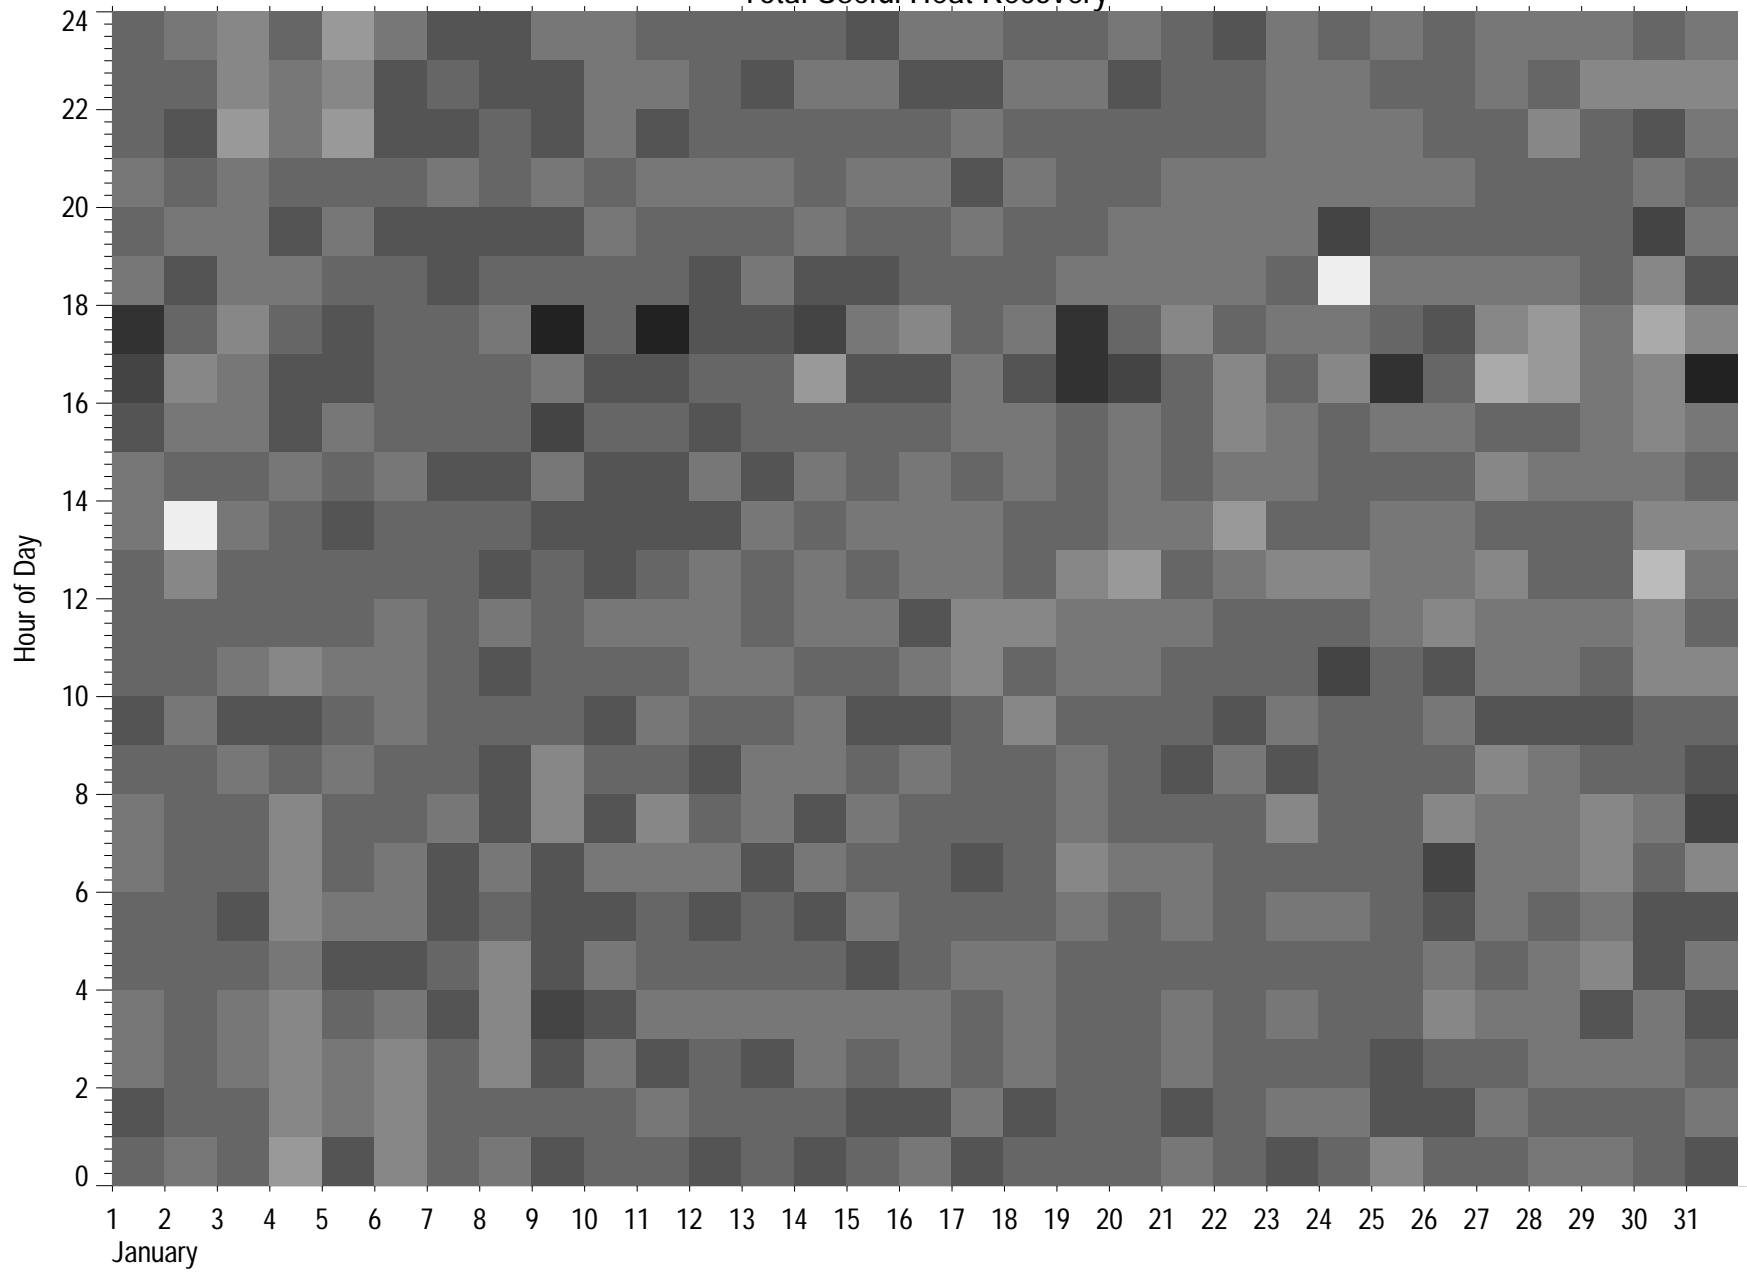

Day (MAX/MIN = 12870.00/ 0.00 MBtu)