


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Hazel Towers, Bronx, NY


09/01/08 to 09/30/08

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
09/01/08	100.00	24.00	n/a	17810.00	505664.00	8418.17	98.36
09/02/08	100.00	24.00	n/a	17870.00	501824.00	8359.02	98.36
09/03/08	100.00	24.00	n/a	17930.00	500608.00	8338.03	98.36
09/04/08	100.00	24.00	n/a	17990.00	502656.00	8382.76	98.36
09/05/08	100.00	24.00	n/a	18320.00	508928.00	8477.60	98.36
09/06/08	100.00	24.00	n/a	18570.00	505920.00	8427.98	98.36
09/07/08	100.00	2.75	n/a	2310.00	63936.00	1028.10	98.42
09/08/08	100.00	0.00	n/a	0.00	696983170.00	0.00	100.00
09/09/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/10/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/11/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/12/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/13/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/14/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/15/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/16/08	100.00	0.00	n/a	0.00	696983100.00	0.00	100.00
09/17/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/18/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/19/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/20/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/21/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/22/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/23/08	100.00	0.00	n/a	0.00	0.00	0.00	-
09/24/08	100.00	0.00	n/a	0.00	696983040.00	0.00	100.00
09/25/08	100.00	14.50	n/a	22070.00	622080.00	10628.50	98.32
09/26/08	100.00	24.00	n/a	36650.00	1004608.00	16735.99	98.36
09/27/08	100.00	24.00	n/a	36910.00	964352.00	16052.91	98.36
09/28/08	100.00	24.00	n/a	36790.00	969024.00	16159.95	98.36
09/29/08	100.00	24.00	n/a	36980.00	973120.00	16221.62	98.36
09/30/08	100.00	24.00	n/a	37070.00	974592.00	16251.04	98.36
Total	100.00	281.25	n/a	317270.00	*****	143481.67	99.99

Generator Gas Use

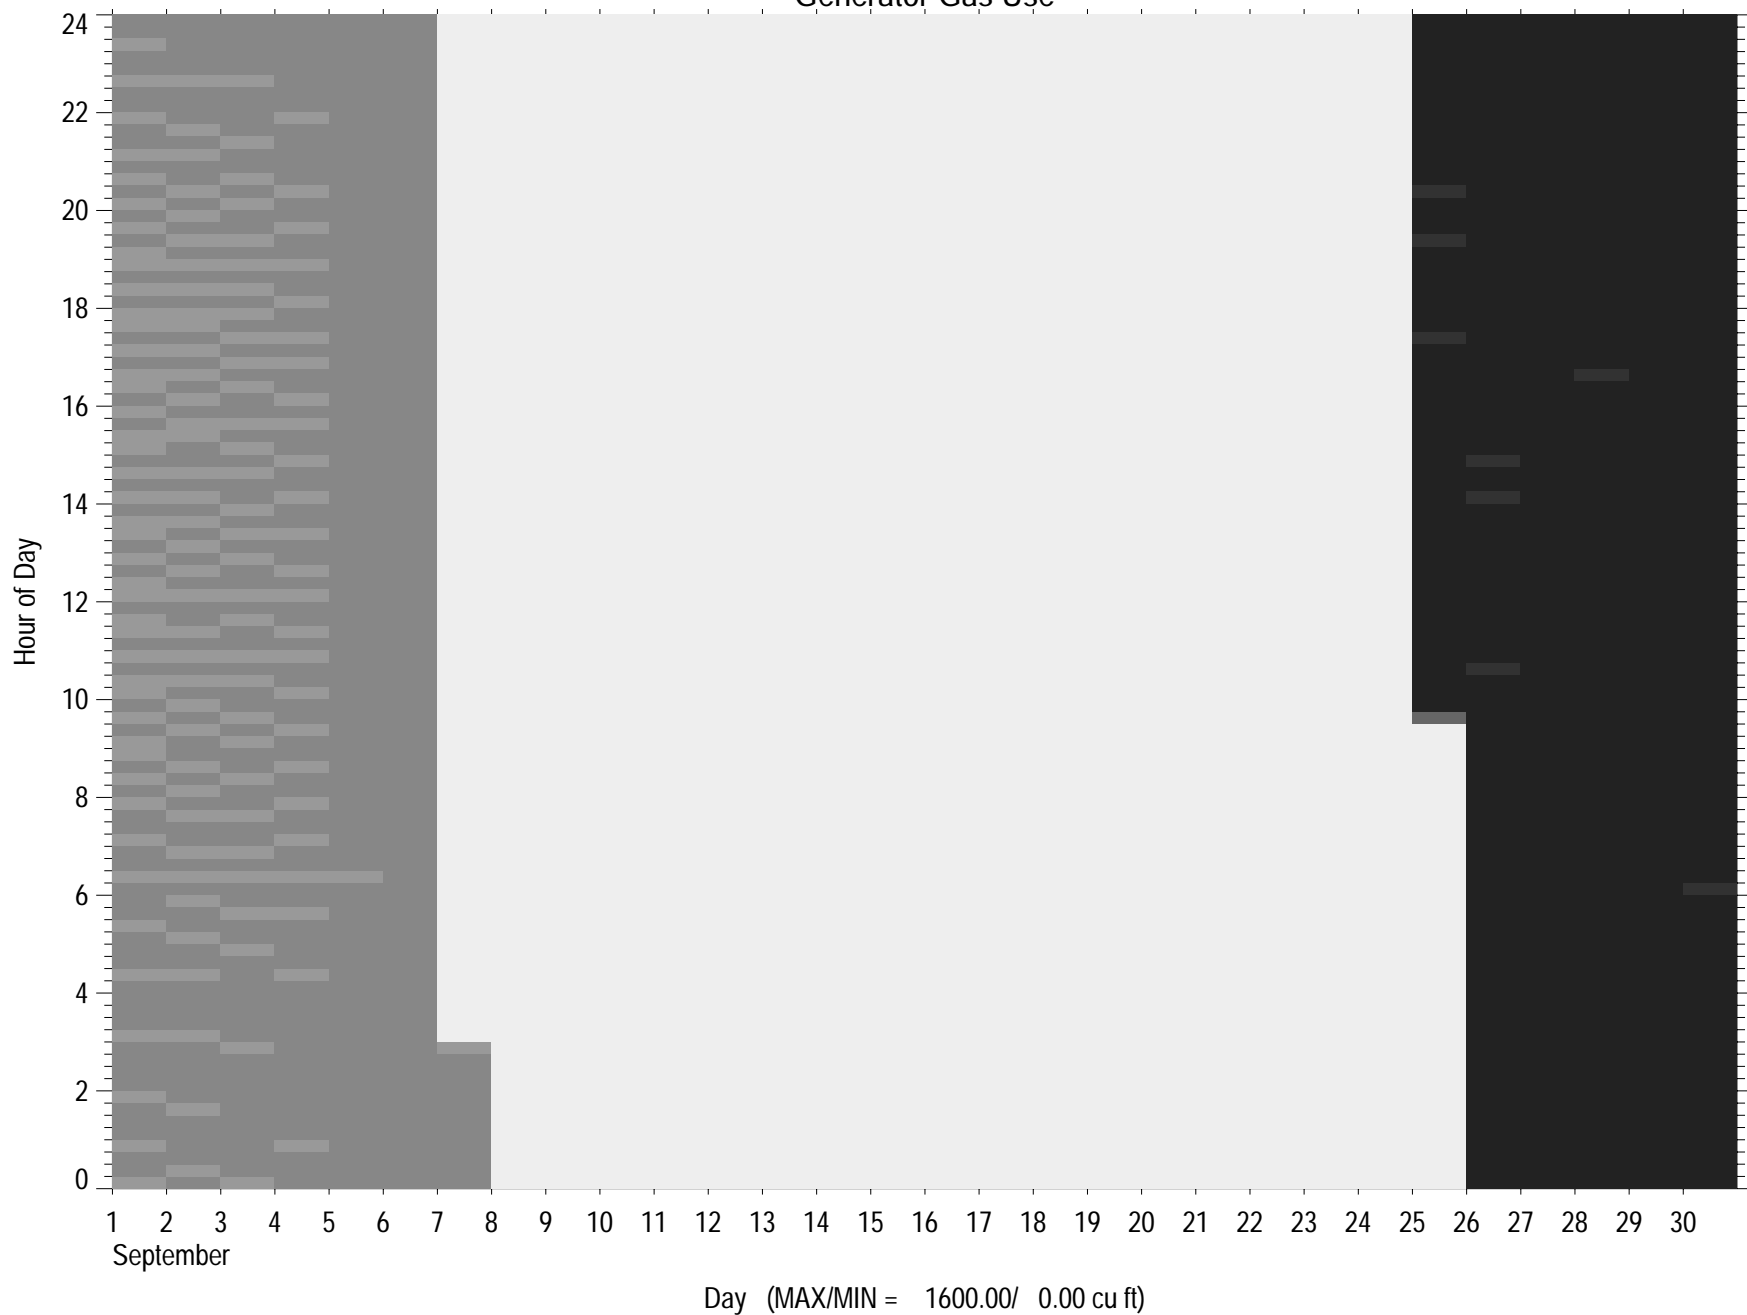

Total Useful Heat Recovery

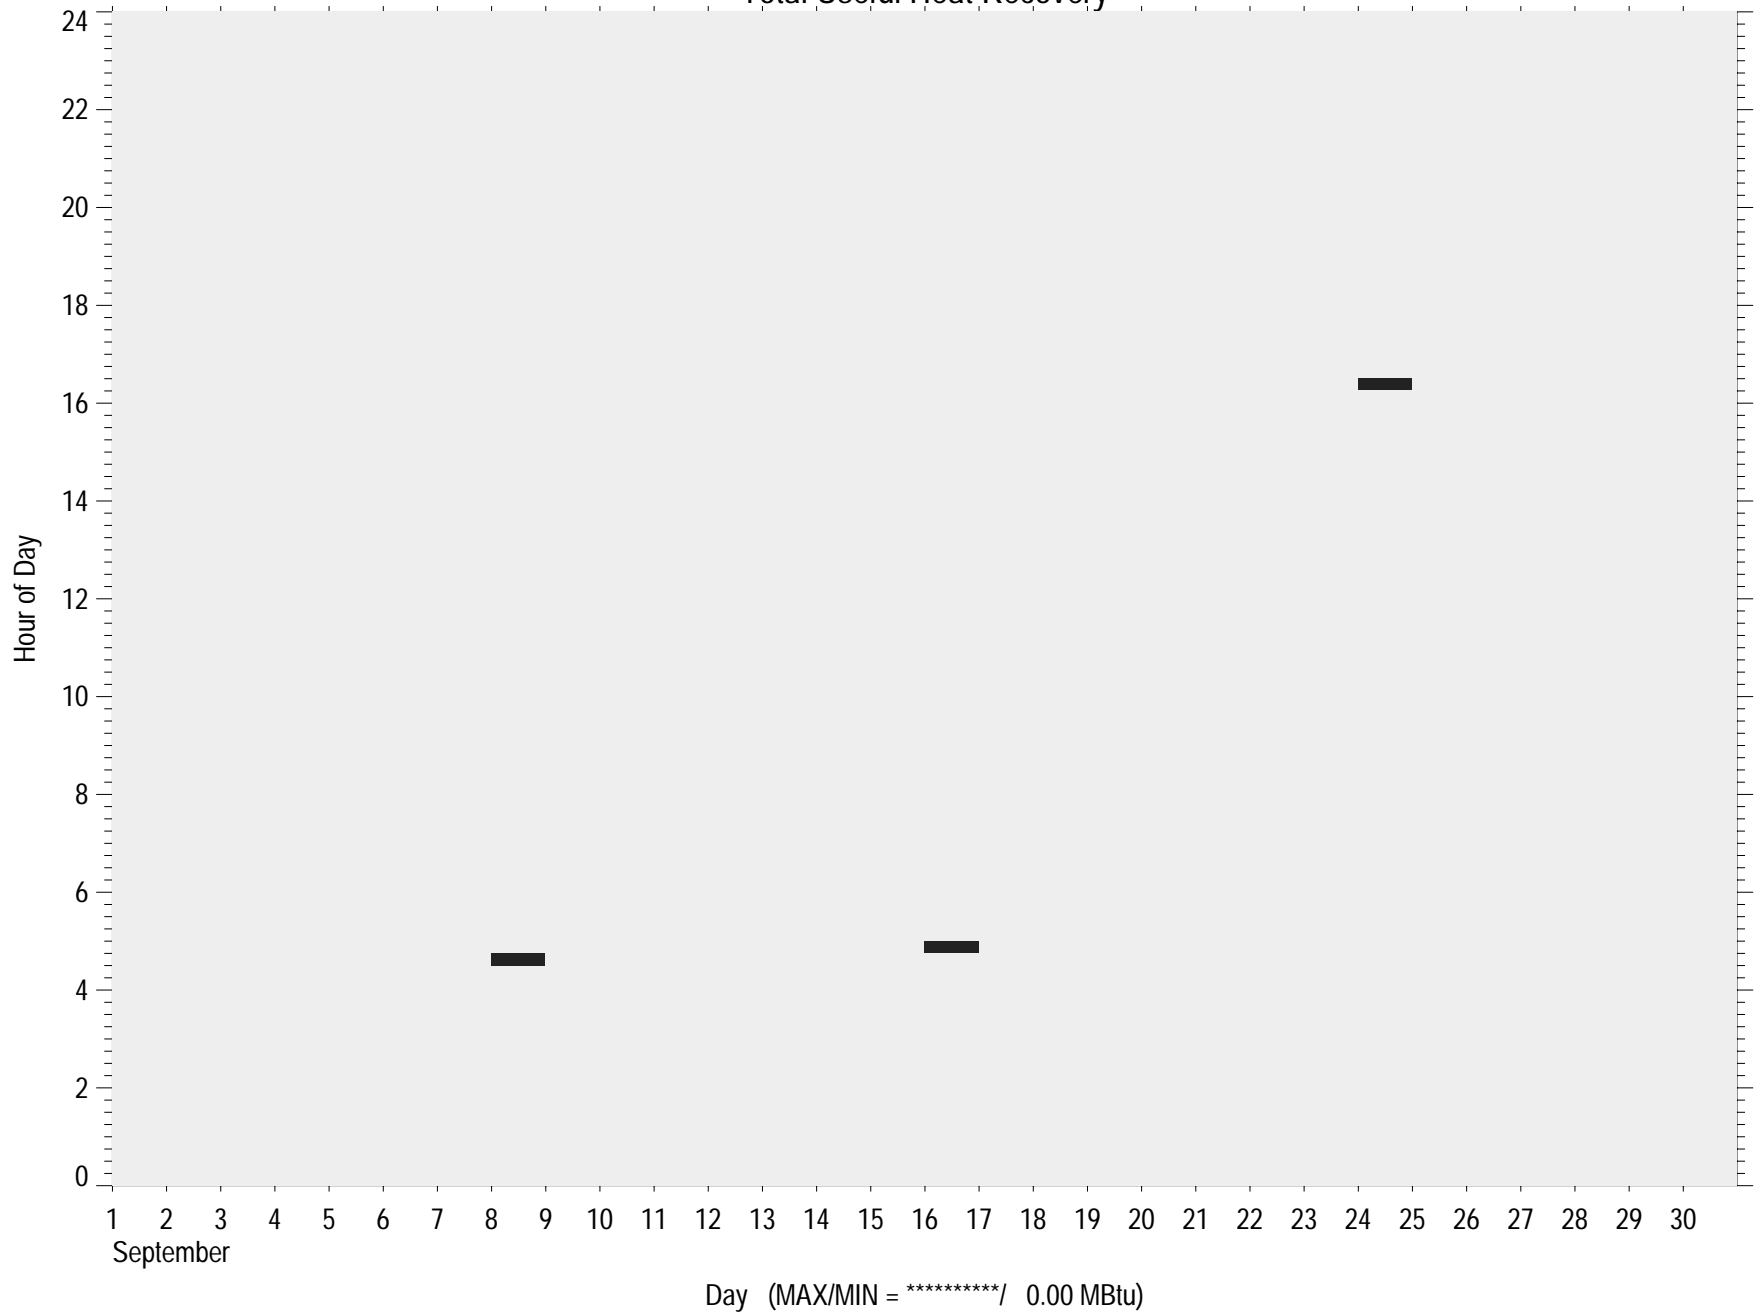

Total Unused Heat Recovery

