


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Hazel Towers, Bronx, NY

12/01/08 to 12/31/08

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
12/01/08	91.15	4.25	n/a	0.00	5952.00	0.00	100.00
12/02/08	68.23	15.25	n/a	0.00	5952.00	0.00	100.00
12/03/08	52.08	23.00	n/a	0.00	5952.00	0.00	100.00
12/04/08	52.60	22.75	n/a	0.00	5952.00	0.00	100.00
12/05/08	67.19	15.75	n/a	0.00	6016.00	0.00	100.00
12/06/08	54.17	22.00	n/a	0.00	5952.00	0.00	100.00
12/07/08	77.08	11.00	n/a	0.00	5952.00	0.00	100.00
12/08/08	68.23	15.25	n/a	0.00	5952.00	0.00	100.00
12/09/08	75.00	12.00	n/a	0.00	5952.00	0.00	100.00
12/10/08	82.81	8.25	n/a	0.00	5952.00	0.00	100.00
12/11/08	80.73	9.25	n/a	0.00	5952.00	0.00	100.00
12/12/08	84.38	7.50	n/a	0.00	6016.00	0.00	100.00
12/13/08	81.77	8.75	n/a	0.00	5952.00	0.00	100.00
12/14/08	78.13	10.50	n/a	0.00	5952.00	0.00	100.00
12/15/08	85.42	7.00	n/a	0.00	5952.00	0.00	100.00
12/16/08	85.42	7.00	n/a	0.00	5952.00	0.00	100.00
12/17/08	73.44	12.75	n/a	0.00	5952.00	0.00	100.00
12/18/08	85.42	7.00	n/a	0.00	5952.00	0.00	100.00
12/19/08	78.13	10.50	n/a	0.00	6016.00	0.00	100.00
12/20/08	86.98	6.25	n/a	0.00	5952.00	0.00	100.00
12/21/08	94.27	2.75	n/a	0.00	5952.00	0.00	100.00
12/22/08	79.69	9.75	n/a	0.00	5952.00	0.00	100.00
12/23/08	86.98	6.25	n/a	0.00	5952.00	0.00	100.00
12/24/08	85.42	7.00	n/a	0.00	5952.00	0.00	100.00
12/25/08	89.06	5.25	n/a	0.00	5952.00	0.00	100.00
12/26/08	83.33	8.00	n/a	0.00	6016.00	0.00	100.00
12/27/08	78.65	10.25	n/a	0.00	5952.00	0.00	100.00
12/28/08	76.04	11.50	n/a	0.00	5952.00	0.00	100.00
12/29/08	86.46	6.50	n/a	0.00	5952.00	0.00	100.00
12/30/08	85.94	6.75	n/a	0.00	5952.00	0.00	100.00
12/31/08	72.92	13.00	n/a	0.00	*****	0.00	100.00
Total	78.29	323.00	n/a	0.00	*****	0.00	100.00

Total Useful Heat Recovery

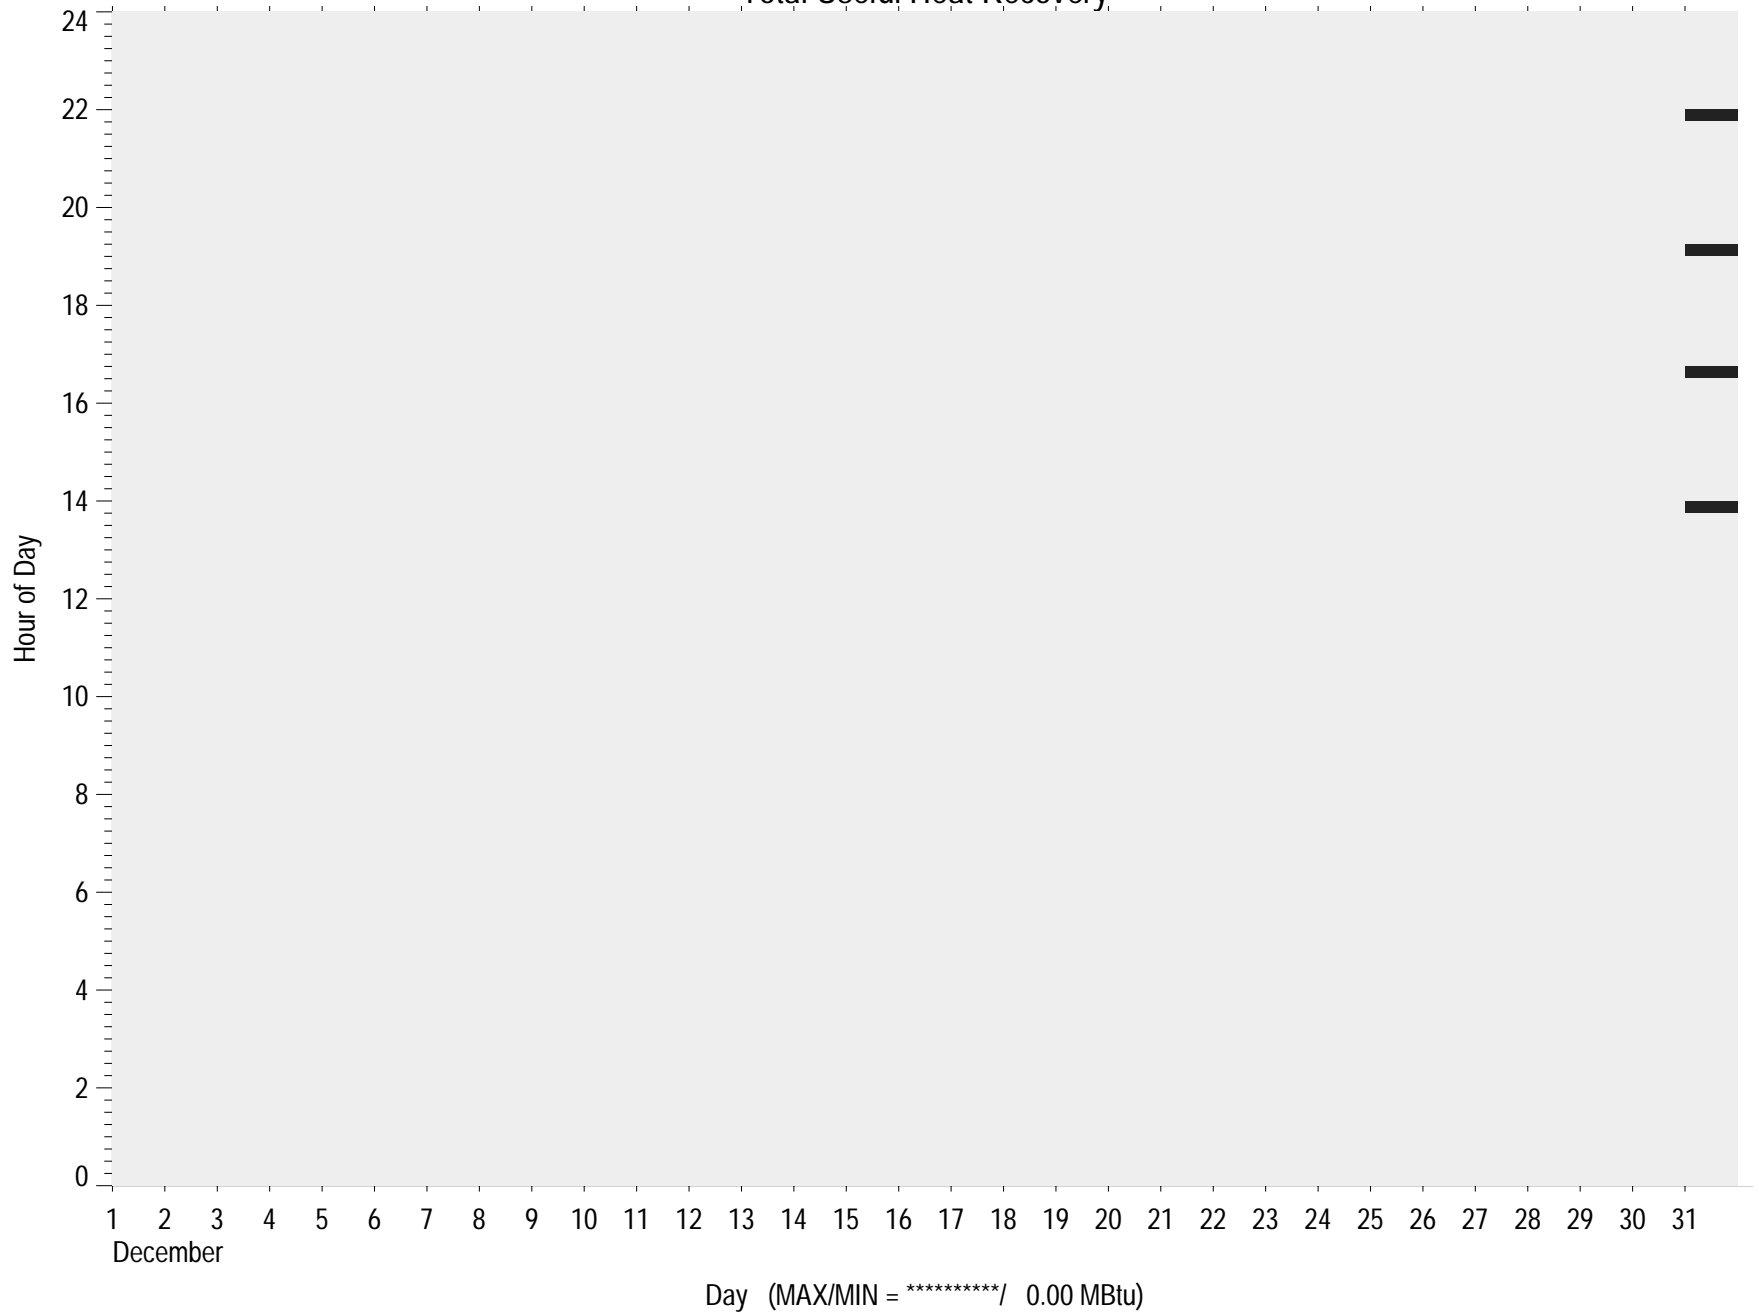

Total Unused Heat Recovery



Day (MAX/MIN = 0.00/ 0.00 MBtu)