


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Hazel Towers, Bronx, NY

01/01/09 to 01/31/09

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
01/01/09	88.54	5.00	n/a	0.00	*****	0.00	100.00
01/02/09	80.73	9.25	n/a	0.00	*****	0.00	100.00
01/03/09	85.42	7.00	n/a	0.00	*****	0.00	100.00
01/04/09	88.54	5.50	n/a	0.00	*****	0.00	100.00
01/05/09	85.94	6.75	n/a	0.00	*****	0.00	100.00
01/06/09	79.17	10.00	n/a	0.00	*****	0.00	100.00
01/07/09	78.65	10.25	n/a	0.00	*****	0.00	100.00
01/08/09	84.90	7.25	n/a	0.00	*****	0.00	100.00
01/09/09	83.85	7.75	n/a	0.00	*****	0.00	100.00
01/10/09	91.67	4.00	n/a	0.00	*****	0.00	100.00
01/11/09	86.46	6.50	n/a	0.00	*****	0.00	100.00
01/12/09	79.17	10.00	n/a	0.00	*****	0.00	100.00
01/13/09	86.46	6.50	n/a	0.00	*****	0.00	100.00
01/14/09	80.73	9.25	n/a	0.00	*****	0.00	100.00
01/15/09	84.90	7.25	n/a	0.00	*****	0.00	100.00
01/16/09	93.75	3.00	n/a	0.00	*****	91.67	100.00
01/17/09	88.54	5.50	n/a	0.00	711187330.00	94.94	100.00
01/18/09	91.15	4.25	n/a	0.00	*****	0.00	100.00
01/19/09	83.85	7.75	n/a	0.00	*****	0.00	100.00
01/20/09	69.27	14.75	n/a	0.00	*****	0.00	100.00
01/21/09	58.33	20.00	n/a	0.00	6464.00	183.35	97.24
01/22/09	58.85	19.75	n/a	0.00	5952.00	0.00	100.00
01/23/09	59.38	19.50	n/a	0.00	5632.00	0.00	100.00
01/24/09	61.46	18.50	n/a	0.00	6400.00	0.00	100.00
01/25/09	69.79	14.50	n/a	0.00	5696.00	0.00	100.00
01/26/09	65.63	16.50	n/a	0.00	2688.00	0.00	100.00
01/27/09	50.00	24.00	n/a	-	0.00	0.00	-
01/28/09	50.00	24.00	n/a	-	0.00	0.00	-
01/29/09	50.00	24.00	n/a	-	0.00	0.00	-
01/30/09	50.00	24.00	n/a	-	0.00	0.00	-
01/31/09	50.00	24.00	n/a	-	0.00	0.00	-
Total	74.68	376.25	n/a	0.00	*****	369.96	100.00

Generator Gas Use

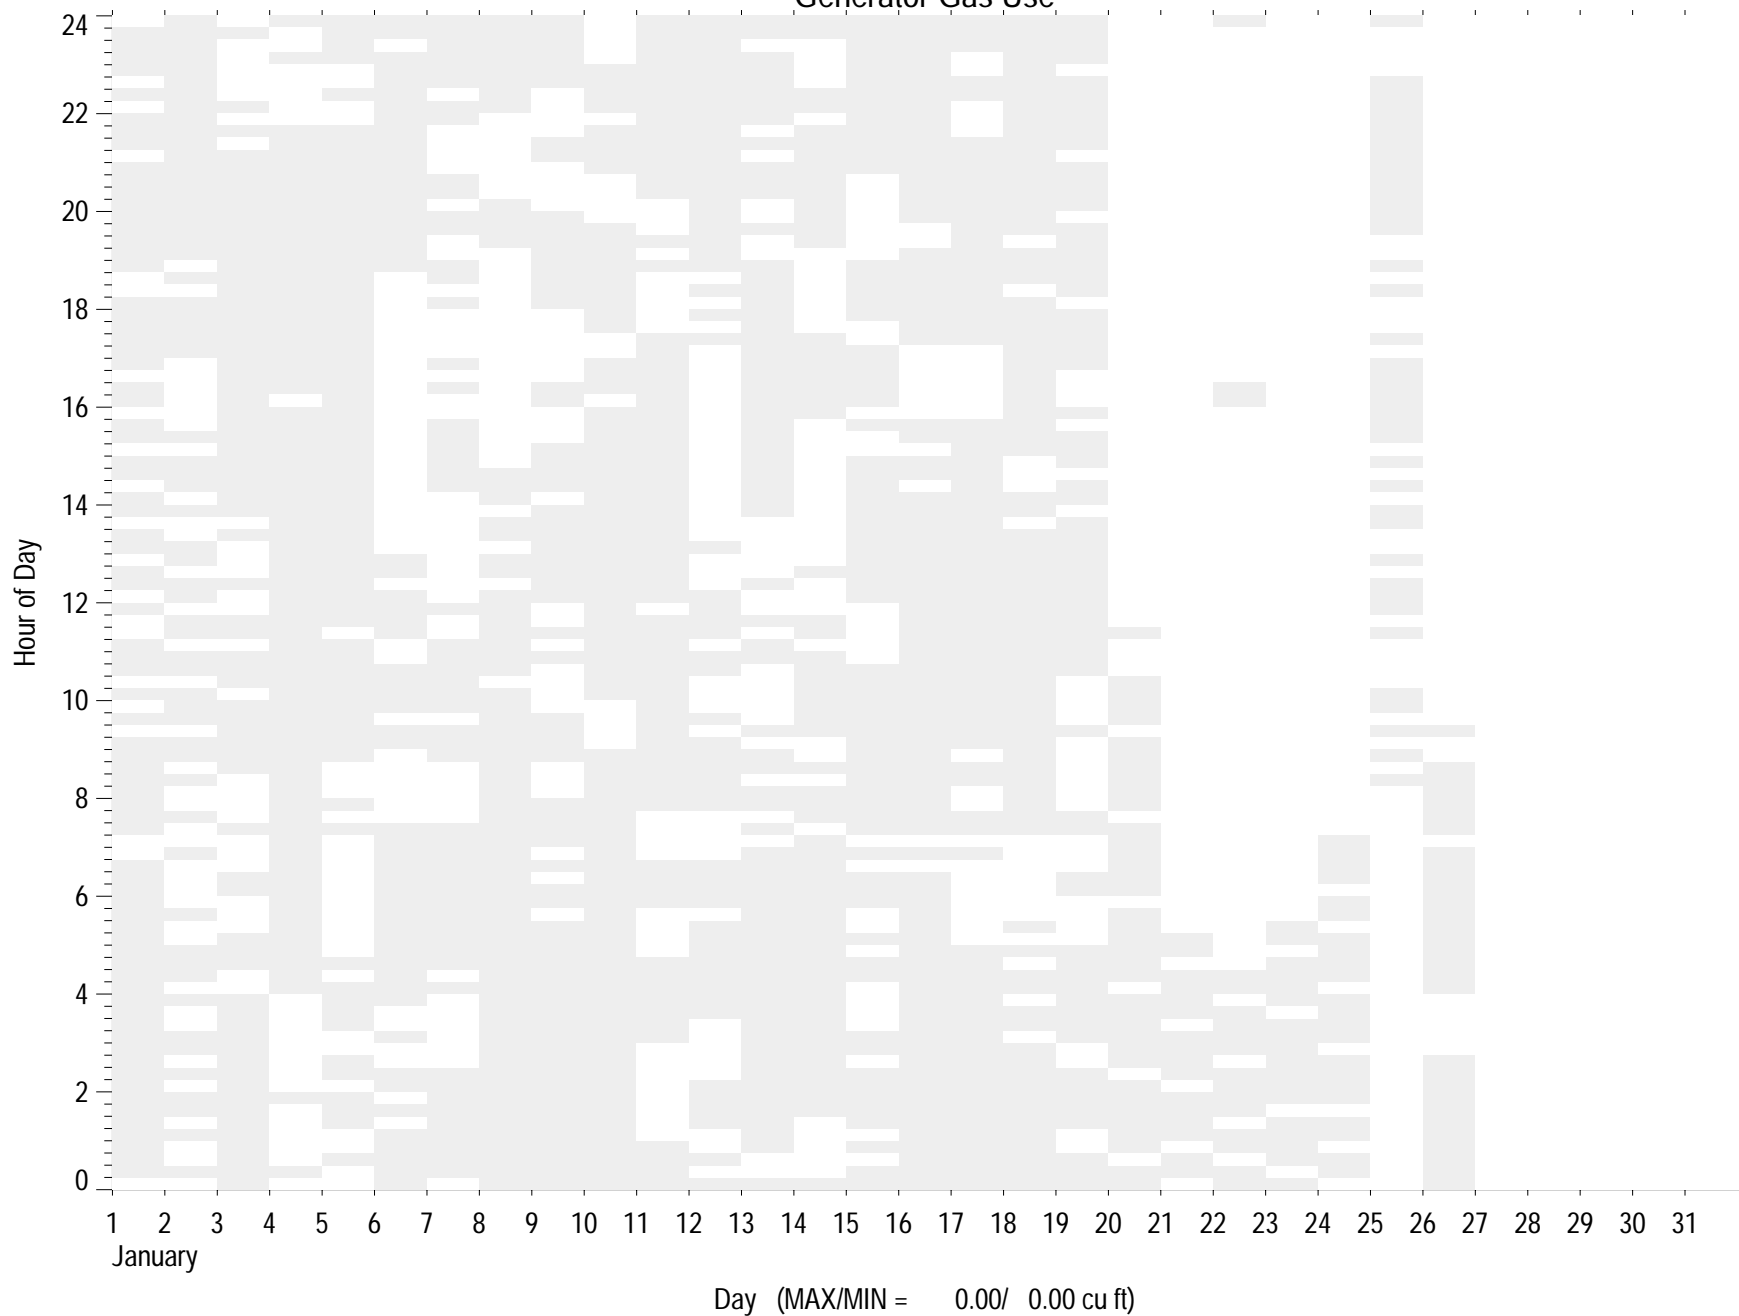

Total Unused Heat Recovery



Day (MAX/MIN = 733.39/ 0.00 MBtu)