


**GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY**

Schwab House - Aegis Energy


11/01/09 to 11/30/09

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
11/01/09	98.52	23.70	n/a	0.00	16147.81	3537.82	82.03
11/02/09	97.43	23.87	n/a	0.00	17180.06	3495.75	83.09
11/03/09	96.90	23.90	n/a	0.00	16706.93	3502.49	82.67
11/04/09	95.25	23.88	n/a	0.00	15753.69	3360.43	82.42
11/05/09	91.55	22.00	n/a	0.00	16949.31	2941.73	85.21
11/06/09	91.78	23.08	n/a	0.00	18490.55	2926.48	86.34
11/07/09	97.01	23.97	n/a	0.00	19270.38	3248.88	85.57
11/08/09	96.02	22.98	n/a	0.00	18014.63	3254.11	84.70
11/09/09	94.51	22.90	n/a	0.00	16515.18	3165.67	83.91
11/10/09	91.60	21.60	n/a	0.00	16619.68	2967.98	84.85
11/11/09	93.61	22.75	n/a	0.00	15976.44	2936.34	84.47
11/12/09	95.97	23.83	n/a	0.00	16006.04	3192.99	83.37
11/13/09	97.80	24.00	n/a	0.00	17793.51	3345.92	84.17
11/14/09	95.30	23.08	n/a	0.00	16054.18	3208.49	83.34
11/15/09	99.81	24.00	n/a	0.00	19454.07	3228.80	85.77
11/16/09	96.50	23.65	n/a	0.00	16251.51	3038.01	84.25
11/17/09	99.40	24.00	n/a	0.00	20512.02	2975.09	87.33
11/18/09	97.62	23.97	n/a	0.00	19097.15	3174.71	85.75
11/19/09	96.92	23.68	n/a	0.00	17585.23	3333.32	84.07
11/20/09	96.11	23.55	n/a	0.00	15935.71	3560.55	81.74
11/21/09	97.52	24.00	n/a	0.00	17456.38	3473.79	83.40
11/22/09	95.95	23.45	n/a	0.00	16521.87	3082.46	84.28
11/23/09	95.81	23.85	n/a	0.00	17428.20	3160.71	84.65
11/24/09	95.65	24.00	n/a	0.00	18752.24	3137.16	85.67
11/25/09	95.32	23.60	n/a	0.00	17908.22	3089.46	85.29
11/26/09	95.76	23.72	n/a	0.00	17082.49	3145.17	84.45
11/27/09	97.64	23.83	n/a	0.00	19256.40	3152.39	85.93
11/28/09	97.80	23.30	n/a	0.00	18507.54	3102.16	85.64
11/29/09	97.62	23.88	n/a	0.00	18041.91	3105.47	85.32
11/30/09	98.17	24.00	n/a	0.00	20577.50	3035.06	87.15
Total	96.23	706.03	n/a	0.00	527846.88	95879.40	84.63


# Generator Energy Production

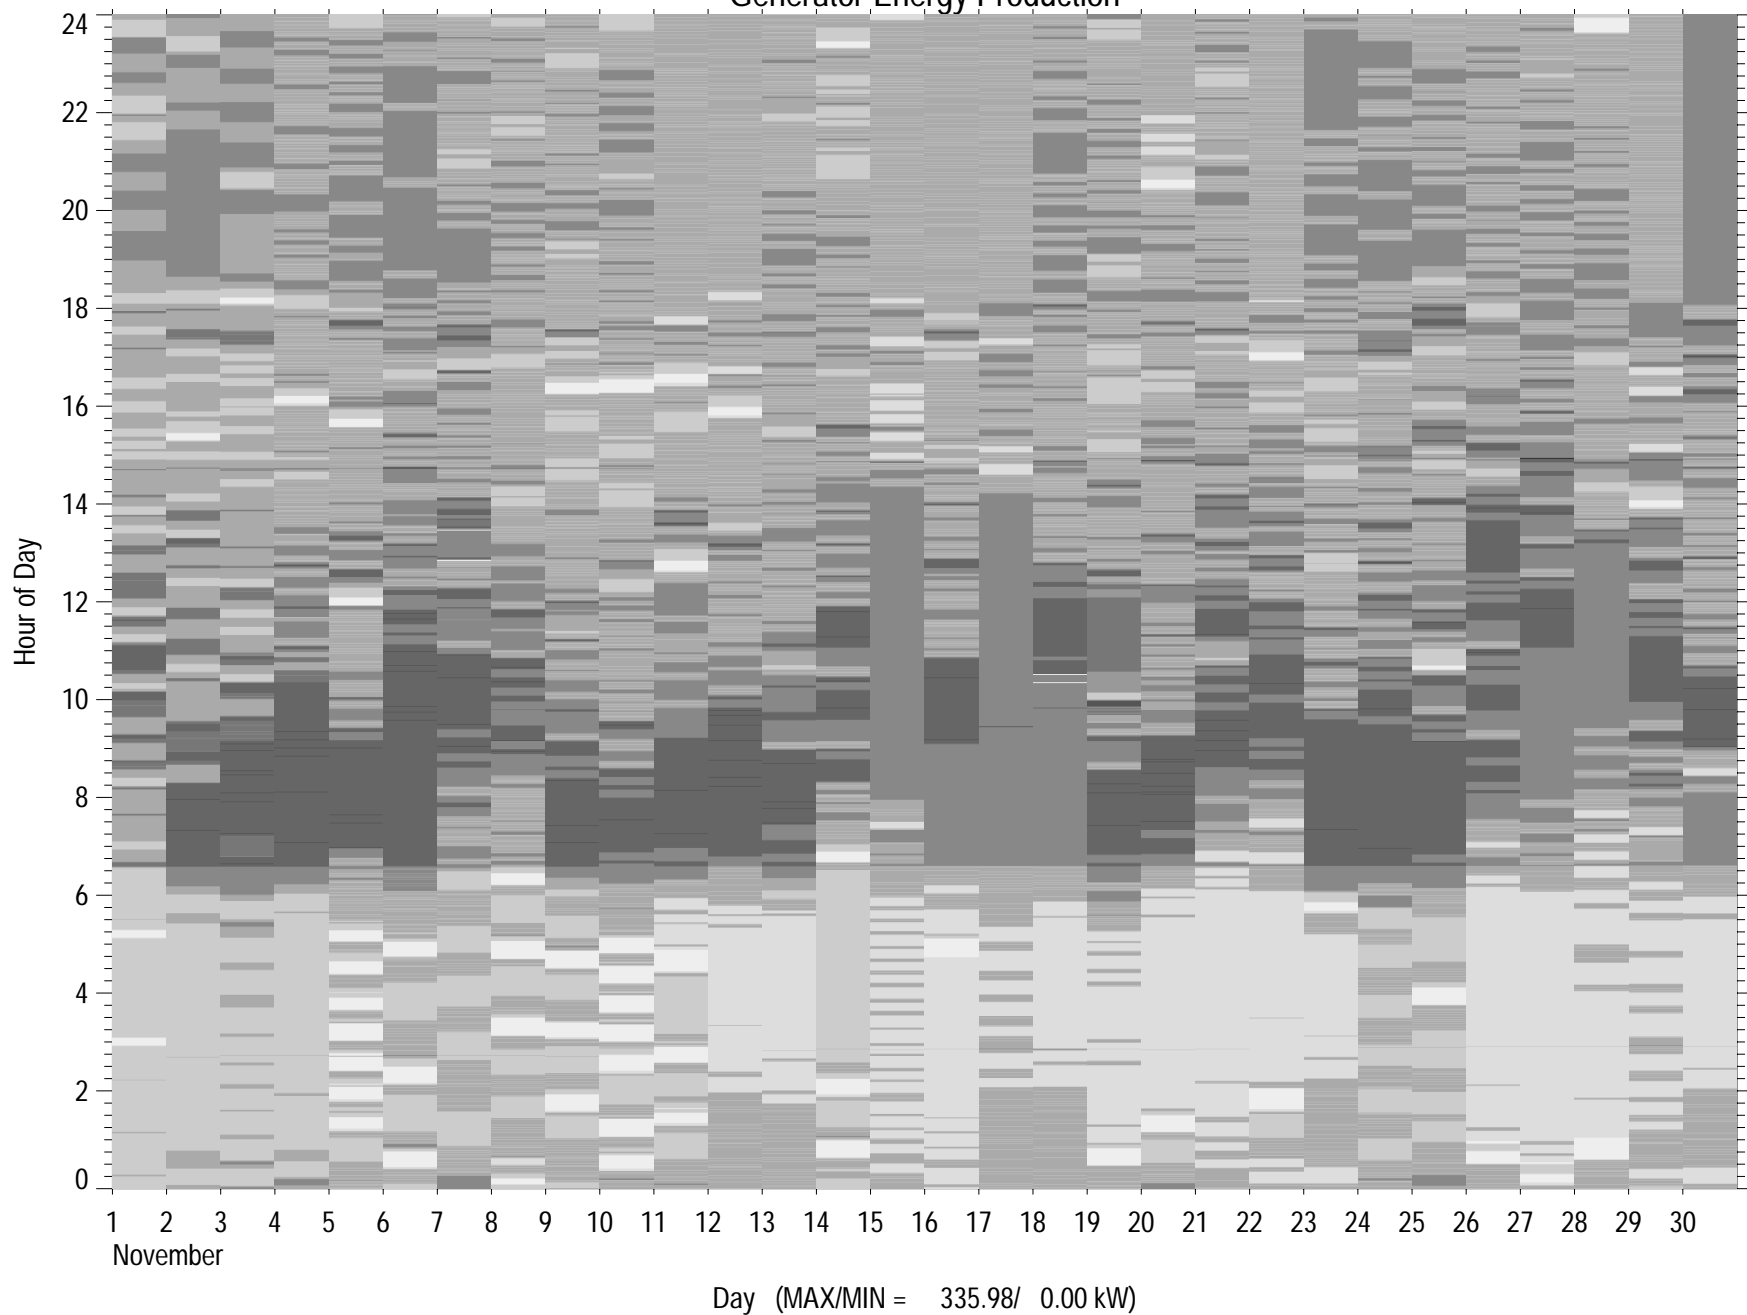

# Generator Gas Use

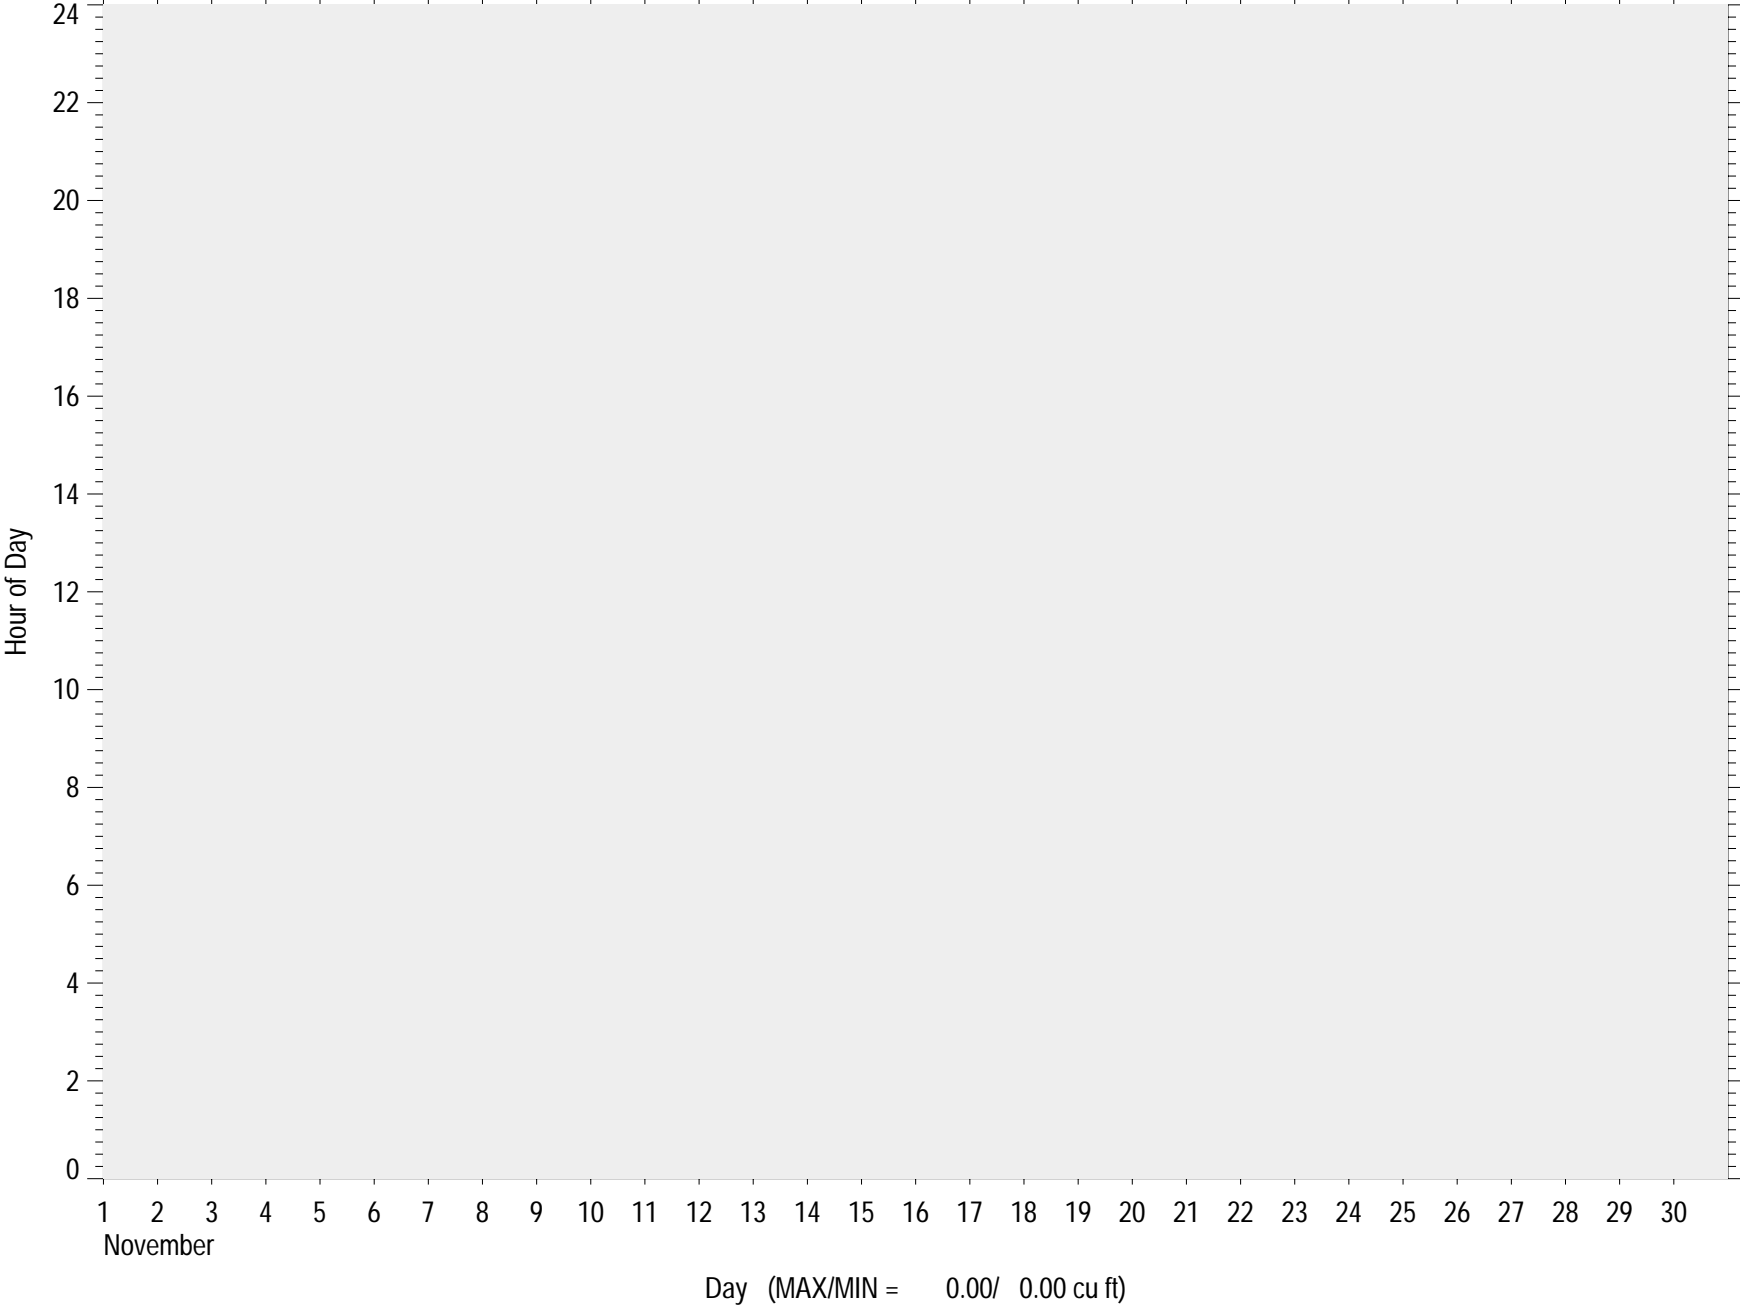

# Total Useful Heat Recovery

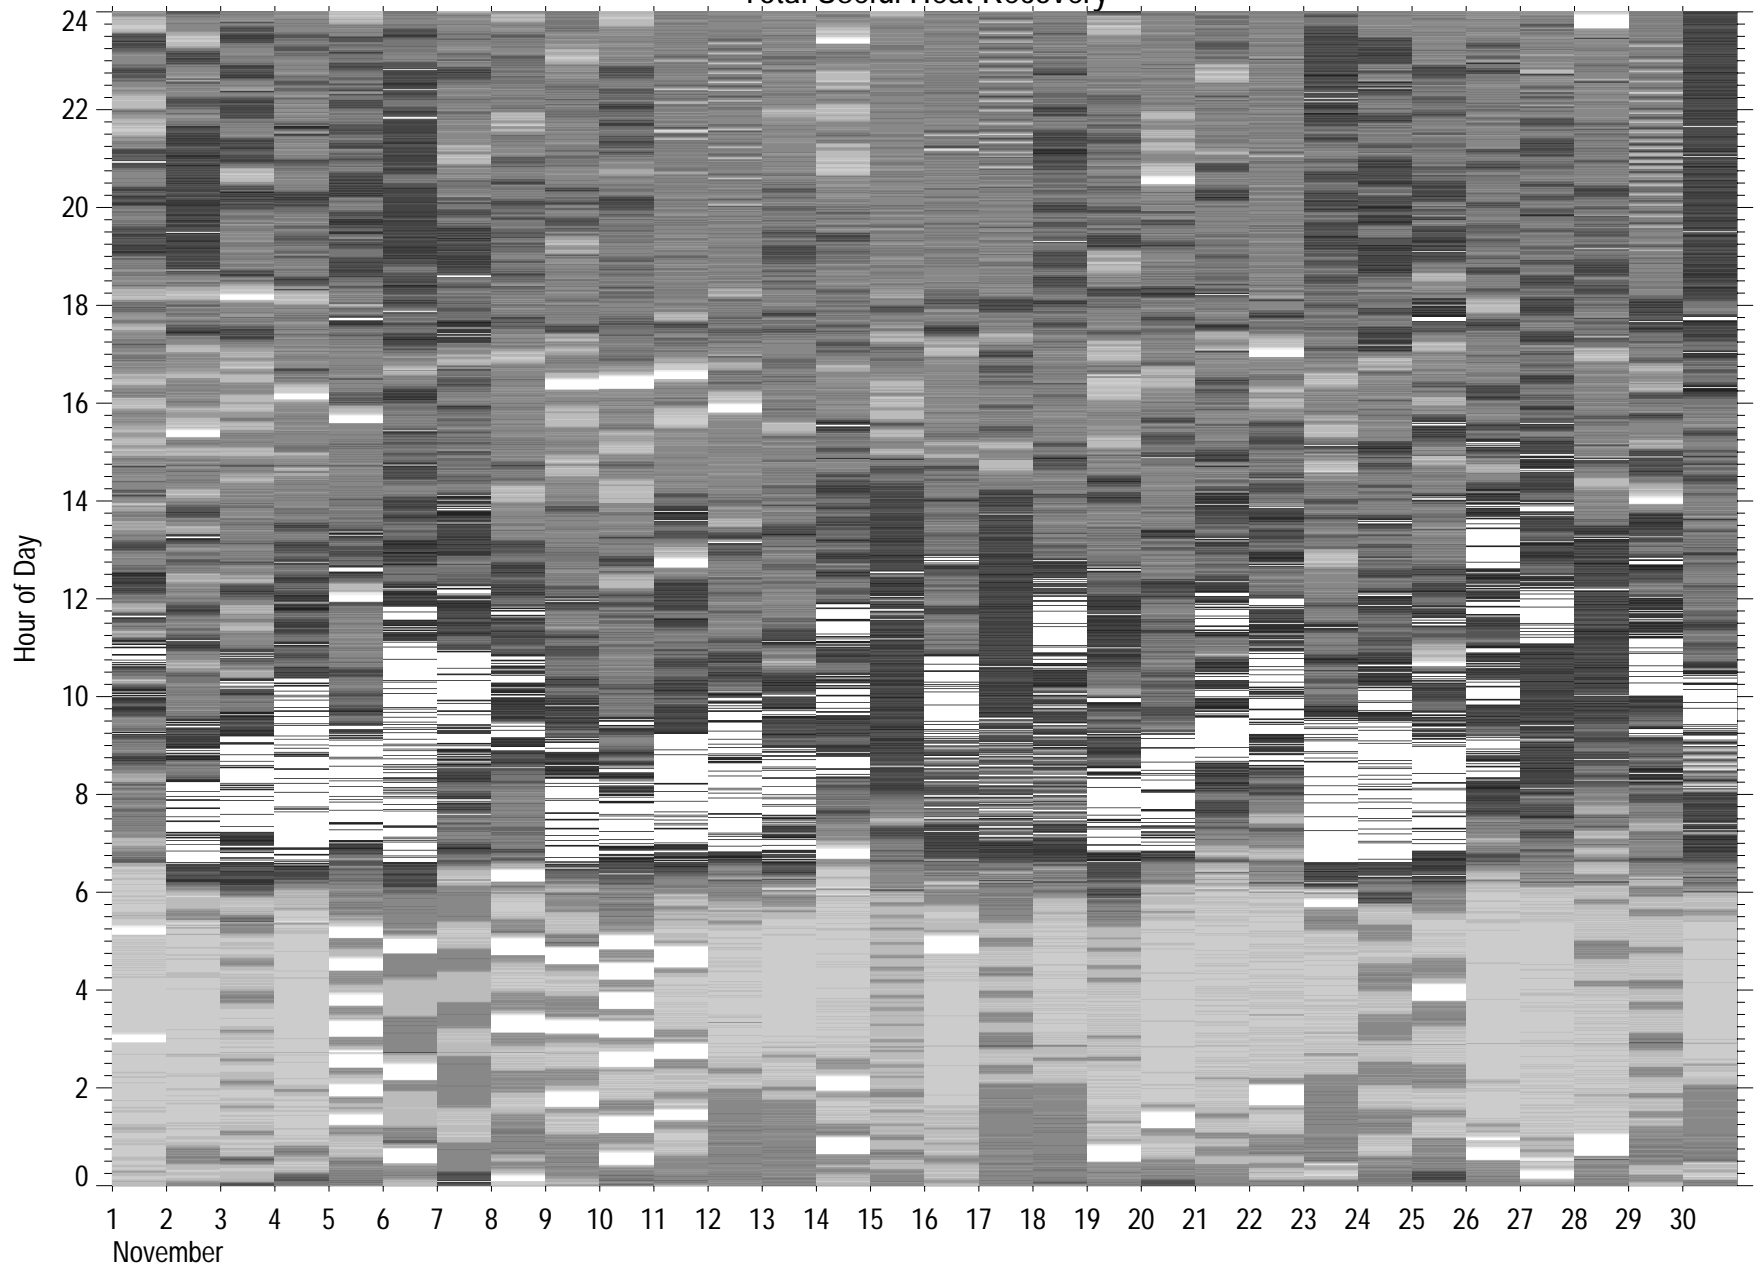

Day (MAX/MIN = 1499.75/ 0.00 MBtu)

# Total Unused Heat Recovery

