


GENERATOR RUNTIME, GAS USE AND HEAT RECOVERY SUMMARY

Schwab House - Aegis Energy


12/01/09 to 12/31/09

Date	Good Data (%)	Total Generator Runtime (hrs)	Other Facility Gas Use (cu ft)	Total Generator Gas Use (cu ft)	Total Useful Heat Recovery (MBtu)	Total Unused Heat Recovery (MBtu)	Percent Useful Heat Recovery (%)
12/01/09	97.55	23.67	n/a	0.00	22312.30	2899.24	88.50
12/02/09	93.15	23.20	n/a	0.00	18322.44	2935.62	86.19
12/03/09	95.51	23.28	n/a	0.00	16118.34	3144.91	83.67
12/04/09	56.67	14.58	n/a	0.00	8856.77	1933.95	82.08
12/05/09	28.26	0.00	n/a	0.00	-	-	-
12/06/09	33.33	0.00	n/a	0.00	-	-	-
12/07/09	84.19	20.22	n/a	0.00	17200.56	2451.15	87.53
12/08/09	92.11	23.88	n/a	0.00	20315.48	3006.93	87.11
12/09/09	93.50	23.68	n/a	0.00	18514.63	3069.92	85.78
12/10/09	92.80	24.00	n/a	0.00	19347.06	3152.87	85.99
12/11/09	87.57	23.65	n/a	0.00	17185.40	2860.00	85.73
12/12/09	89.31	24.00	n/a	0.00	18272.12	3116.54	85.43
12/13/09	89.49	24.00	n/a	0.00	18493.63	3030.52	85.92
12/14/09	92.71	24.00	n/a	0.00	19174.09	3057.78	86.25
12/15/09	91.67	24.00	n/a	0.00	19115.66	3256.56	85.44
12/16/09	85.56	23.77	n/a	0.00	13902.19	3183.32	81.37
12/17/09	85.02	24.00	n/a	0.00	15108.44	3263.53	82.24
12/18/09	11.23	2.77	n/a	0.00	3141.85	406.88	88.53
12/19/09	0.00	0.00	n/a	-	-	-	-
12/20/09	0.00	0.00	n/a	-	-	-	-
12/21/09	0.00	0.00	n/a	-	-	-	-
12/22/09	0.00	0.00	n/a	-	-	-	-
12/23/09	0.00	0.00	n/a	-	-	-	-
12/24/09	0.00	0.00	n/a	-	-	-	-
12/25/09	0.00	0.00	n/a	-	-	-	-
12/26/09	0.00	0.00	n/a	-	-	-	-
12/27/09	0.00	0.00	n/a	-	-	-	-
12/28/09	0.00	0.00	n/a	-	-	-	-
12/29/09	0.00	0.00	n/a	-	-	-	-
12/30/09	0.00	0.00	n/a	-	-	-	-
12/31/09	0.00	0.00	n/a	-	-	-	-
Total	45.15	346.70	n/a	0.00	265380.94	44769.71	85.57

Generator Energy Production

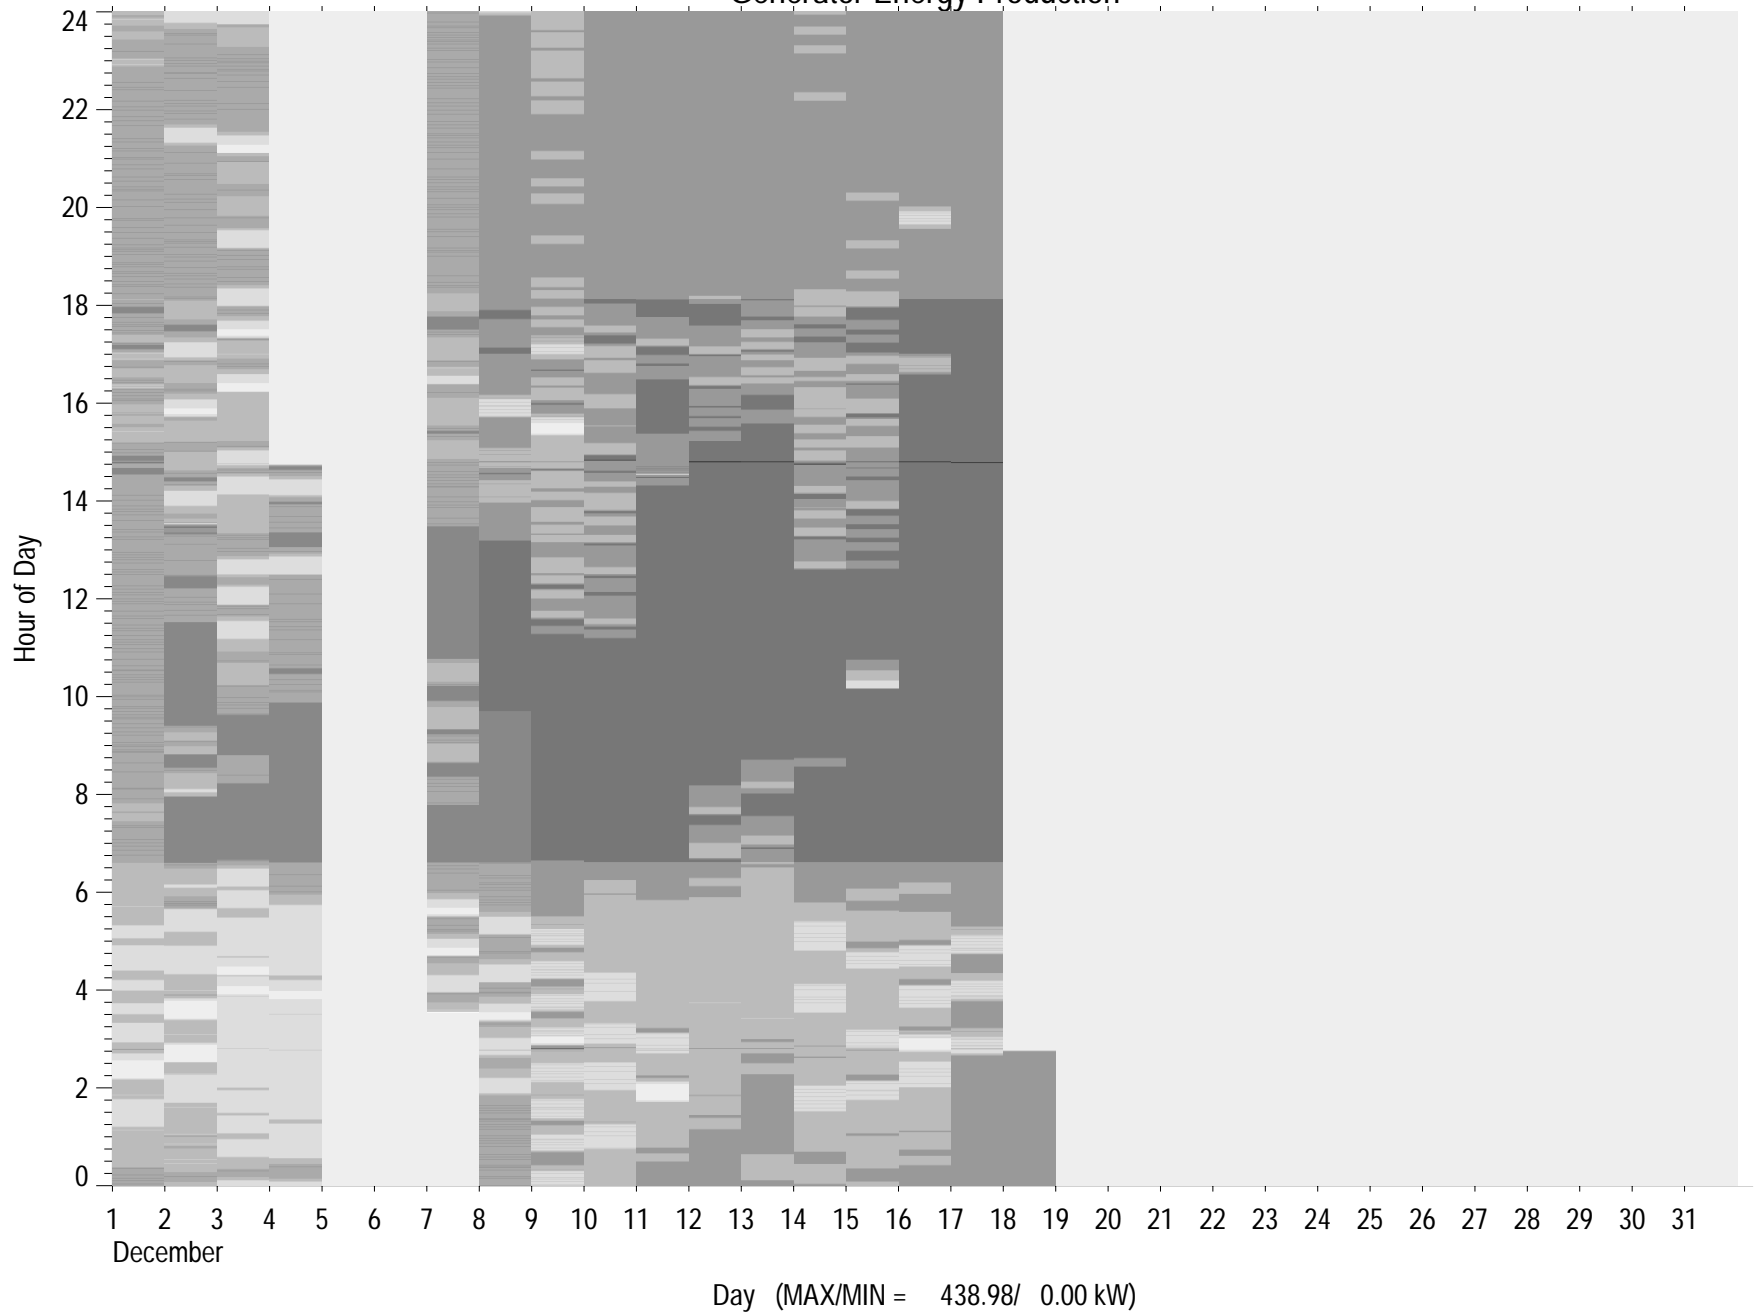

Generator Gas Use

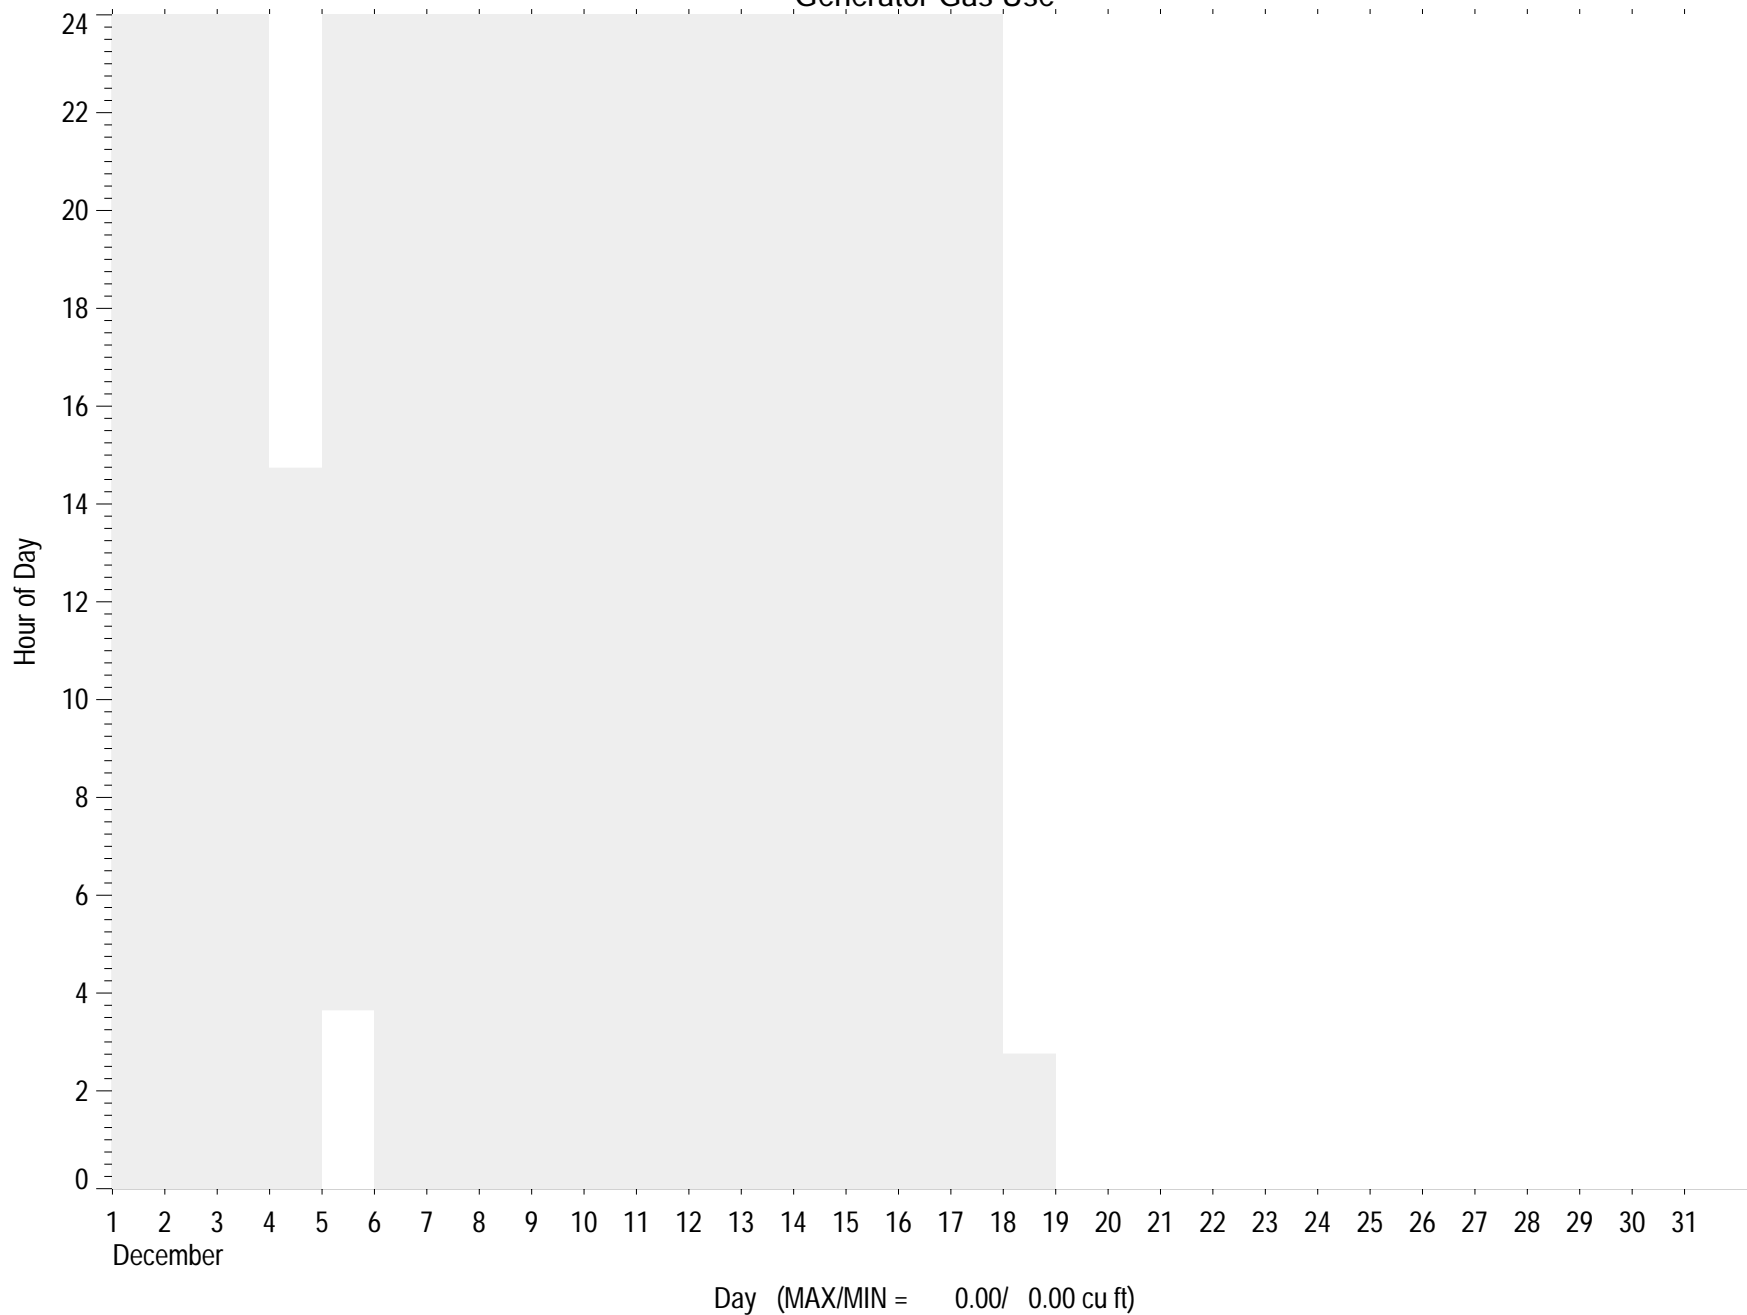

Day (MAX/MIN = 0.00/ 0.00 cu ft)

Total Unused Heat Recovery

