

GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

03/01/05 to 03/31/05

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	265.9	280.8	294.1	269.8	283.2	298.4	268.4	283.2	298.1	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	28.8	236.5	298.5
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

03/01/05 to 03/31/05

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
03/01/05	100.00	-	-	3337.00	-
03/02/05	100.00	-	-	3323.80	-
03/03/05	100.00	-	-	2677.60	-
03/04/05	100.00	-	-	3276.70	-
03/05/05	100.00	-	-	3135.30	-
03/06/05	100.00	-	-	0.00	-
03/07/05	98.96	-	-	2075.30	-
03/08/05	100.00	-	-	3222.00	-
03/09/05	100.00	-	-	3458.80	-
03/10/05	100.00	-	-	3076.90	-
03/11/05	100.00	-	-	3362.90	-
03/12/05	100.00	-	-	3195.70	-
03/13/05	100.00	-	-	0.00	-
03/14/05	100.00	-	-	3436.80	-
03/15/05	100.00	-	-	3394.70	-
03/16/05	100.00	-	-	3659.10	-
03/17/05	0.00	-	-	-	-
03/18/05	100.00	-	-	3083.70	-
03/19/05	51.04	-	-	2571.10	-
03/20/05	0.00	-	-	-	-
03/21/05	98.96	-	-	1330.30	-
03/22/05	100.00	-	-	3407.70	-
03/23/05	100.00	-	-	3478.40	-
03/24/05	100.00	-	-	2877.60	-
03/25/05	100.00	-	-	3311.60	-
03/26/05	100.00	-	-	3151.30	-
03/27/05	100.00	-	-	0.00	-
03/28/05	100.00	-	-	3681.80	-
03/29/05	100.00	-	-	3554.00	-
03/30/05	100.00	-	-	3276.40	-
03/31/05	100.00	-	-	3071.90	-
Total	91.90	-	-	81428.40	-

Generator Output Power

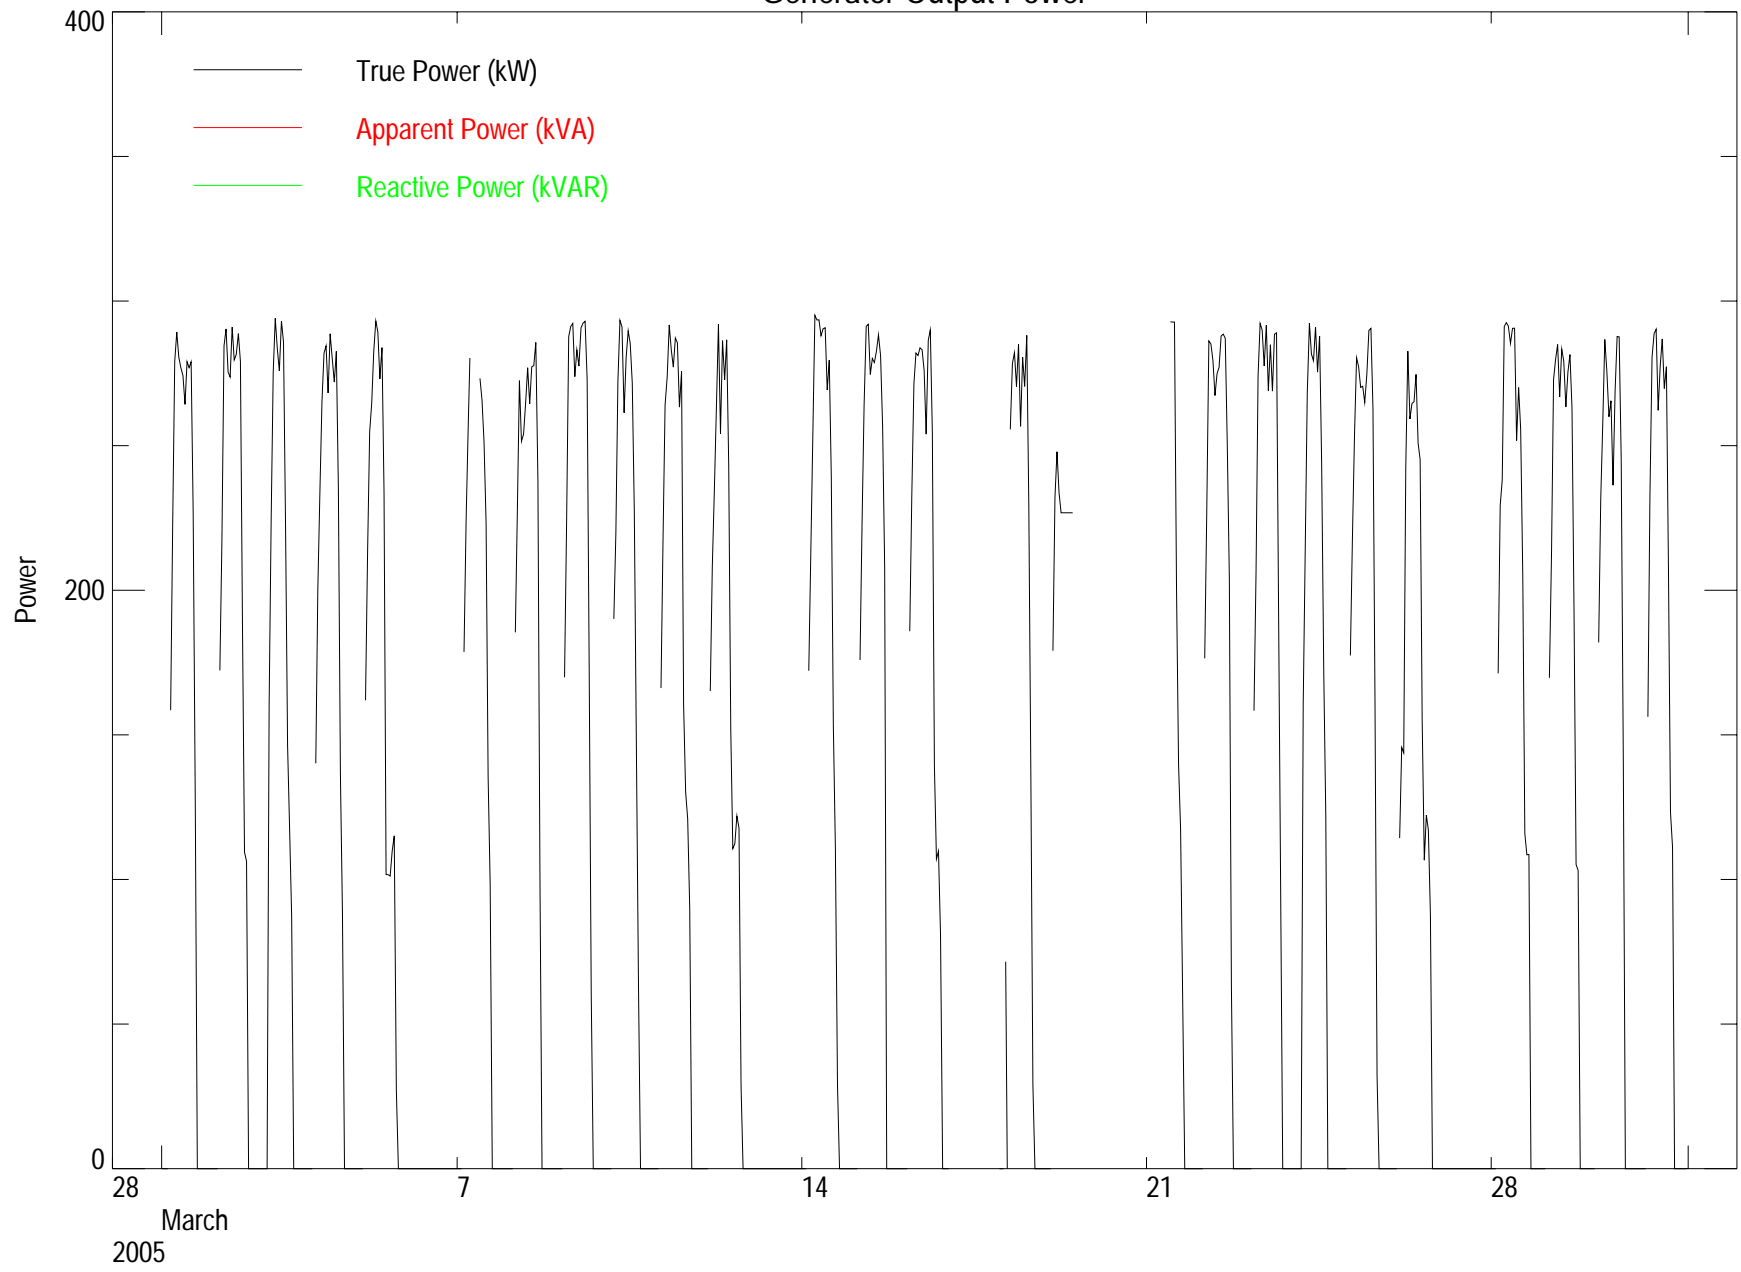

Generator Output Voltage

