

## GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

04/01/05 to 04/30/05

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	265.4	281.4	292.1	267.1	283.4	296.9	268.1	283.7	294.9	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	24.7	237.9	296.6
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


# GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

04/01/05 to 04/30/05

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
04/01/05	100.00	-	-	3102.50	-
04/02/05	3.13	-	-	0.00	-
04/03/05	100.00	-	-	0.00	-
04/04/05	100.00	-	-	3140.10	-
04/05/05	100.00	-	-	3353.50	-
04/06/05	100.00	-	-	3373.20	-
04/07/05	100.00	-	-	2877.60	-
04/08/05	100.00	-	-	3119.30	-
04/09/05	67.71	-	-	3152.60	-
04/10/05	100.00	-	-	0.00	-
04/11/05	100.00	-	-	3612.40	-
04/12/05	100.00	-	-	3491.20	-
04/13/05	100.00	-	-	3511.10	-
04/14/05	100.00	-	-	3030.20	-
04/15/05	100.00	-	-	3784.60	-
04/16/05	100.00	-	-	3512.70	-
04/17/05	100.00	-	-	0.00	-
04/18/05	100.00	-	-	3384.60	-
04/19/05	100.00	-	-	3628.10	-
04/20/05	100.00	-	-	3582.30	-
04/21/05	100.00	-	-	3090.90	-
04/22/05	100.00	-	-	3693.80	-
04/23/05	100.00	-	-	3590.20	-
04/24/05	100.00	-	-	0.00	-
04/25/05	100.00	-	-	3753.80	-
04/26/05	100.00	-	-	3350.70	-
04/27/05	100.00	-	-	3494.20	-
04/28/05	100.00	-	-	3042.40	-
04/29/05	100.00	-	-	3475.70	-
04/30/05	95.83	-	-	3571.40	-
Total	95.56	-	-	84719.10	-

# Generator Output Power

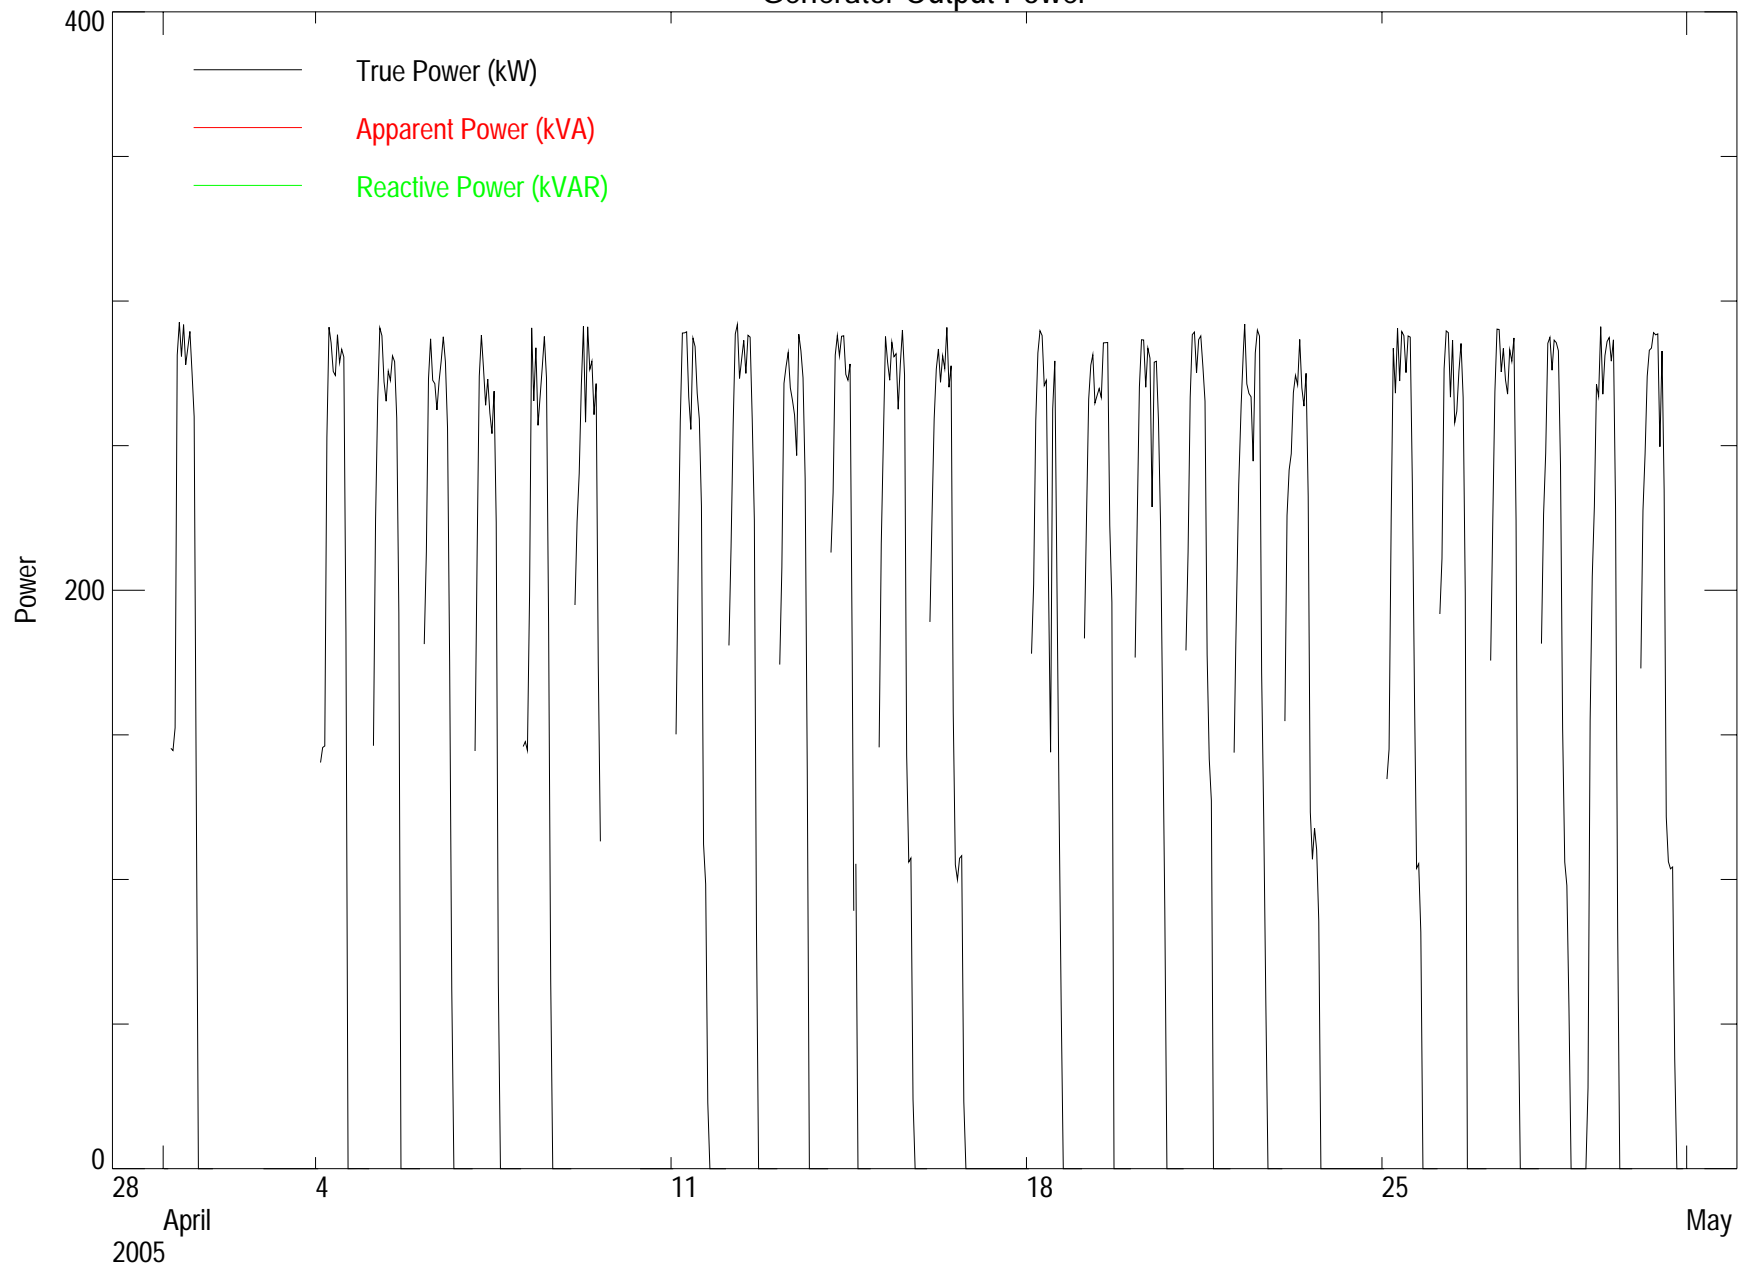

# Generator Output Voltage

