

GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

05/01/05 to 05/31/05

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	265.4	280.7	292.2	265.6	282.7	295.9	267.4	283.0	296.9	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	80.8	244.9	295.2
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

05/01/05 to 05/31/05

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
05/01/05	100.00	-	-	99.00	-
05/02/05	100.00	-	-	3757.70	-
05/03/05	100.00	-	-	3681.00	-
05/04/05	100.00	-	-	3530.60	-
05/05/05	100.00	-	-	3223.30	-
05/06/05	100.00	-	-	3634.70	-
05/07/05	100.00	-	-	4052.40	-
05/08/05	100.00	-	-	0.00	-
05/09/05	100.00	-	-	4459.80	-
05/10/05	100.00	-	-	3557.50	-
05/11/05	95.83	-	-	3563.00	-
05/12/05	4.17	-	-	99.00	-
05/13/05	95.83	-	-	3675.60	-
05/14/05	4.17	-	-	99.00	-
05/15/05	100.00	-	-	0.00	-
05/16/05	100.00	-	-	3822.70	-
05/17/05	100.00	-	-	3640.80	-
05/18/05	100.00	-	-	3534.60	-
05/19/05	100.00	-	-	3219.80	-
05/20/05	100.00	-	-	3717.30	-
05/21/05	100.00	-	-	3284.80	-
05/22/05	100.00	-	-	0.00	-
05/23/05	100.00	-	-	3880.30	-
05/24/05	100.00	-	-	3666.60	-
05/25/05	100.00	-	-	3897.00	-
05/26/05	100.00	-	-	3414.50	-
05/27/05	100.00	-	-	3719.50	-
05/28/05	100.00	-	-	3565.20	-
05/29/05	100.00	-	-	0.00	-
05/30/05	100.00	-	-	3371.00	-
05/31/05	95.83	-	-	3194.40	-
Total	93.41	-	-	87361.10	-

Generator Output Power

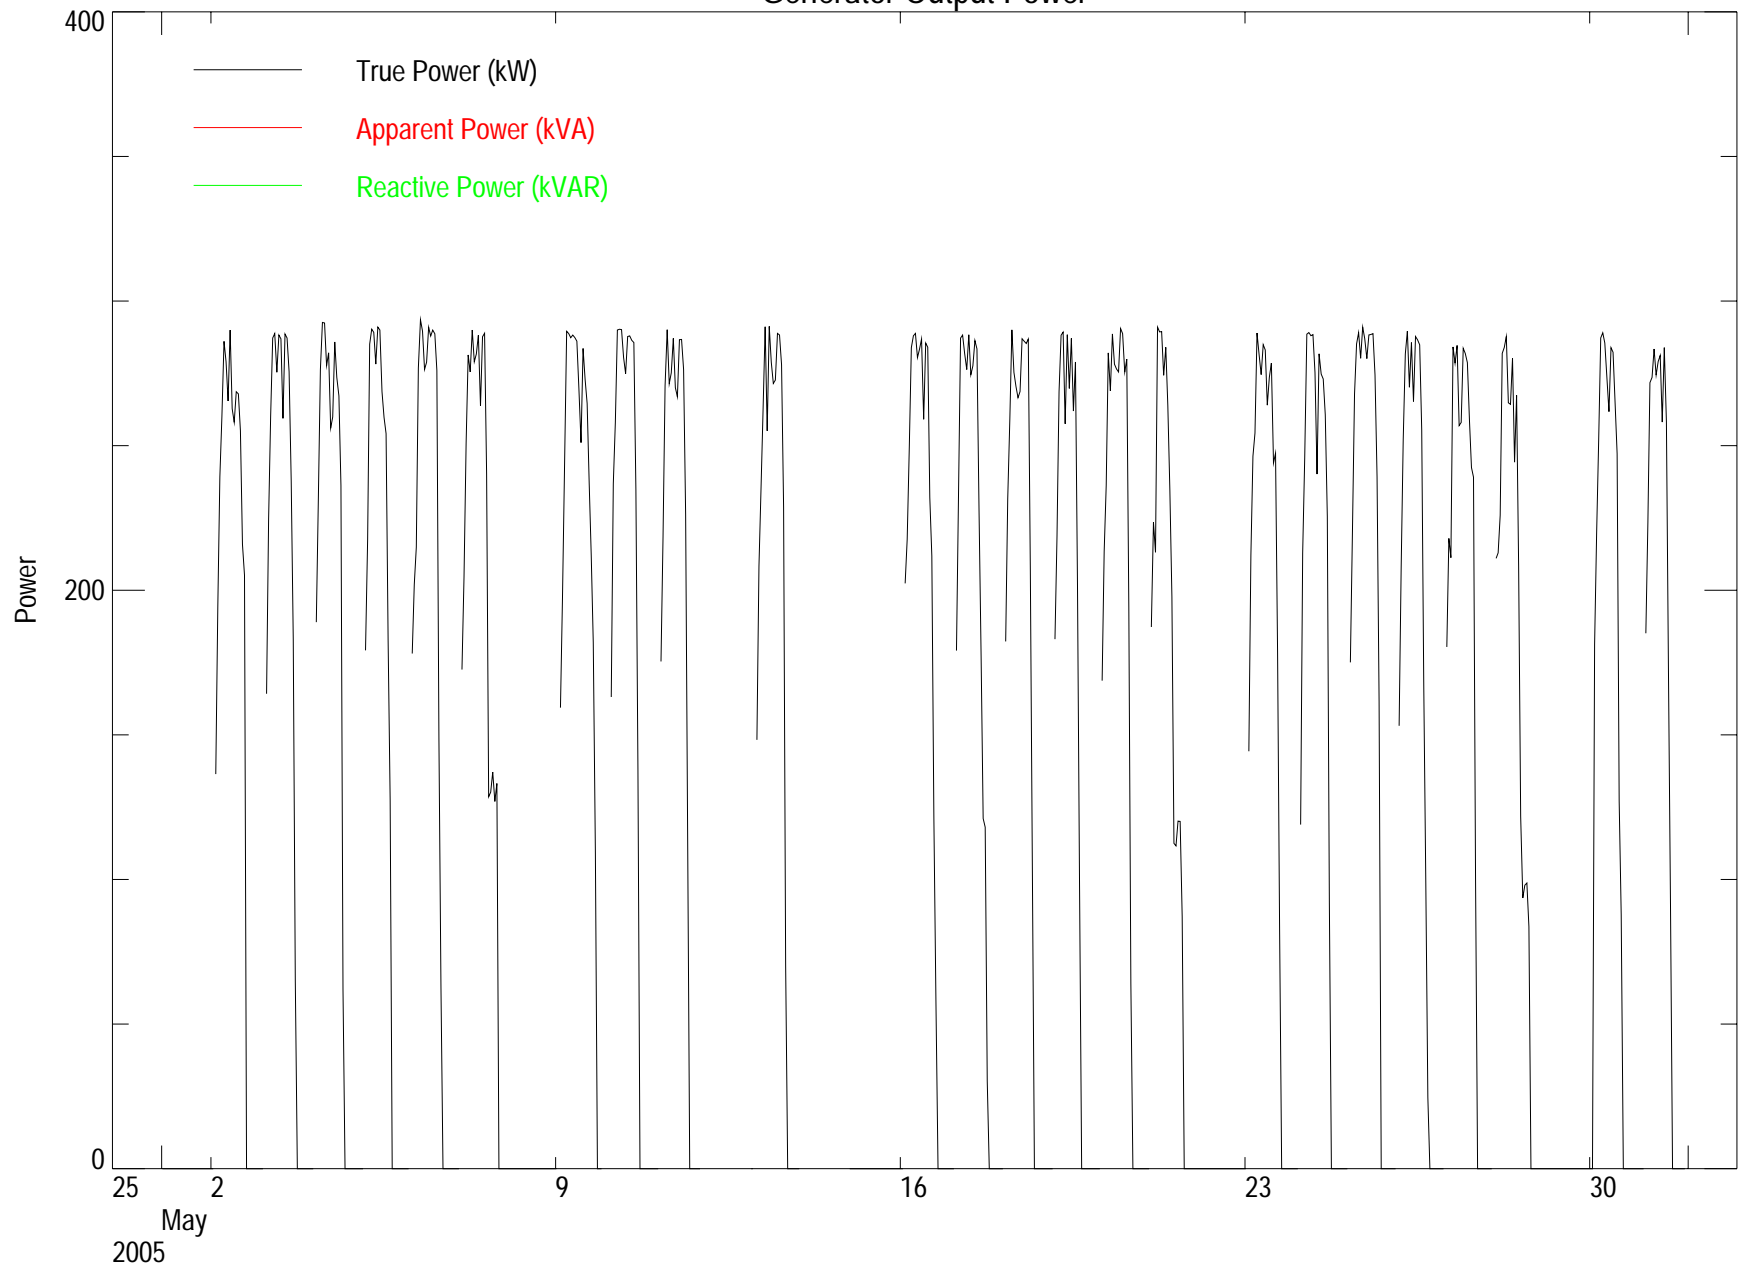

Generator Output Voltage

