

GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

06/01/05 to 06/30/05

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	250.9	279.9	294.5	251.4	281.7	295.6	251.7	282.5	296.4	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	20.0	240.5	292.6
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

06/01/05 to 06/30/05

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
06/01/05	100.00	-	-	3802.60	-
06/02/05	100.00	-	-	3300.00	-
06/03/05	100.00	-	-	3896.60	-
06/04/05	100.00	-	-	3564.40	-
06/05/05	100.00	-	-	0.00	-
06/06/05	100.00	-	-	3864.00	-
06/07/05	100.00	-	-	3644.70	-
06/08/05	100.00	-	-	3667.20	-
06/09/05	100.00	-	-	3228.90	-
06/10/05	100.00	-	-	3839.40	-
06/11/05	100.00	-	-	3773.60	-
06/12/05	100.00	-	-	0.00	-
06/13/05	100.00	-	-	3957.30	-
06/14/05	100.00	-	-	3519.70	-
06/15/05	100.00	-	-	2637.20	-
06/16/05	100.00	-	-	3476.60	-
06/17/05	100.00	-	-	3693.30	-
06/18/05	100.00	-	-	3873.40	-
06/19/05	100.00	-	-	0.00	-
06/20/05	100.00	-	-	3854.90	-
06/21/05	100.00	-	-	3652.70	-
06/22/05	100.00	-	-	3907.70	-
06/23/05	100.00	-	-	3615.80	-
06/24/05	100.00	-	-	3932.30	-
06/25/05	100.00	-	-	3960.30	-
06/26/05	100.00	-	-	0.00	-
06/27/05	100.00	-	-	3944.20	-
06/28/05	100.00	-	-	3756.60	-
06/29/05	100.00	-	-	3612.00	-
06/30/05	95.83	-	-	3626.00	-
Total	99.86	-	-	95601.40	-

Generator Output Power

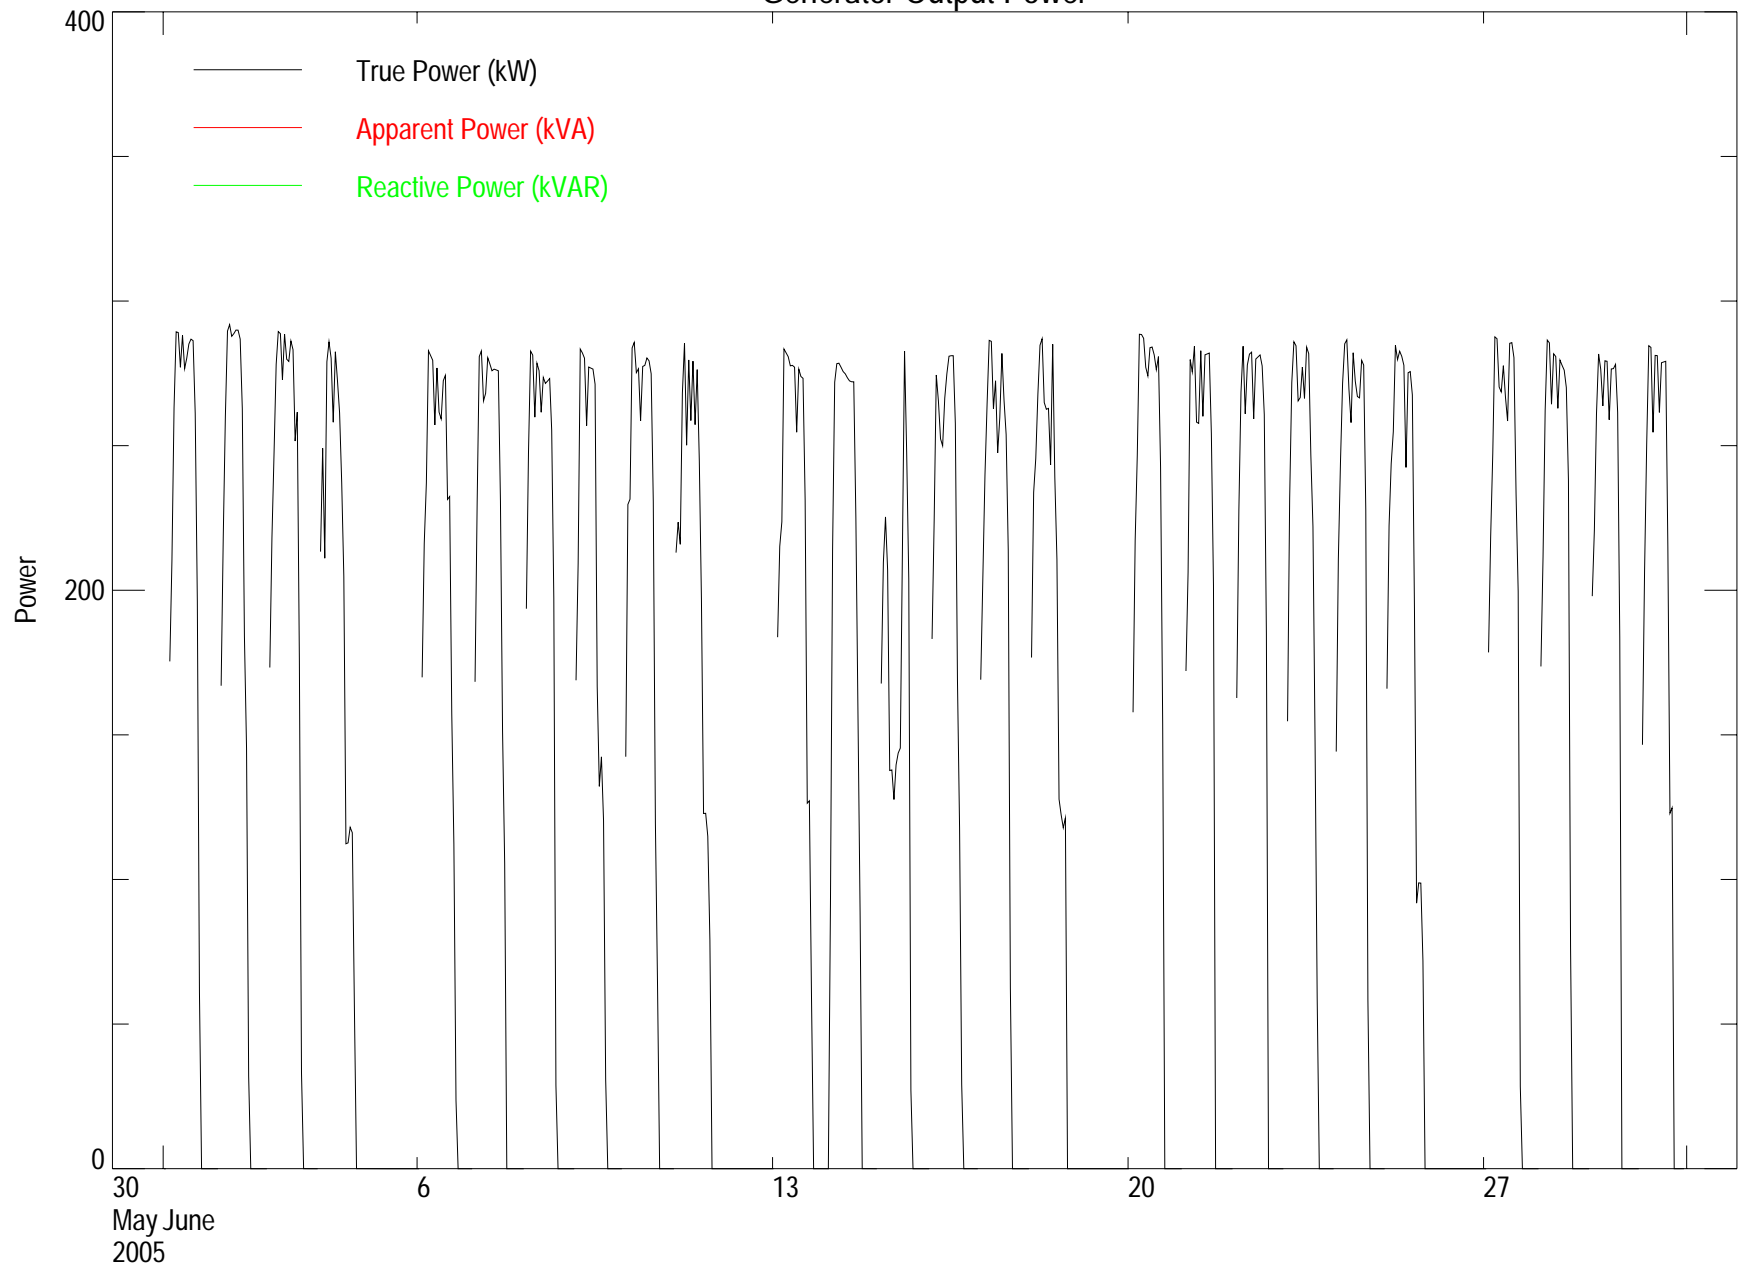

Generator Output Voltage

