

## GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

08/01/05 to 08/31/05

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	72.0	280.2	291.9	157.5	282.5	295.8	149.9	283.3	297.1	n/a	n/a	n/a
Current (amps)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	19.6	236.6	287.9
Apparent Power (kVA)	-	-	-	-	-	-	-	-	-	-	-	-
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Voltage THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Current THD (%)	-	-	-	-	-	-	-	-	-	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-


# GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

08/01/05 to 08/31/05

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
08/01/05	100.00	-	-	3616.90	-
08/02/05	100.00	-	-	3445.50	-
08/03/05	100.00	-	-	3580.40	-
08/04/05	100.00	-	-	2916.70	-
08/05/05	100.00	-	-	3408.40	-
08/06/05	100.00	-	-	3722.80	-
08/07/05	100.00	-	-	0.00	-
08/08/05	100.00	-	-	3529.80	-
08/09/05	100.00	-	-	3380.90	-
08/10/05	100.00	-	-	3263.70	-
08/11/05	100.00	-	-	2965.90	-
08/12/05	100.00	-	-	3412.10	-
08/13/05	100.00	-	-	3346.30	-
08/14/05	100.00	-	-	0.00	-
08/15/05	100.00	-	-	3462.40	-
08/16/05	100.00	-	-	3463.80	-
08/17/05	100.00	-	-	3331.40	-
08/18/05	100.00	-	-	3109.90	-
08/19/05	100.00	-	-	3686.50	-
08/20/05	95.83	-	-	3608.30	-
08/21/05	4.17	-	-	99.00	-
08/22/05	100.00	-	-	3629.40	-
08/23/05	100.00	-	-	2477.90	-
08/24/05	100.00	-	-	3340.50	-
08/25/05	100.00	-	-	2993.70	-
08/26/05	100.00	-	-	3313.20	-
08/27/05	100.00	-	-	3027.90	-
08/28/05	100.00	-	-	0.00	-
08/29/05	100.00	-	-	2388.10	-
08/30/05	100.00	-	-	3411.20	-
08/31/05	95.83	-	-	3250.40	-
Total	96.64	-	-	89183.00	-

# Generator Output Power

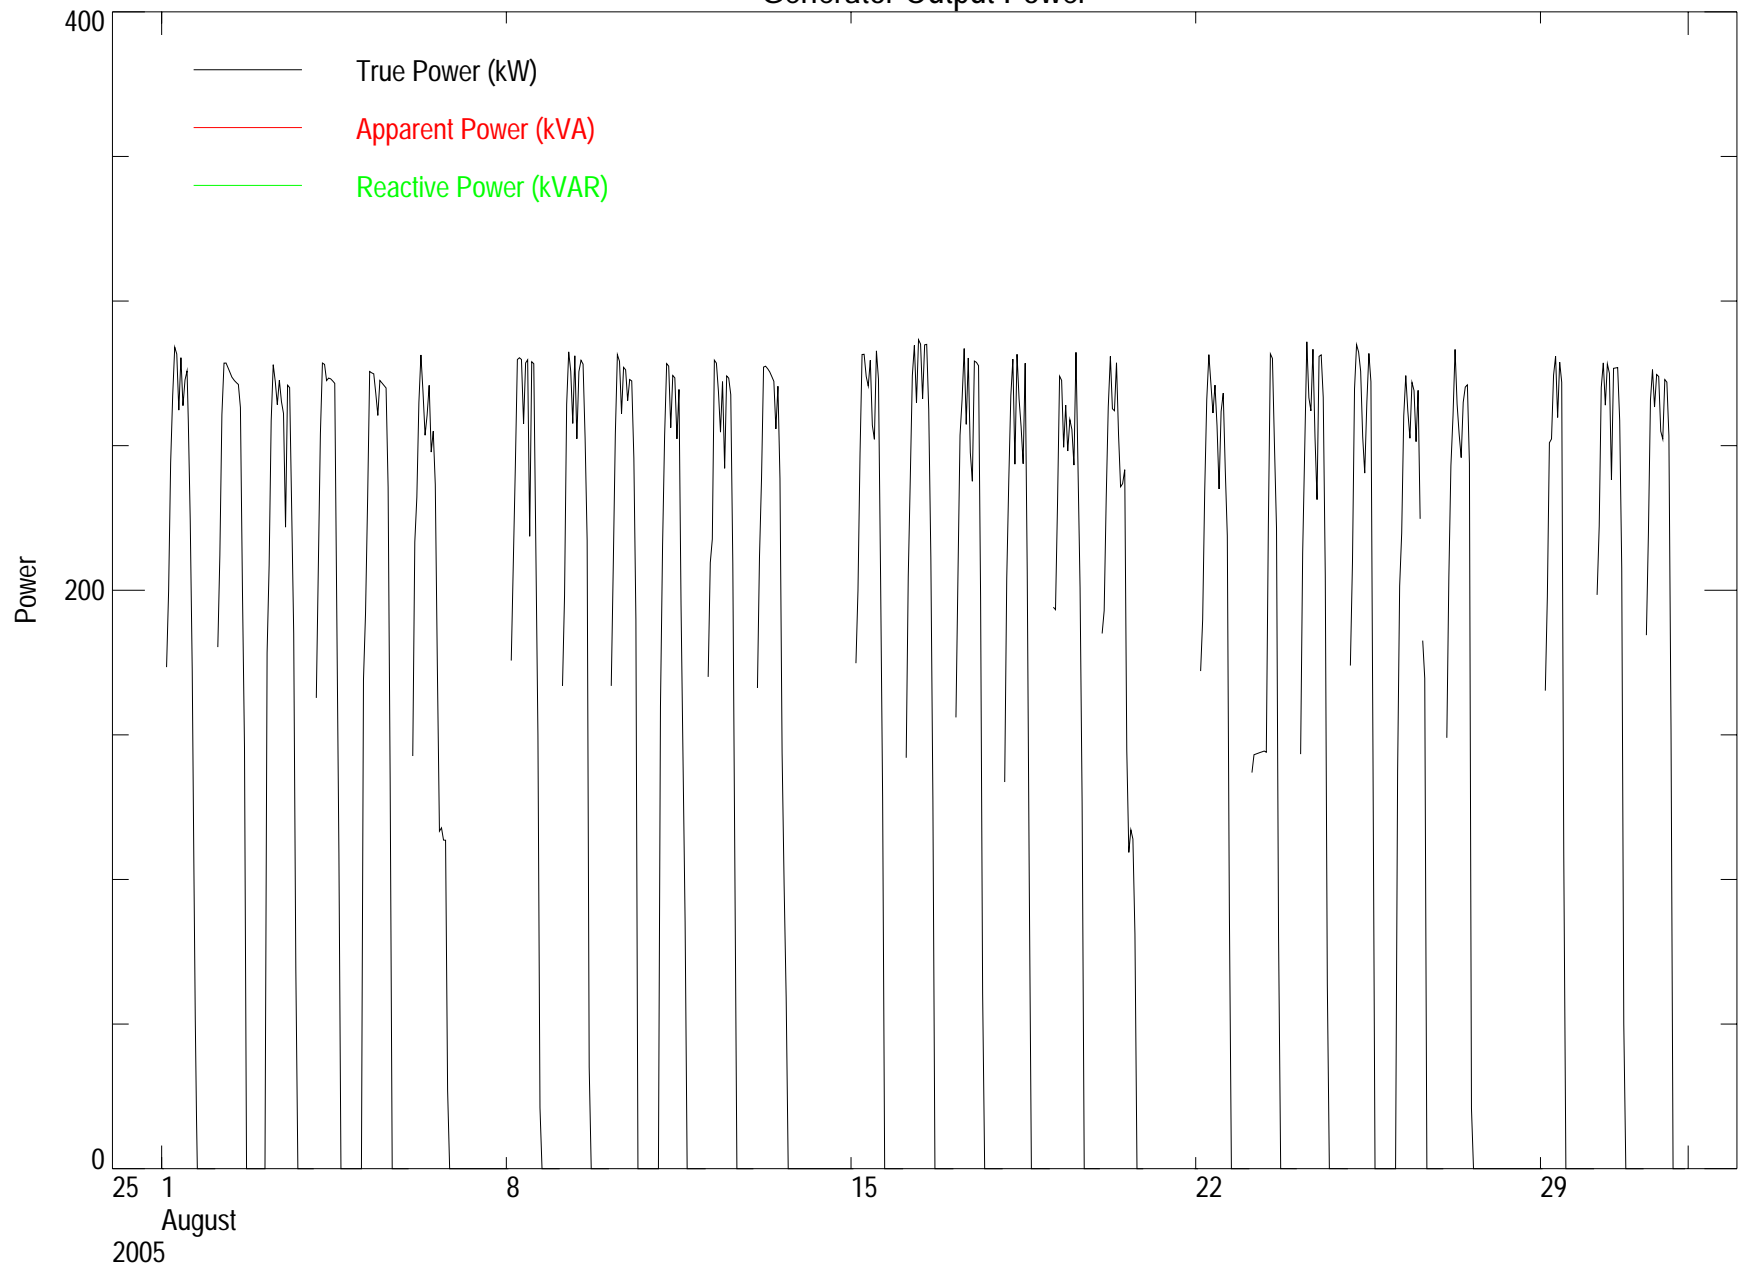

# Generator Output Voltage

