

GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen

01/01/09 to 05/31/09

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	263.1	264.5	290.2	264.8	266.3	292.9	265.1	266.5	293.0	n/a	n/a	n/a
Current (amps)	0.59	389.52	394.85	0.42	382.37	390.96	0.07	401.47	406.58	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	81.9	230.2	267.9
Apparent Power (kVA)	0.2	102.6	105.7	0.1	101.3	105.3	0.0	106.5	108.9	105.2	274.9	318.9
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.78	0.84	0.90
Voltage THD (%)	0.40	1.17	3.09	0.41	1.27	3.18	0.41	1.45	2.90	n/a	n/a	n/a
Current THD (%)	0.19	1.81	4.74	0.18	1.91	4.41	0.23	2.01	4.69	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	59.9	60.0	60.1


GENERATOR POWER QUALITY - DATA SUMMARY

Arrow Linen


01/01/09 to 05/31/09

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
Jan 2009	100.00	13264.06	109783.51	11206.20	0.84
Feb 2009	100.00	-	112761.60	0.00	-
Mar 2009	96.77	-	30707.25	99.00	-
Apr 2009	90.03	-	-	0.00	-
May 2009	0.00	-	-	-	-
Total	76.83	13264.06	253252.36	11305.20	0.85


Generator Output Power

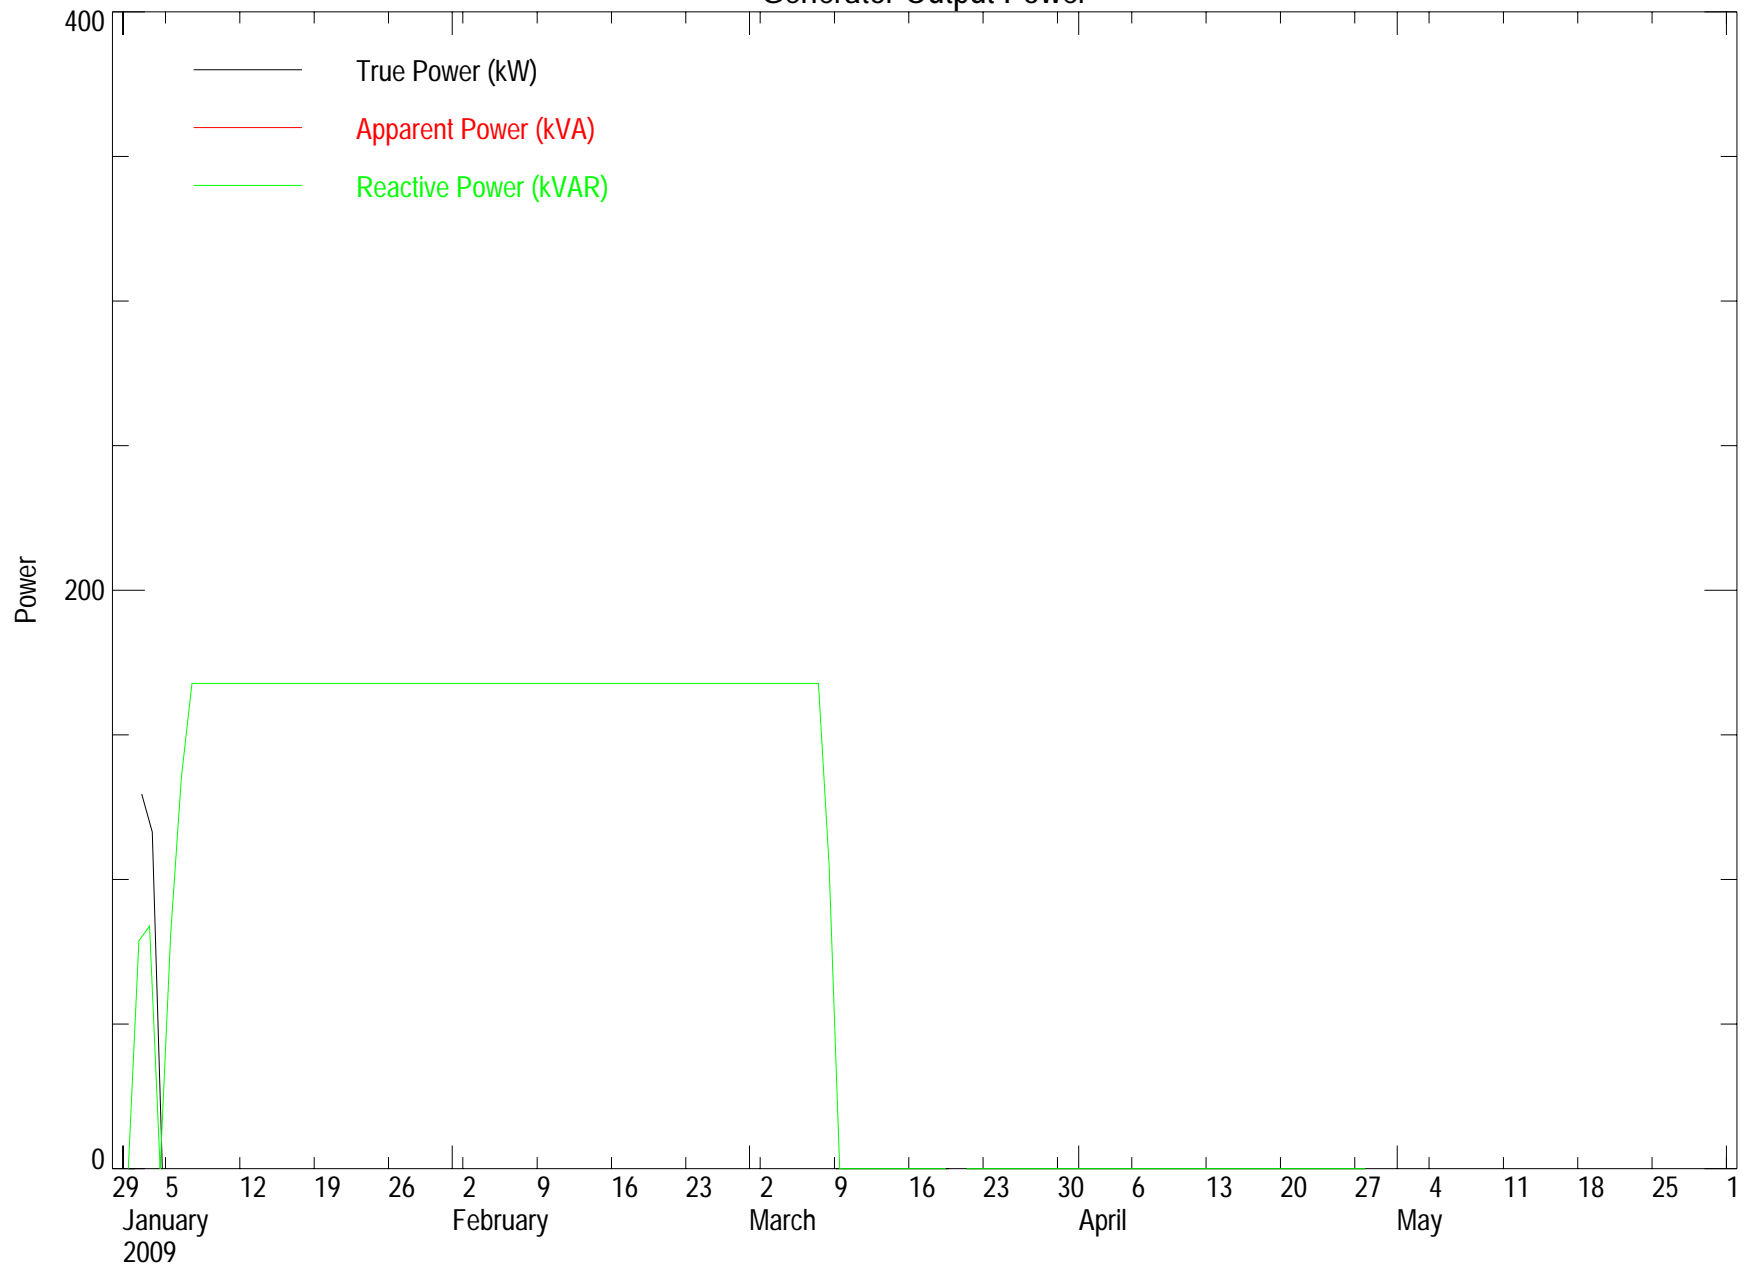


Generator Output Voltage

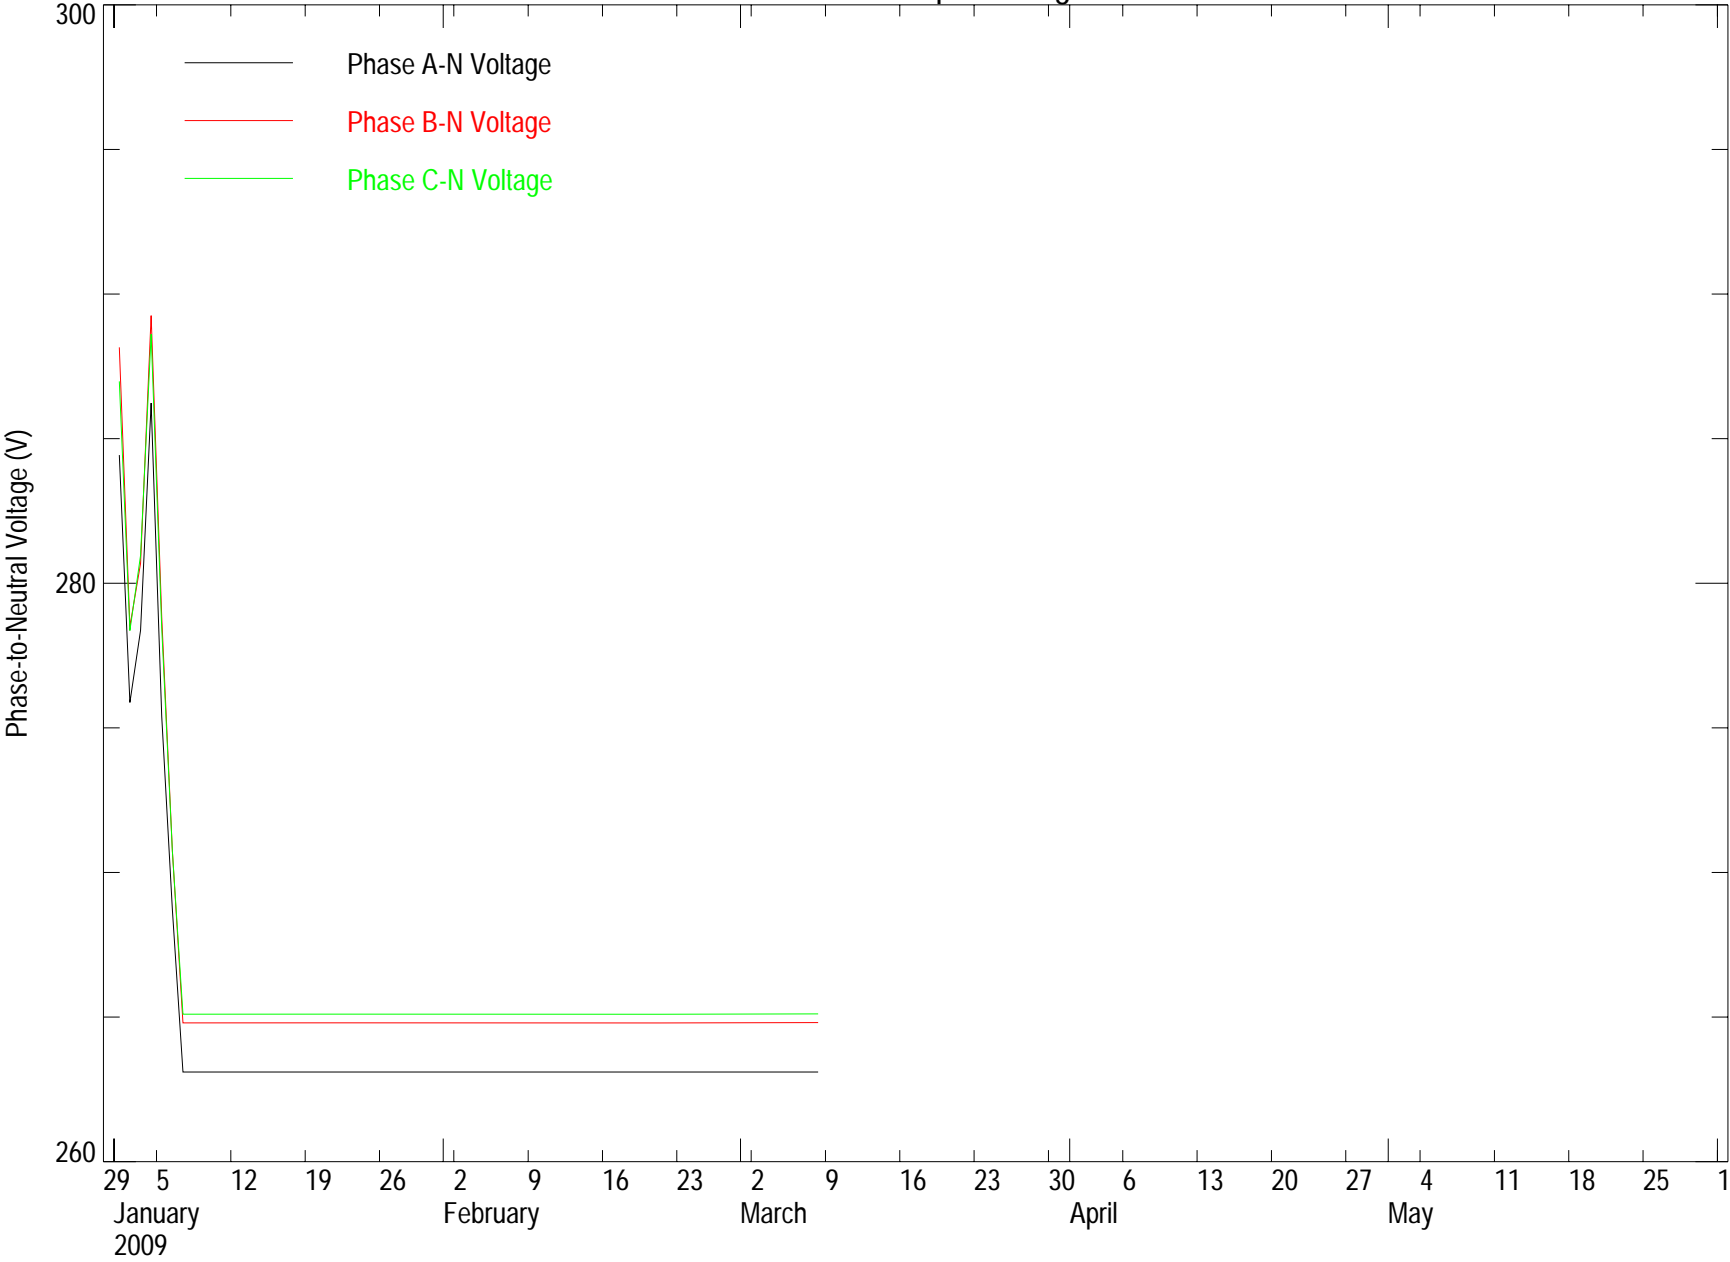


Generator Output Current

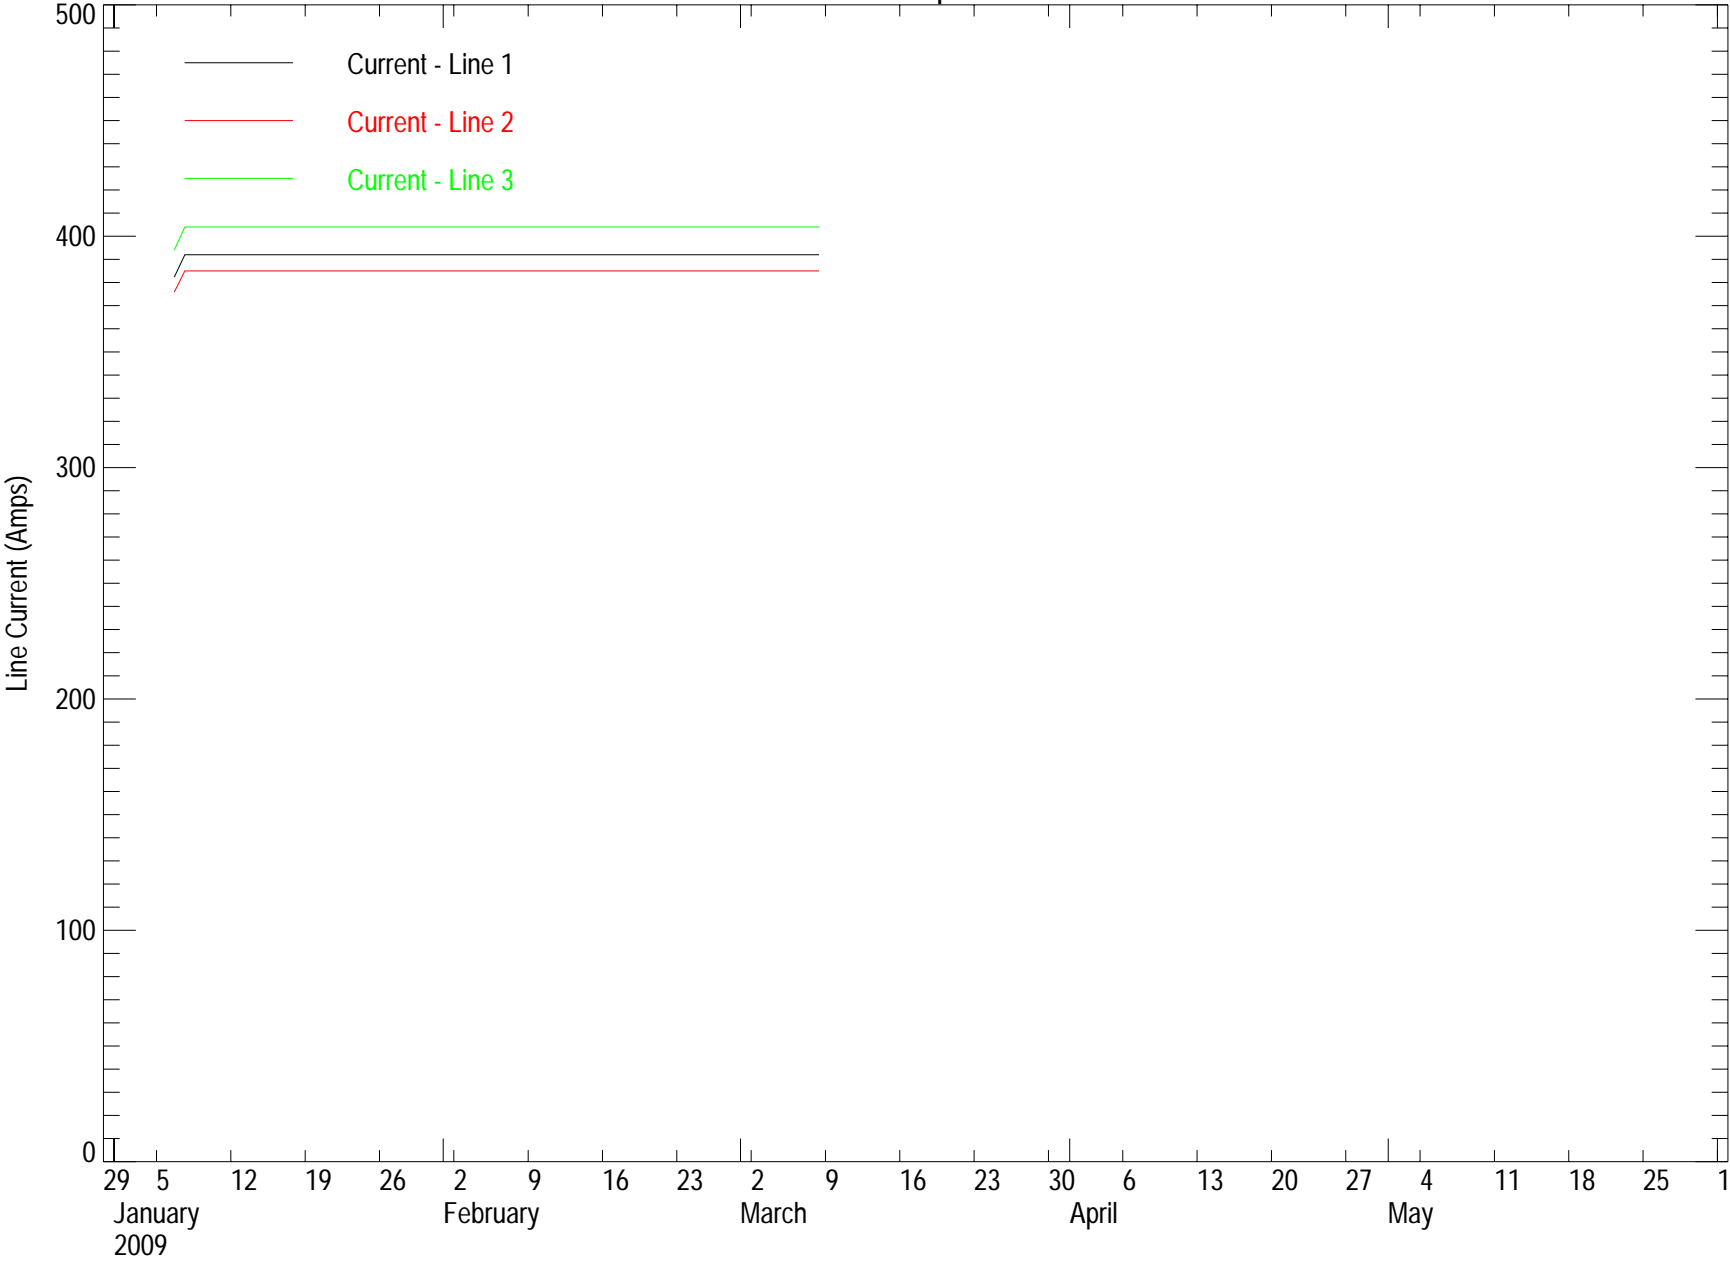

Generator Current Total Harmonic Distortion per Line

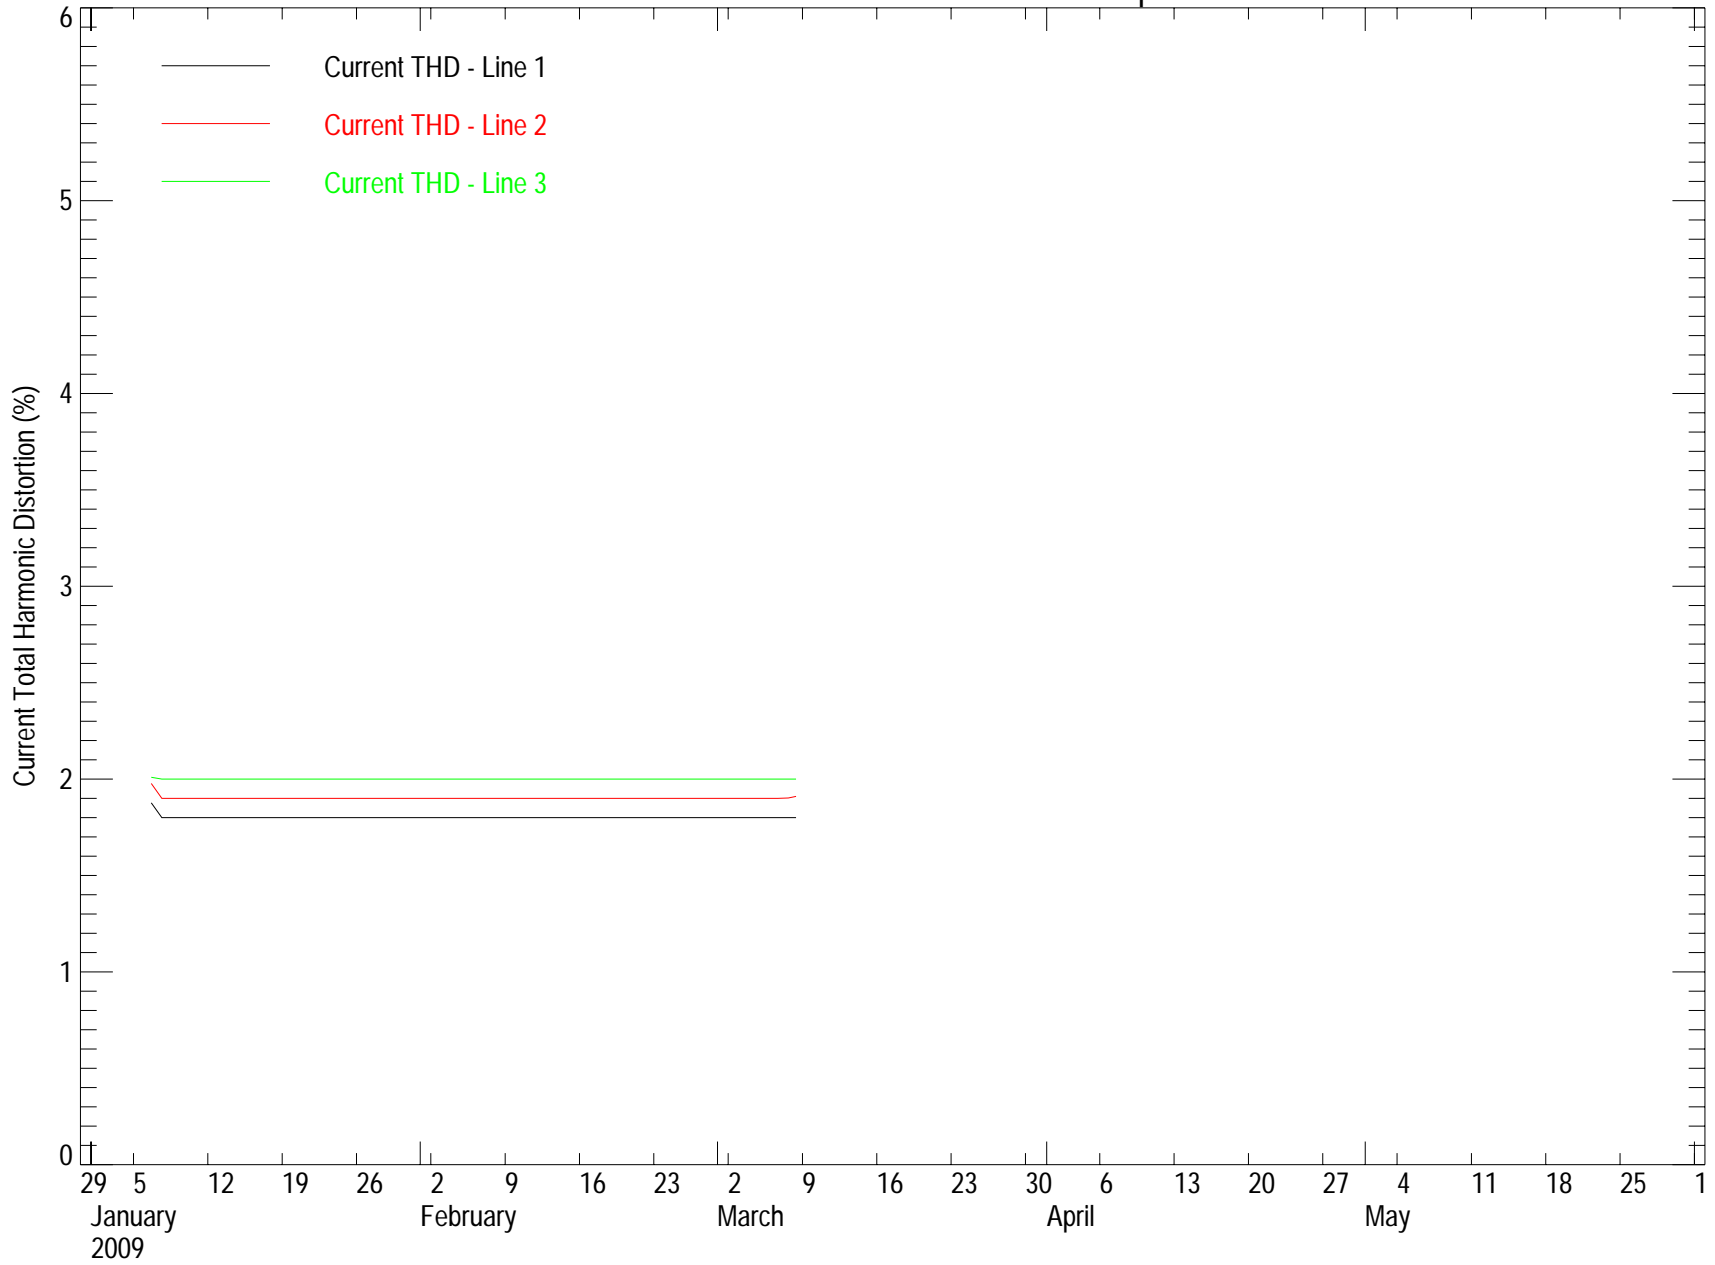

Generator Voltage Total Harmonic Distortion per Line

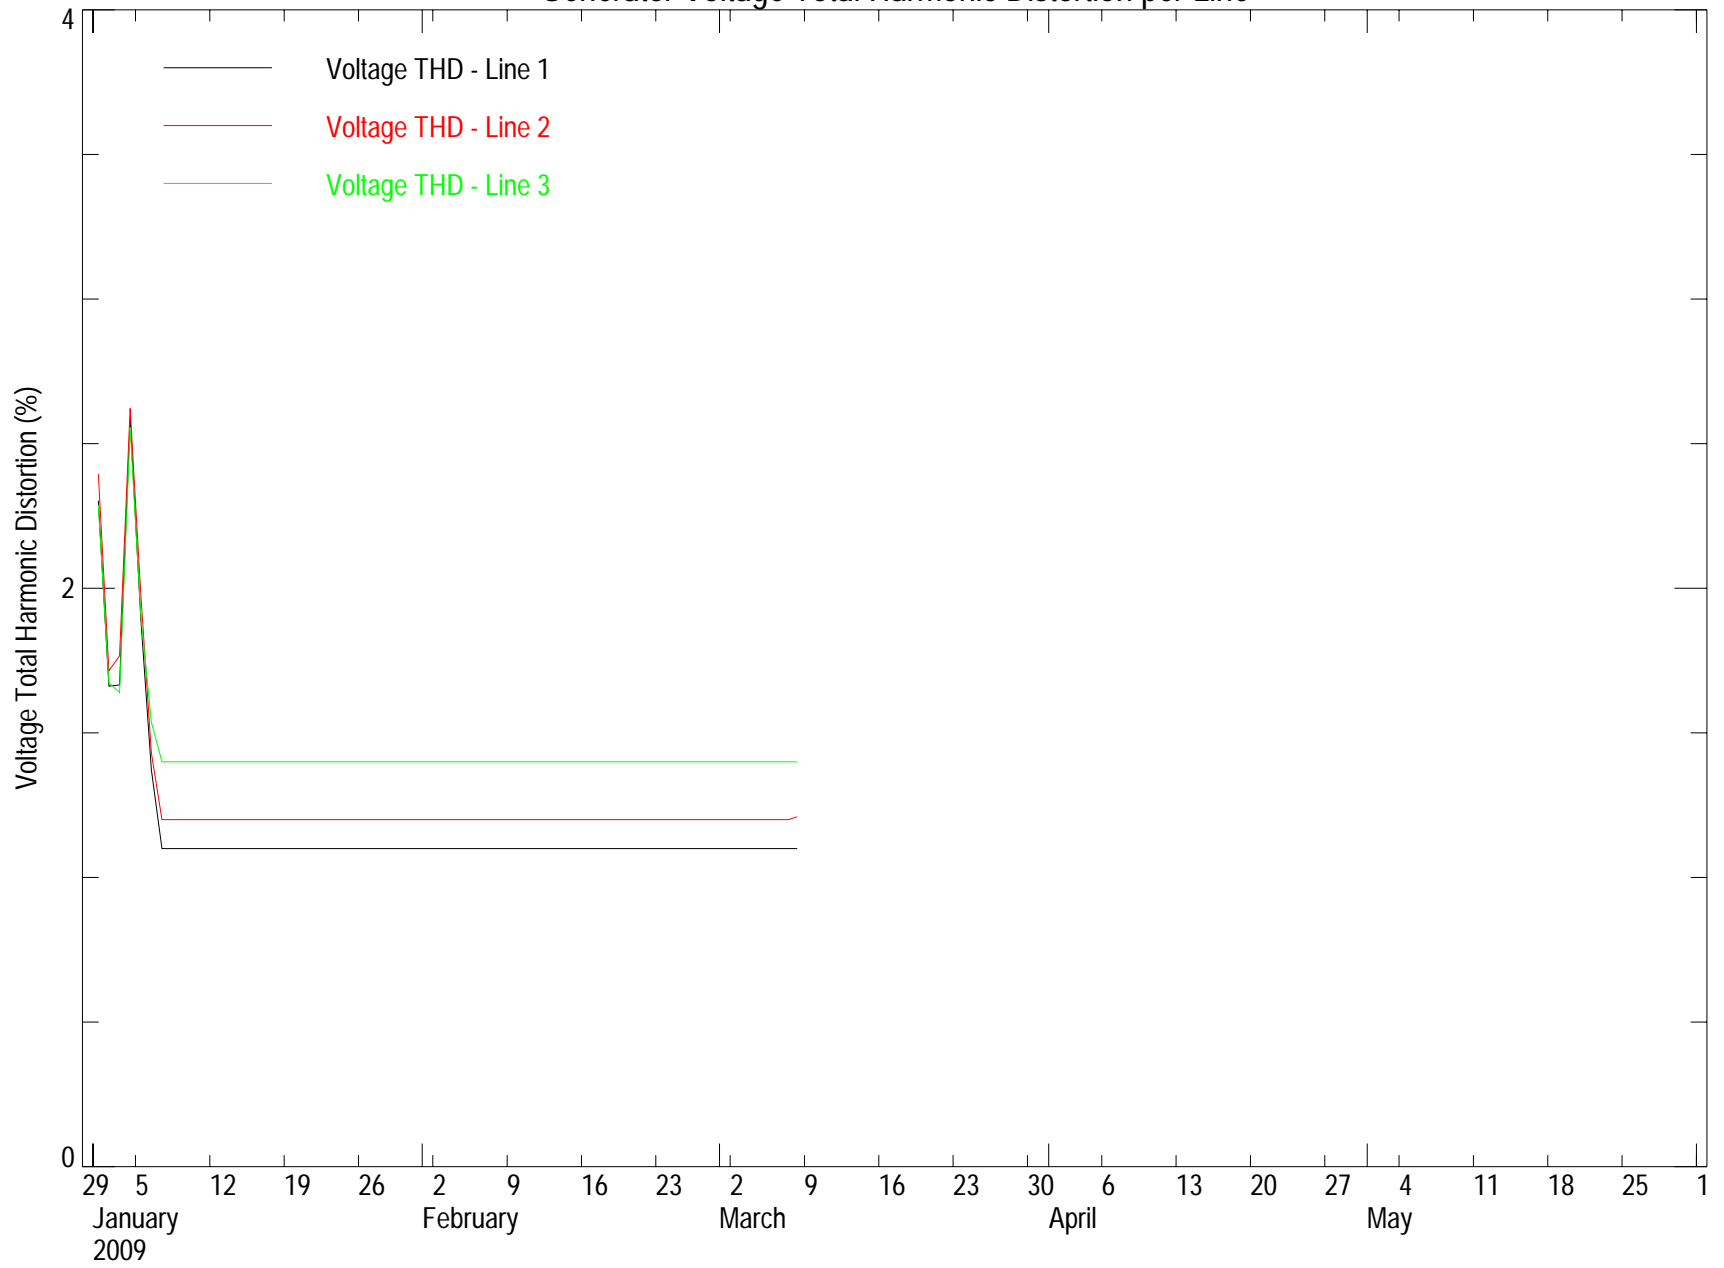

Generator Output Power Factor

