

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

11/01/05 to 11/30/05

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	94.80	102.73	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	4.4	62.9	68.3
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

11/01/05 to 11/30/05

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
11/01/05	0.00	n/a	n/a	-	n/a
11/02/05	0.00	n/a	n/a	-	n/a
11/03/05	0.00	n/a	n/a	-	n/a
11/04/05	0.00	n/a	n/a	-	n/a
11/05/05	0.00	n/a	n/a	-	n/a
11/06/05	0.00	n/a	n/a	-	n/a
11/07/05	0.00	n/a	n/a	-	n/a
11/08/05	0.00	n/a	n/a	-	n/a
11/09/05	0.00	n/a	n/a	-	n/a
11/10/05	0.00	n/a	n/a	-	n/a
11/11/05	0.00	n/a	n/a	-	n/a
11/12/05	0.00	n/a	n/a	-	n/a
11/13/05	0.00	n/a	n/a	-	n/a
11/14/05	0.00	n/a	n/a	-	n/a
11/15/05	0.00	n/a	n/a	-	n/a
11/16/05	0.00	n/a	n/a	-	n/a
11/17/05	0.00	n/a	n/a	-	n/a
11/18/05	100.00	n/a	n/a	1516.26	n/a
11/19/05	100.00	n/a	n/a	1491.62	n/a
11/20/05	100.00	n/a	n/a	1129.66	n/a
11/21/05	100.00	n/a	n/a	0.00	n/a
11/22/05	100.00	n/a	n/a	746.85	n/a
11/23/05	100.00	n/a	n/a	1523.89	n/a
11/24/05	100.00	n/a	n/a	1525.72	n/a
11/25/05	100.00	n/a	n/a	1596.77	n/a
11/26/05	100.00	n/a	n/a	1490.02	n/a
11/27/05	100.00	n/a	n/a	0.00	n/a
11/28/05	100.00	n/a	n/a	868.94	n/a
11/29/05	100.00	n/a	n/a	1483.01	n/a
11/30/05	100.00	n/a	n/a	1432.44	n/a
Total	43.33	n/a	n/a	14805.17	n/a

Generator Output Power

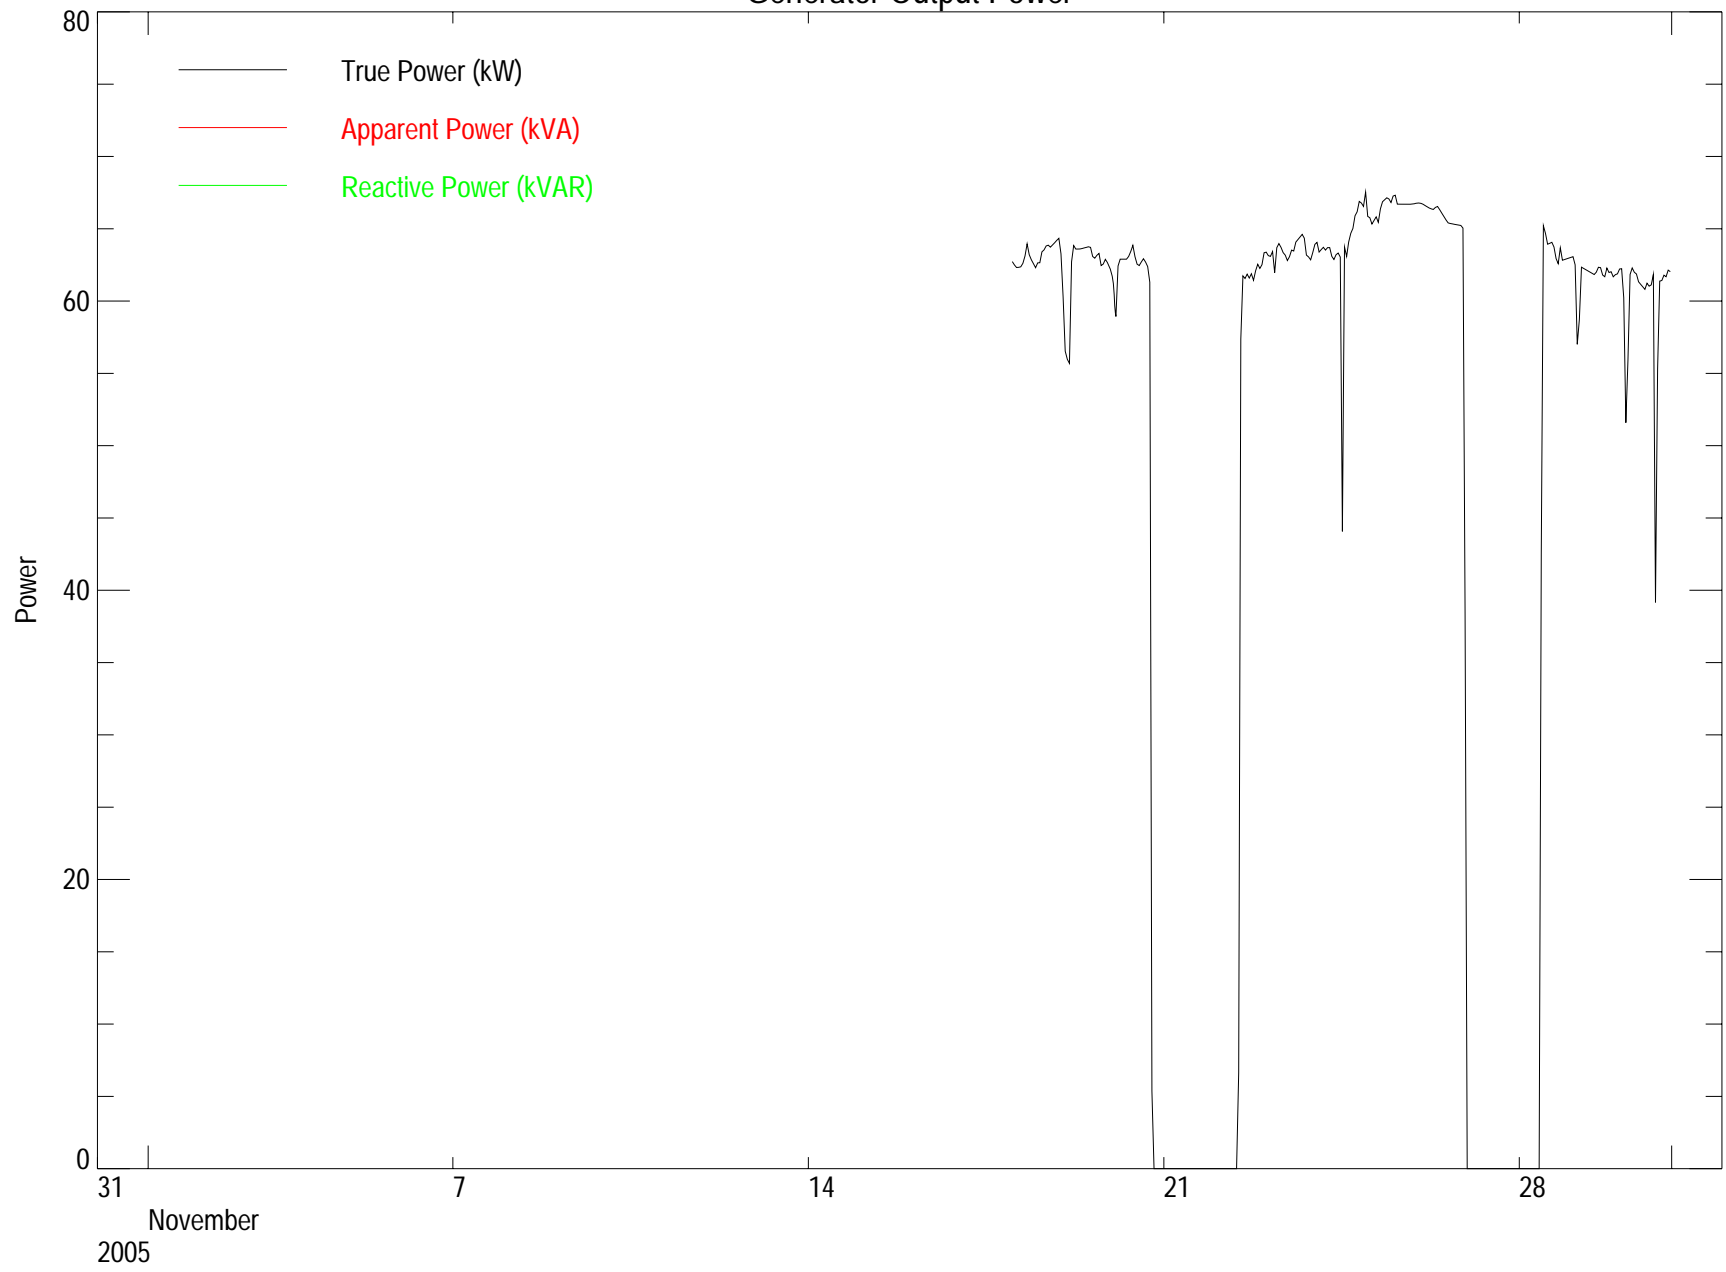

Generator Output Current

