

## GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

02/01/06 to 02/28/06

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	96.81	106.17	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	3.1	65.7	70.1
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


## GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

02/01/06 to 02/28/06

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
02/01/06	100.00	n/a	n/a	1464.33	n/a
02/02/06	100.00	n/a	n/a	1481.86	n/a
02/03/06	100.00	n/a	n/a	1475.92	n/a
02/04/06	21.88	n/a	n/a	300.14	n/a
02/05/06	0.00	n/a	n/a	-	n/a
02/06/06	0.00	n/a	n/a	-	n/a
02/07/06	0.00	n/a	n/a	-	n/a
02/08/06	100.00	n/a	n/a	1536.30	n/a
02/09/06	100.00	n/a	n/a	1533.48	n/a
02/10/06	100.00	n/a	n/a	1611.05	n/a
02/11/06	100.00	n/a	n/a	1607.03	n/a
02/12/06	100.00	n/a	n/a	1606.03	n/a
02/13/06	100.00	n/a	n/a	1642.13	n/a
02/14/06	100.00	n/a	n/a	1638.15	n/a
02/15/06	100.00	n/a	n/a	1612.15	n/a
02/16/06	100.00	n/a	n/a	1581.90	n/a
02/17/06	100.00	n/a	n/a	698.65	n/a
02/18/06	100.00	n/a	n/a	0.00	n/a
02/19/06	100.00	n/a	n/a	0.00	n/a
02/20/06	100.00	n/a	n/a	0.00	n/a
02/21/06	100.00	n/a	n/a	0.00	n/a
02/22/06	100.00	n/a	n/a	0.00	n/a
02/23/06	100.00	n/a	n/a	901.94	n/a
02/24/06	100.00	n/a	n/a	1612.50	n/a
02/25/06	100.00	n/a	n/a	1597.73	n/a
02/26/06	100.00	n/a	n/a	1615.42	n/a
02/27/06	100.00	n/a	n/a	1630.40	n/a
02/28/06	100.00	n/a	n/a	1625.76	n/a
Total	86.50	n/a	n/a	28772.86	n/a

# Generator Output Power

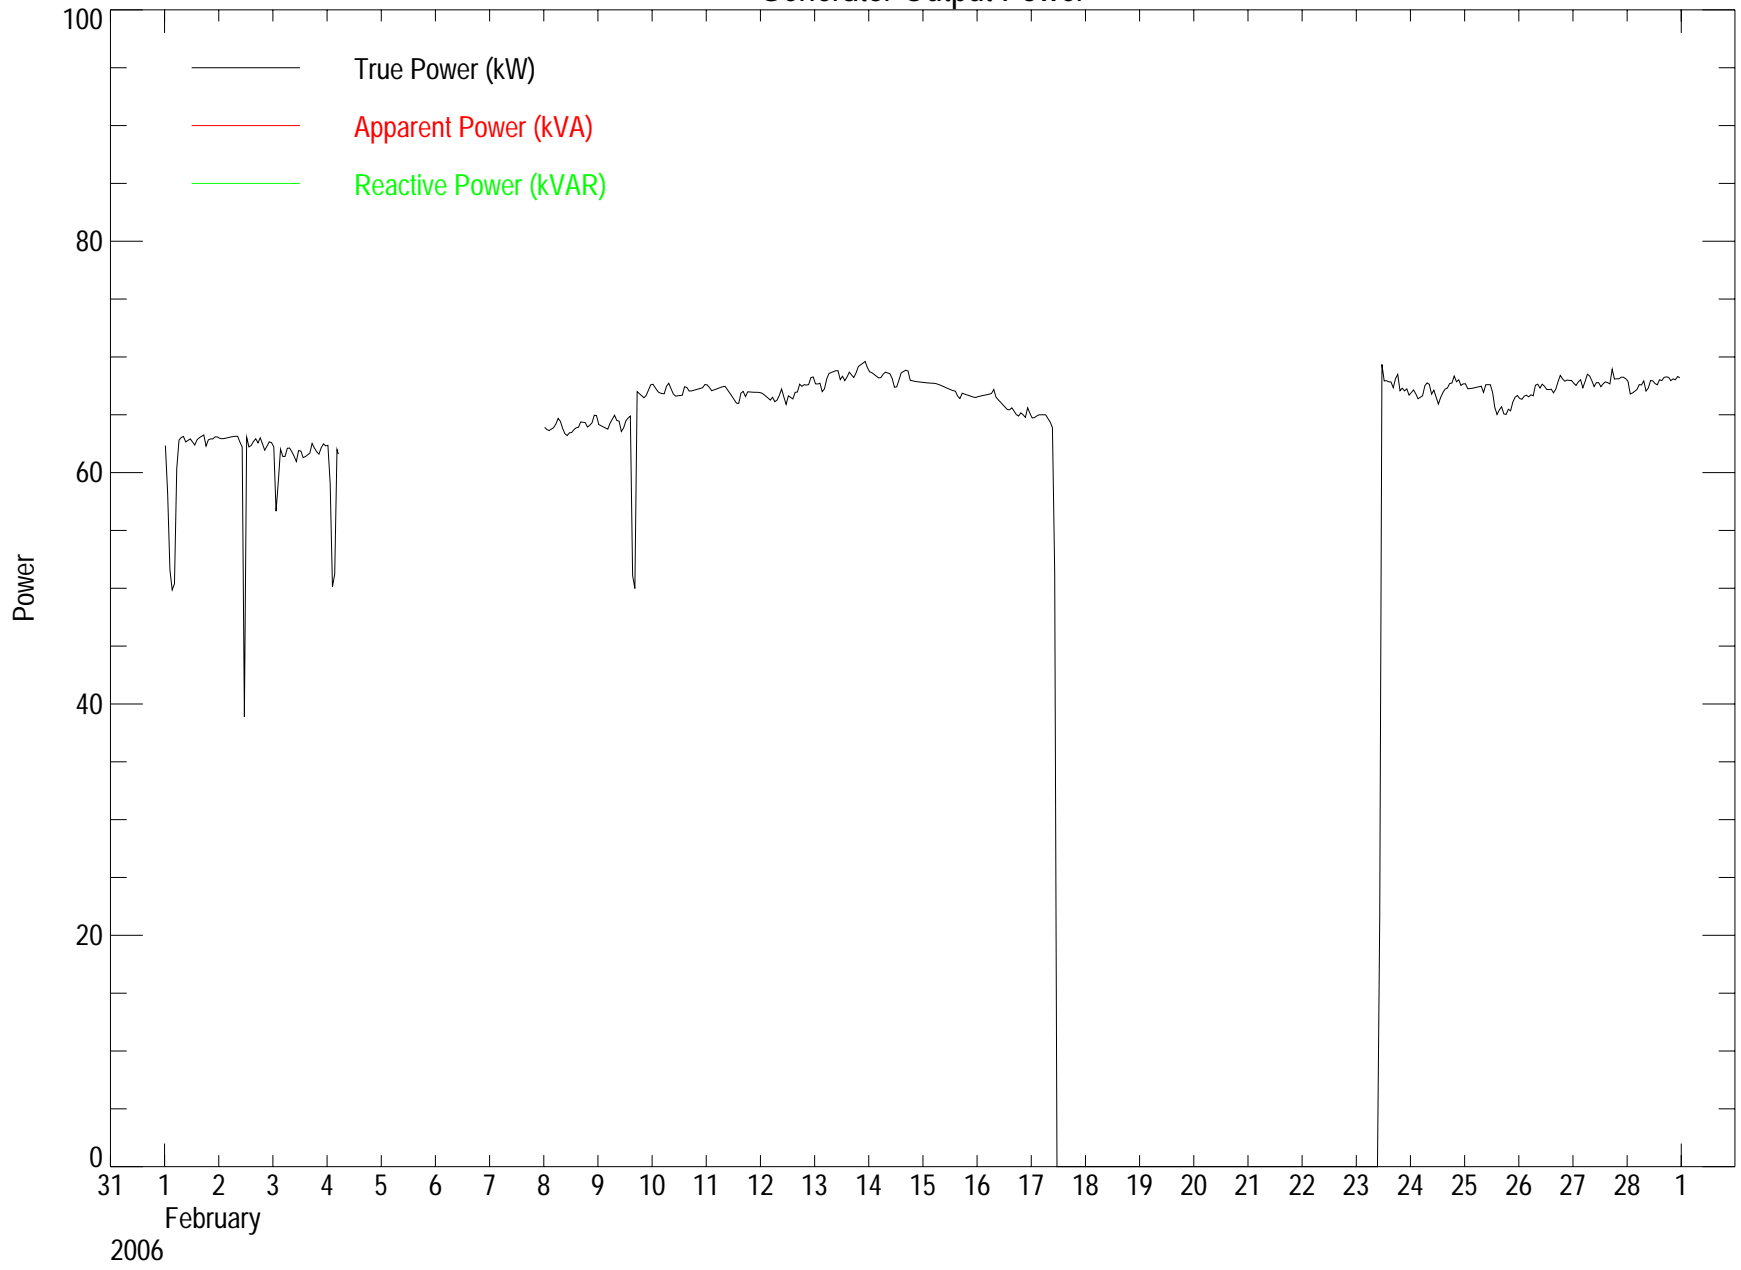

# Generator Output Current

