

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

04/01/06 to 04/30/06

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	69.94	92.78	100.31	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	13.8	58.0	65.5
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

04/01/06 to 04/30/06

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
04/01/06	0.00	n/a	n/a	-	n/a
04/02/06	100.00	n/a	n/a	1397.07	n/a
04/03/06	100.00	n/a	n/a	1406.59	n/a
04/04/06	100.00	n/a	n/a	1398.76	n/a
04/05/06	100.00	n/a	n/a	1425.38	n/a
04/06/06	100.00	n/a	n/a	1443.61	n/a
04/07/06	100.00	n/a	n/a	1406.14	n/a
04/08/06	100.00	n/a	n/a	1427.66	n/a
04/09/06	100.00	n/a	n/a	1417.70	n/a
04/10/06	100.00	n/a	n/a	1449.03	n/a
04/11/06	100.00	n/a	n/a	1426.42	n/a
04/12/06	100.00	n/a	n/a	1411.16	n/a
04/13/06	100.00	n/a	n/a	1374.96	n/a
04/14/06	100.00	n/a	n/a	1351.86	n/a
04/15/06	100.00	n/a	n/a	1346.45	n/a
04/16/06	100.00	n/a	n/a	1313.19	n/a
04/17/06	100.00	n/a	n/a	1339.22	n/a
04/18/06	100.00	n/a	n/a	1347.19	n/a
04/19/06	100.00	n/a	n/a	1362.75	n/a
04/20/06	100.00	n/a	n/a	200.25	n/a
04/21/06	100.00	n/a	n/a	0.00	n/a
04/22/06	100.00	n/a	n/a	0.00	n/a
04/23/06	100.00	n/a	n/a	0.00	n/a
04/24/06	100.00	n/a	n/a	0.00	n/a
04/25/06	100.00	n/a	n/a	988.65	n/a
04/26/06	100.00	n/a	n/a	1422.69	n/a
04/27/06	100.00	n/a	n/a	1397.80	n/a
04/28/06	100.00	n/a	n/a	1344.56	n/a
04/29/06	100.00	n/a	n/a	1362.40	n/a
04/30/06	100.00	n/a	n/a	1428.01	n/a
Total	96.67	n/a	n/a	33189.48	n/a

Generator Output Power

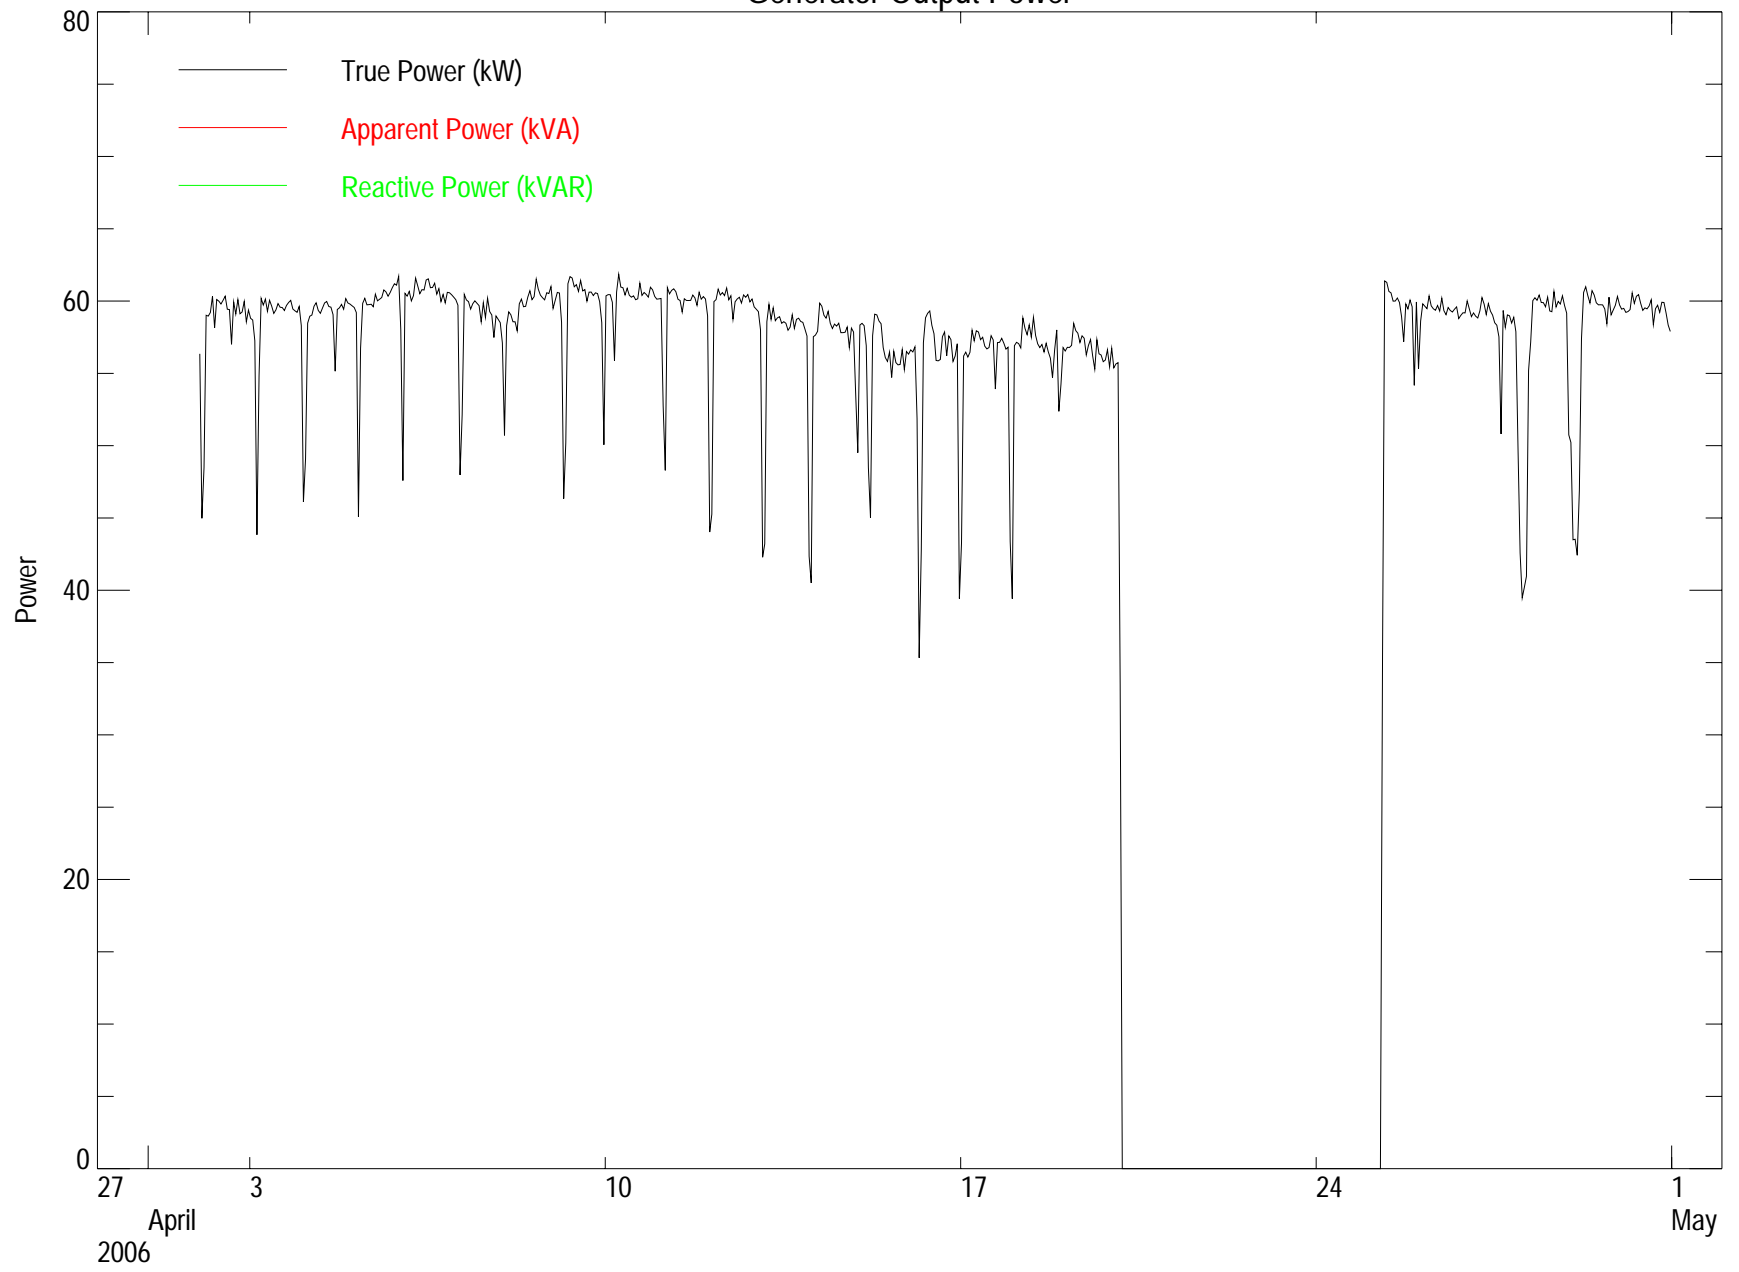

Generator Output Current

