

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

06/01/06 to 06/30/06

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	77.50	97.22	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	7.2	52.1	60.3
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

06/01/06 to 06/30/06

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
06/01/06	100.00	n/a	n/a	1183.68	n/a
06/02/06	100.00	n/a	n/a	1175.05	n/a
06/03/06	100.00	n/a	n/a	1207.58	n/a
06/04/06	100.00	n/a	n/a	1223.08	n/a
06/05/06	100.00	n/a	n/a	1232.40	n/a
06/06/06	100.00	n/a	n/a	1244.43	n/a
06/07/06	100.00	n/a	n/a	1250.84	n/a
06/08/06	100.00	n/a	n/a	1269.78	n/a
06/09/06	100.00	n/a	n/a	1272.88	n/a
06/10/06	100.00	n/a	n/a	1284.09	n/a
06/11/06	100.00	n/a	n/a	1306.69	n/a
06/12/06	100.00	n/a	n/a	1239.05	n/a
06/13/06	100.00	n/a	n/a	1293.43	n/a
06/14/06	100.00	n/a	n/a	1263.59	n/a
06/15/06	100.00	n/a	n/a	715.33	n/a
06/16/06	100.00	n/a	n/a	0.00	n/a
06/17/06	100.00	n/a	n/a	0.00	n/a
06/18/06	100.00	n/a	n/a	0.00	n/a
06/19/06	100.00	n/a	n/a	0.00	n/a
06/20/06	100.00	n/a	n/a	0.00	n/a
06/21/06	100.00	n/a	n/a	0.00	n/a
06/22/06	100.00	n/a	n/a	0.00	n/a
06/23/06	100.00	n/a	n/a	0.00	n/a
06/24/06	100.00	n/a	n/a	0.00	n/a
06/25/06	100.00	n/a	n/a	0.00	n/a
06/26/06	100.00	n/a	n/a	0.00	n/a
06/27/06	100.00	n/a	n/a	354.10	n/a
06/28/06	100.00	n/a	n/a	655.77	n/a
06/29/06	100.00	n/a	n/a	0.00	n/a
06/30/06	100.00	n/a	n/a	0.00	n/a
Total	100.00	n/a	n/a	19171.75	n/a

Generator Output Power

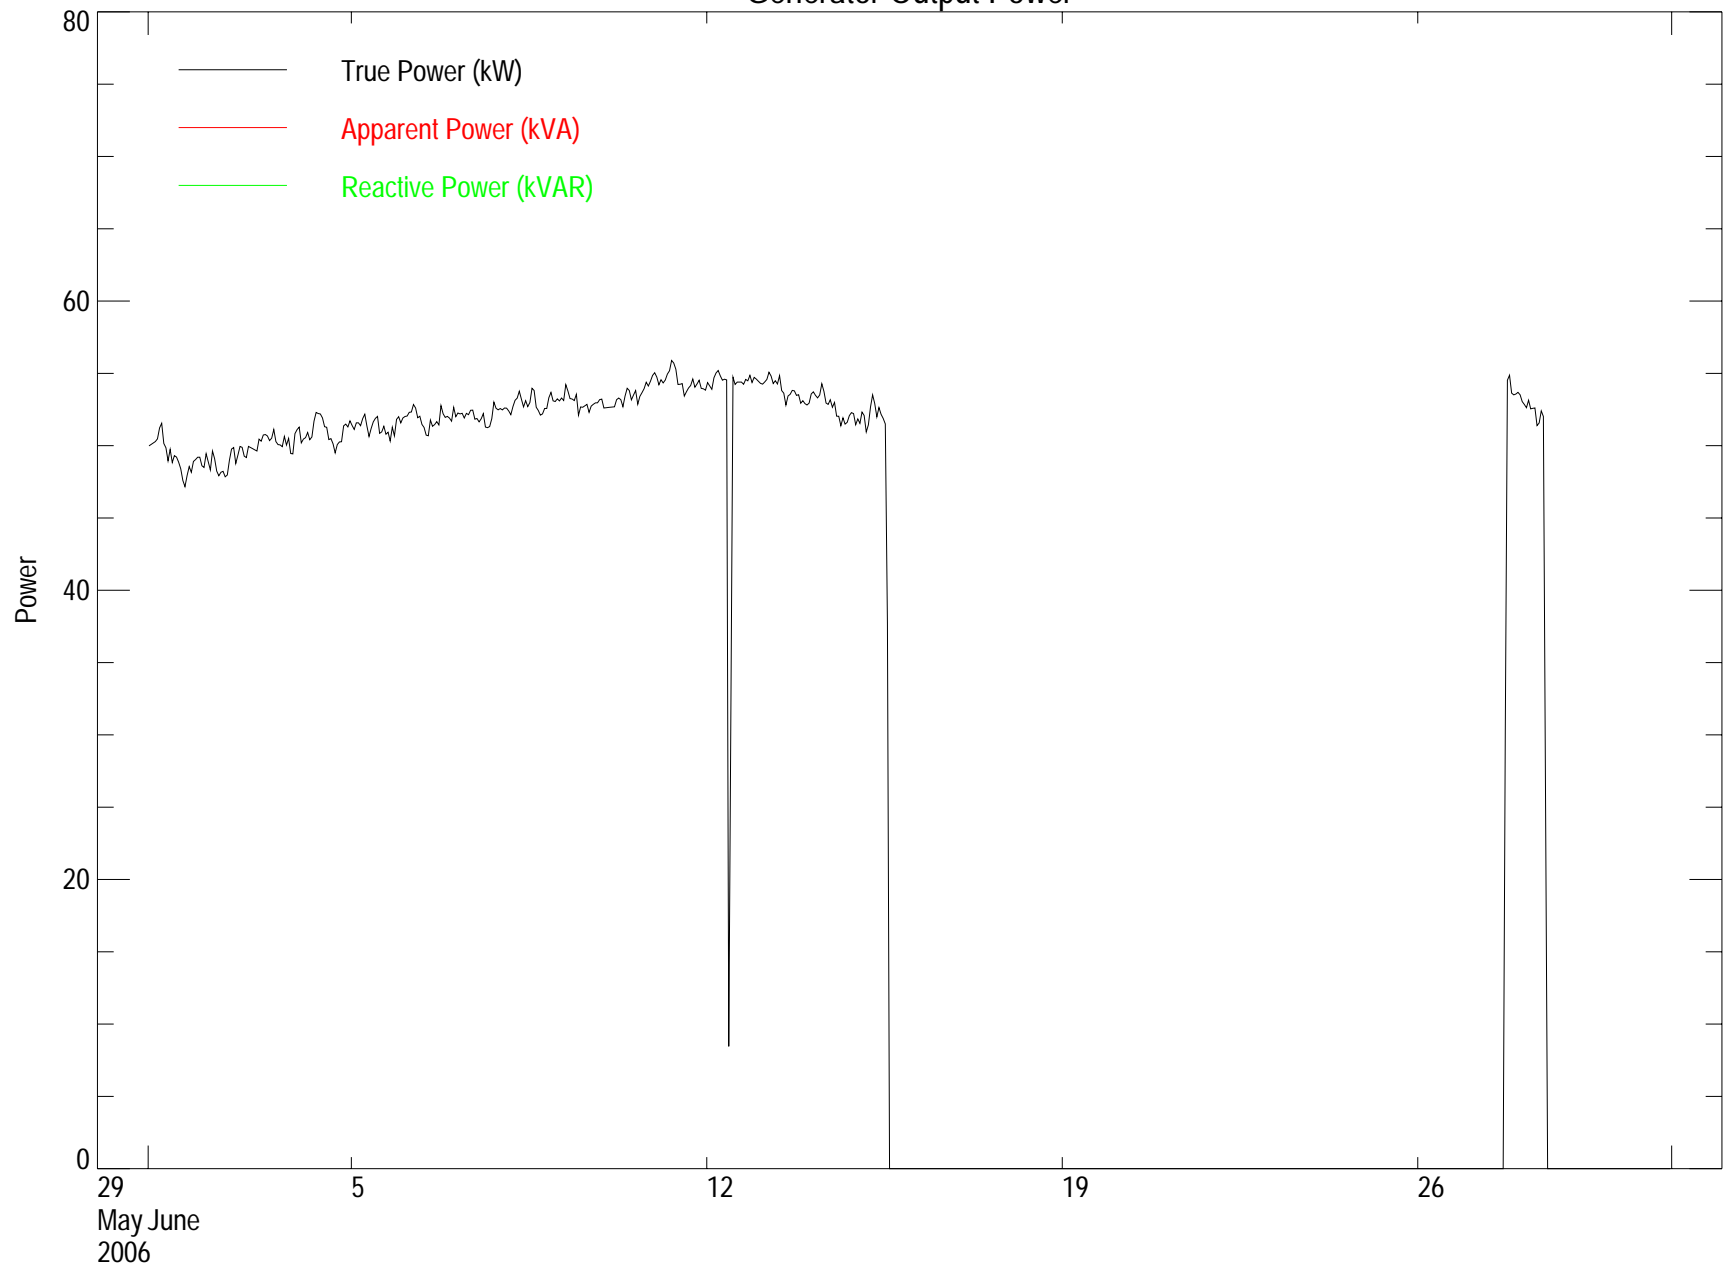

Generator Output Current

