

## GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

07/01/06 to 07/31/06

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	0.06	0.10	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


# GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

07/01/06 to 07/31/06

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
07/01/06	100.00	n/a	n/a	0.00	n/a
07/02/06	100.00	n/a	n/a	0.00	n/a
07/03/06	100.00	n/a	n/a	0.00	n/a
07/04/06	100.00	n/a	n/a	0.00	n/a
07/05/06	100.00	n/a	n/a	0.00	n/a
07/06/06	100.00	n/a	n/a	0.00	n/a
07/07/06	100.00	n/a	n/a	0.00	n/a
07/08/06	100.00	n/a	n/a	0.00	n/a
07/09/06	100.00	n/a	n/a	0.00	n/a
07/10/06	100.00	n/a	n/a	0.00	n/a
07/11/06	100.00	n/a	n/a	0.00	n/a
07/12/06	100.00	n/a	n/a	0.00	n/a
07/13/06	100.00	n/a	n/a	0.00	n/a
07/14/06	100.00	n/a	n/a	0.00	n/a
07/15/06	100.00	n/a	n/a	0.00	n/a
07/16/06	100.00	n/a	n/a	0.00	n/a
07/17/06	100.00	n/a	n/a	0.00	n/a
07/18/06	100.00	n/a	n/a	0.00	n/a
07/19/06	100.00	n/a	n/a	0.00	n/a
07/20/06	100.00	n/a	n/a	0.00	n/a
07/21/06	100.00	n/a	n/a	0.00	n/a
07/22/06	100.00	n/a	n/a	0.00	n/a
07/23/06	100.00	n/a	n/a	0.00	n/a
07/24/06	100.00	n/a	n/a	0.00	n/a
07/25/06	100.00	n/a	n/a	0.00	n/a
07/26/06	100.00	n/a	n/a	0.00	n/a
07/27/06	100.00	n/a	n/a	0.00	n/a
07/28/06	100.00	n/a	n/a	0.00	n/a
07/29/06	100.00	n/a	n/a	0.00	n/a
07/30/06	100.00	n/a	n/a	0.00	n/a
07/31/06	100.00	n/a	n/a	0.00	n/a
Total	100.00	n/a	n/a	0.00	n/a

# Generator Output Power

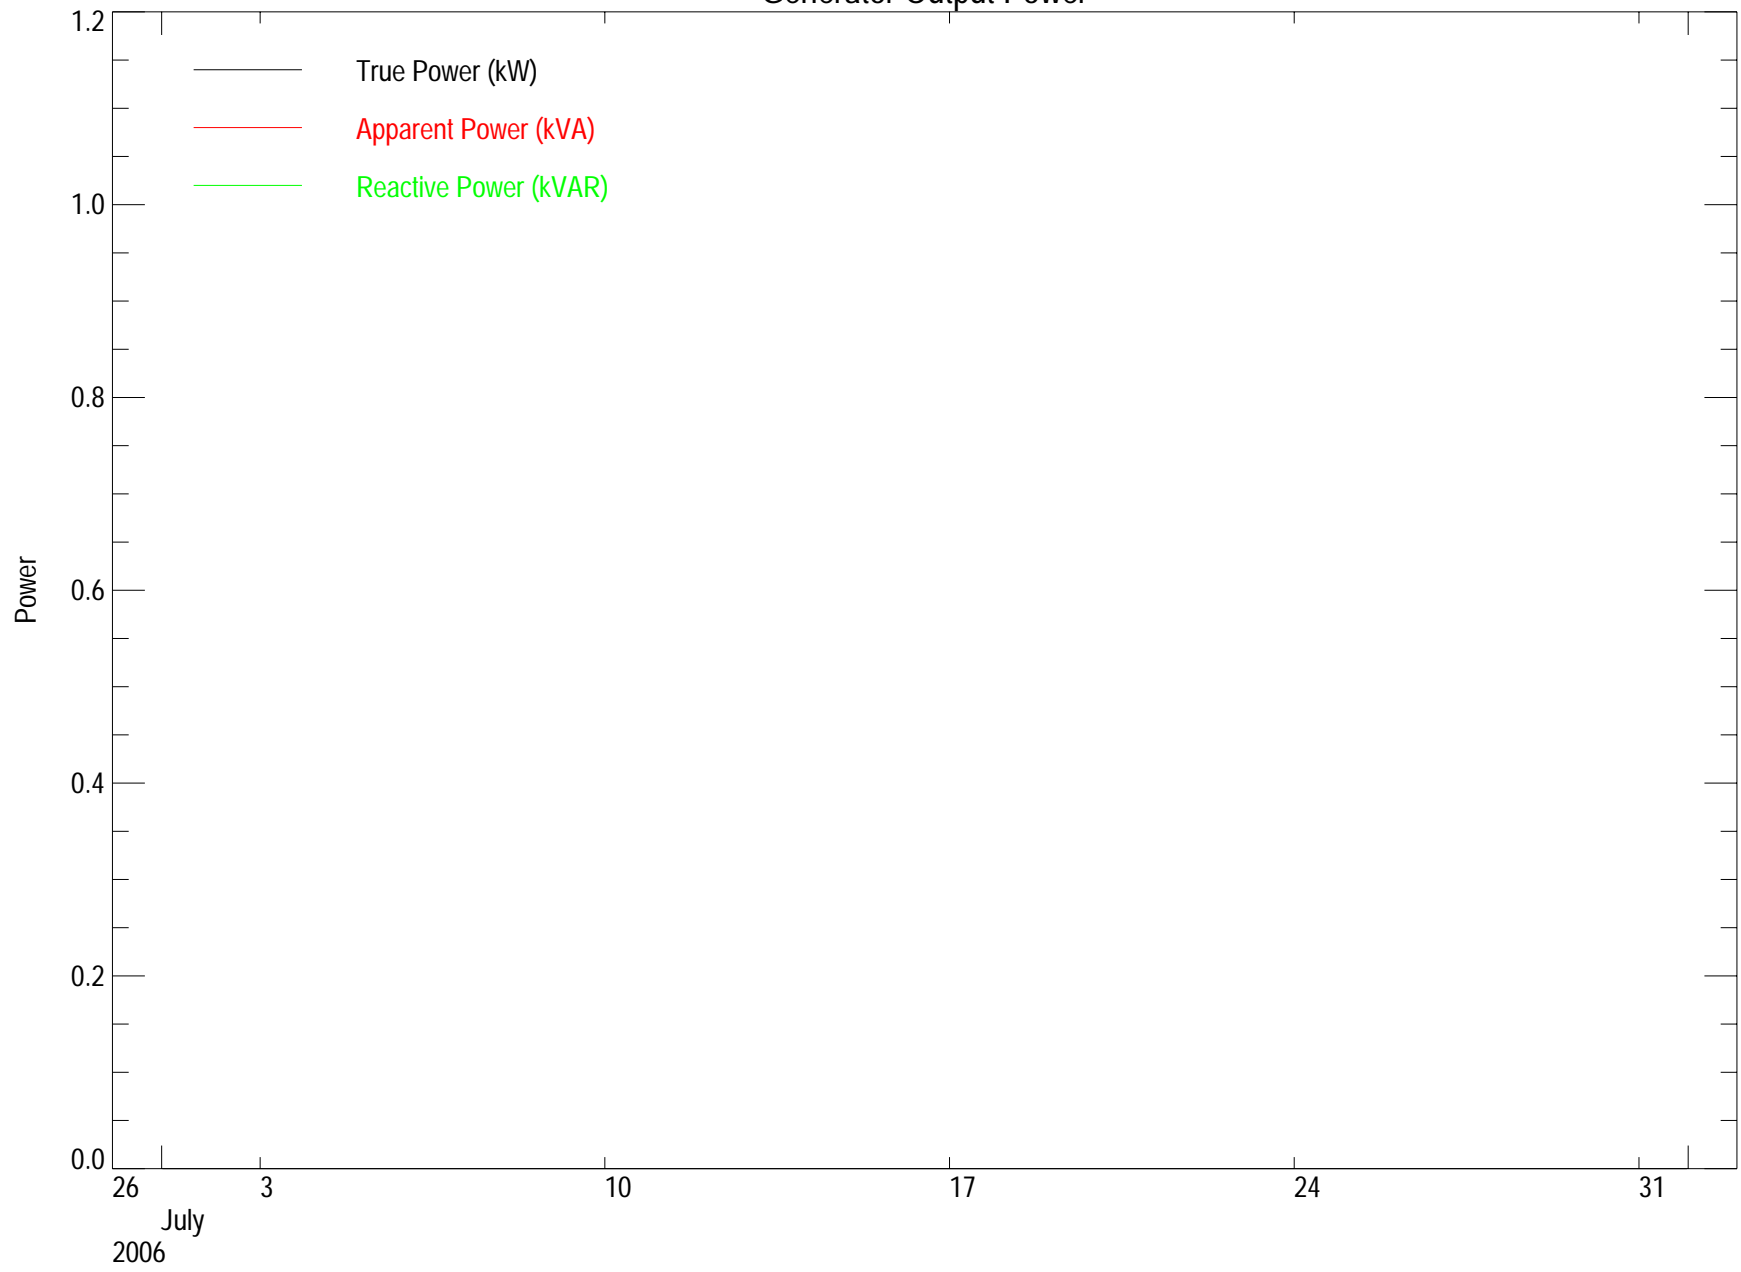

# Generator Output Current

