

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

08/01/06 to 08/31/06

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	0.10	0.20	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	-	-	-
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

08/01/06 to 08/31/06

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
08/01/06	100.00	n/a	n/a	0.00	n/a
08/02/06	100.00	n/a	n/a	0.00	n/a
08/03/06	100.00	n/a	n/a	0.00	n/a
08/04/06	100.00	n/a	n/a	0.00	n/a
08/05/06	100.00	n/a	n/a	0.00	n/a
08/06/06	100.00	n/a	n/a	0.00	n/a
08/07/06	100.00	n/a	n/a	0.00	n/a
08/08/06	100.00	n/a	n/a	0.00	n/a
08/09/06	100.00	n/a	n/a	0.00	n/a
08/10/06	100.00	n/a	n/a	0.00	n/a
08/11/06	100.00	n/a	n/a	0.00	n/a
08/12/06	100.00	n/a	n/a	0.00	n/a
08/13/06	100.00	n/a	n/a	0.00	n/a
08/14/06	100.00	n/a	n/a	0.00	n/a
08/15/06	100.00	n/a	n/a	0.00	n/a
08/16/06	100.00	n/a	n/a	0.00	n/a
08/17/06	100.00	n/a	n/a	0.00	n/a
08/18/06	100.00	n/a	n/a	0.00	n/a
08/19/06	100.00	n/a	n/a	0.00	n/a
08/20/06	100.00	n/a	n/a	0.00	n/a
08/21/06	100.00	n/a	n/a	0.00	n/a
08/22/06	100.00	n/a	n/a	0.00	n/a
08/23/06	100.00	n/a	n/a	0.00	n/a
08/24/06	100.00	n/a	n/a	0.00	n/a
08/25/06	100.00	n/a	n/a	0.00	n/a
08/26/06	100.00	n/a	n/a	0.00	n/a
08/27/06	100.00	n/a	n/a	0.00	n/a
08/28/06	100.00	n/a	n/a	0.00	n/a
08/29/06	100.00	n/a	n/a	0.00	n/a
08/30/06	100.00	n/a	n/a	0.00	n/a
08/31/06	100.00	n/a	n/a	0.00	n/a
Total	100.00	n/a	n/a	0.00	n/a

Generator Output Power

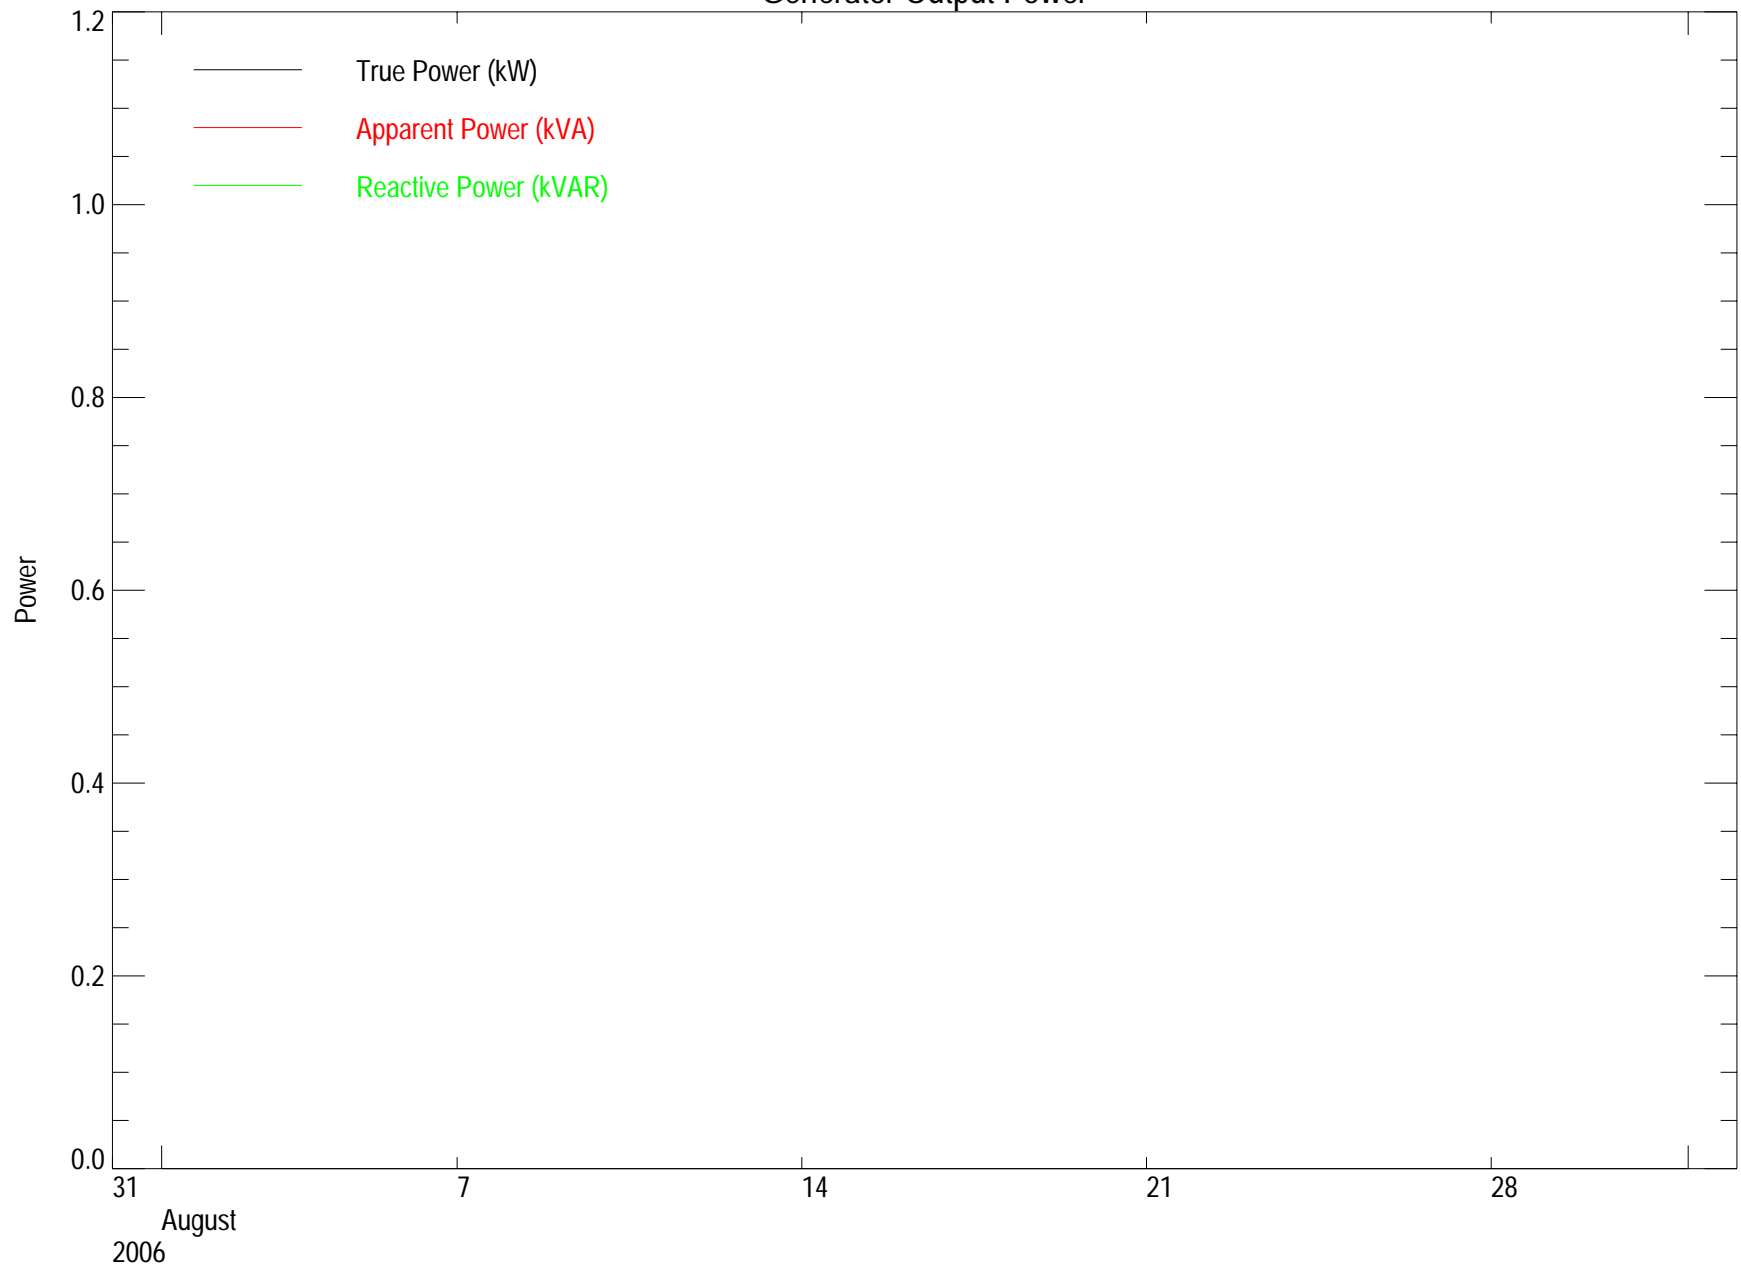

Generator Output Current

