

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

09/01/06 to 09/30/06

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.10	83.58	172.01	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	1.6	50.1	61.6
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

09/01/06 to 09/30/06

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
09/01/06	100.00	n/a	n/a	0.00	n/a
09/02/06	100.00	n/a	n/a	0.00	n/a
09/03/06	100.00	n/a	n/a	0.00	n/a
09/04/06	100.00	n/a	n/a	0.00	n/a
09/05/06	100.00	n/a	n/a	0.00	n/a
09/06/06	100.00	n/a	n/a	0.00	n/a
09/07/06	100.00	n/a	n/a	616.29	n/a
09/08/06	100.00	n/a	n/a	1243.35	n/a
09/09/06	100.00	n/a	n/a	1276.38	n/a
09/10/06	100.00	n/a	n/a	1271.22	n/a
09/11/06	100.00	n/a	n/a	663.56	n/a
09/12/06	100.00	n/a	n/a	0.00	n/a
09/13/06	100.00	n/a	n/a	0.00	n/a
09/14/06	100.00	n/a	n/a	687.59	n/a
09/15/06	100.00	n/a	n/a	1267.28	n/a
09/16/06	100.00	n/a	n/a	1224.05	n/a
09/17/06	100.00	n/a	n/a	1189.05	n/a
09/18/06	100.00	n/a	n/a	1157.74	n/a
09/19/06	100.00	n/a	n/a	1159.26	n/a
09/20/06	100.00	n/a	n/a	1148.57	n/a
09/21/06	100.00	n/a	n/a	1177.48	n/a
09/22/06	100.00	n/a	n/a	1181.41	n/a
09/23/06	100.00	n/a	n/a	1179.43	n/a
09/24/06	100.00	n/a	n/a	1144.76	n/a
09/25/06	100.00	n/a	n/a	1138.24	n/a
09/26/06	100.00	n/a	n/a	1173.87	n/a
09/27/06	100.00	n/a	n/a	1188.23	n/a
09/28/06	100.00	n/a	n/a	1189.90	n/a
09/29/06	100.00	n/a	n/a	1180.45	n/a
09/30/06	100.00	n/a	n/a	0.00	n/a
Total	100.00	n/a	n/a	23458.10	n/a

Generator Output Power

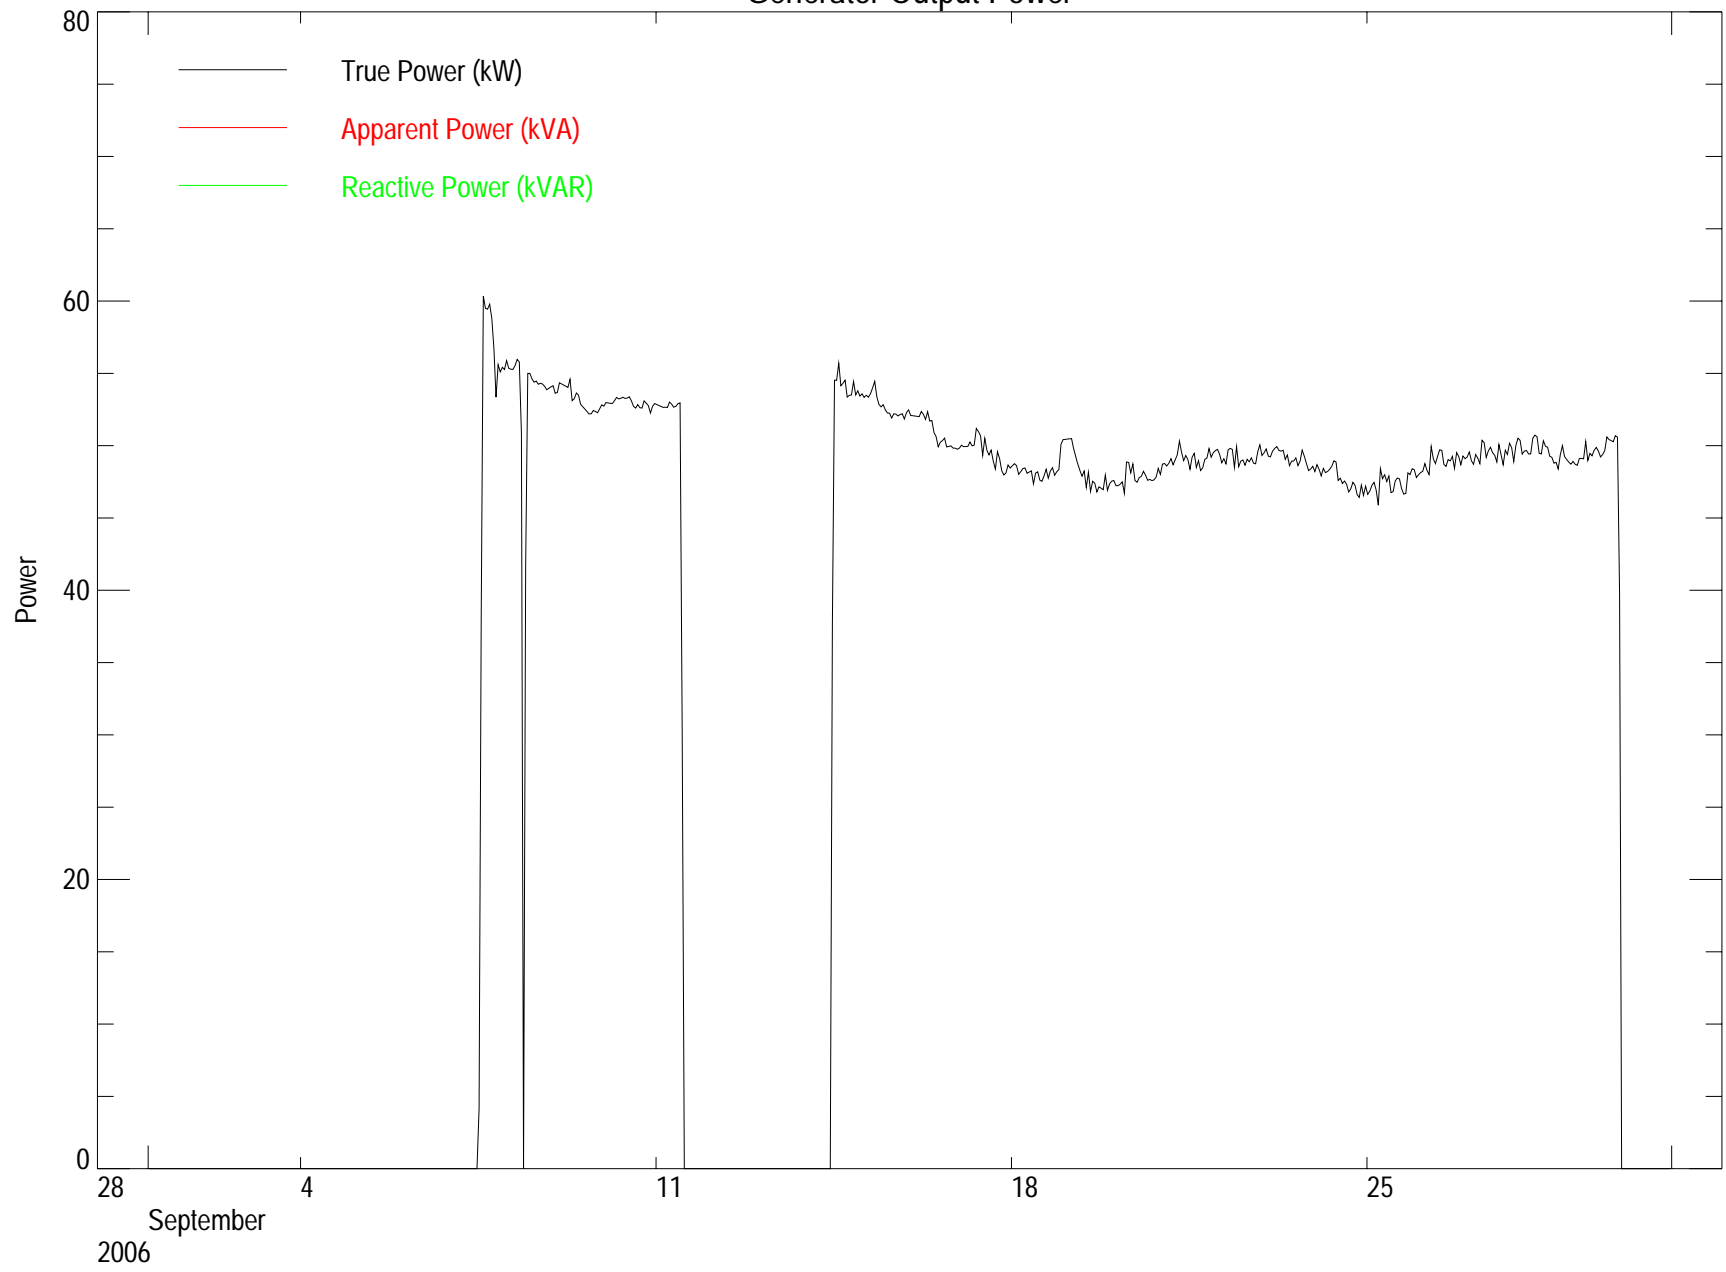

Generator Output Current

