

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

12/01/06 to 12/31/06

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	60.98	104.88	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.7	56.5	67.1
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

12/01/06 to 12/31/06

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
12/01/06	100.00	n/a	n/a	1349.98	n/a
12/02/06	100.00	n/a	n/a	1392.52	n/a
12/03/06	100.00	n/a	n/a	1420.71	n/a
12/04/06	100.00	n/a	n/a	1440.67	n/a
12/05/06	100.00	n/a	n/a	1482.03	n/a
12/06/06	100.00	n/a	n/a	1480.24	n/a
12/07/06	100.00	n/a	n/a	1449.70	n/a
12/08/06	100.00	n/a	n/a	924.89	n/a
12/09/06	100.00	n/a	n/a	0.00	n/a
12/10/06	100.00	n/a	n/a	0.00	n/a
12/11/06	100.00	n/a	n/a	815.61	n/a
12/12/06	100.00	n/a	n/a	1502.07	n/a
12/13/06	100.00	n/a	n/a	1178.34	n/a
12/14/06	100.00	n/a	n/a	1413.92	n/a
12/15/06	100.00	n/a	n/a	1373.05	n/a
12/16/06	100.00	n/a	n/a	1331.54	n/a
12/17/06	100.00	n/a	n/a	1214.79	n/a
12/18/06	100.00	n/a	n/a	430.65	n/a
12/19/06	100.00	n/a	n/a	229.18	n/a
12/20/06	100.00	n/a	n/a	47.24	n/a
12/21/06	100.00	n/a	n/a	0.00	n/a
12/22/06	100.00	n/a	n/a	21.91	n/a
12/23/06	100.00	n/a	n/a	0.00	n/a
12/24/06	100.00	n/a	n/a	599.85	n/a
12/25/06	100.00	n/a	n/a	97.60	n/a
12/26/06	100.00	n/a	n/a	281.05	n/a
12/27/06	100.00	n/a	n/a	0.00	n/a
12/28/06	100.00	n/a	n/a	0.00	n/a
12/29/06	100.00	n/a	n/a	0.00	n/a
12/30/06	100.00	n/a	n/a	0.00	n/a
12/31/06	100.00	n/a	n/a	64.22	n/a
Total	100.00	n/a	n/a	21541.76	n/a

Generator Output Power

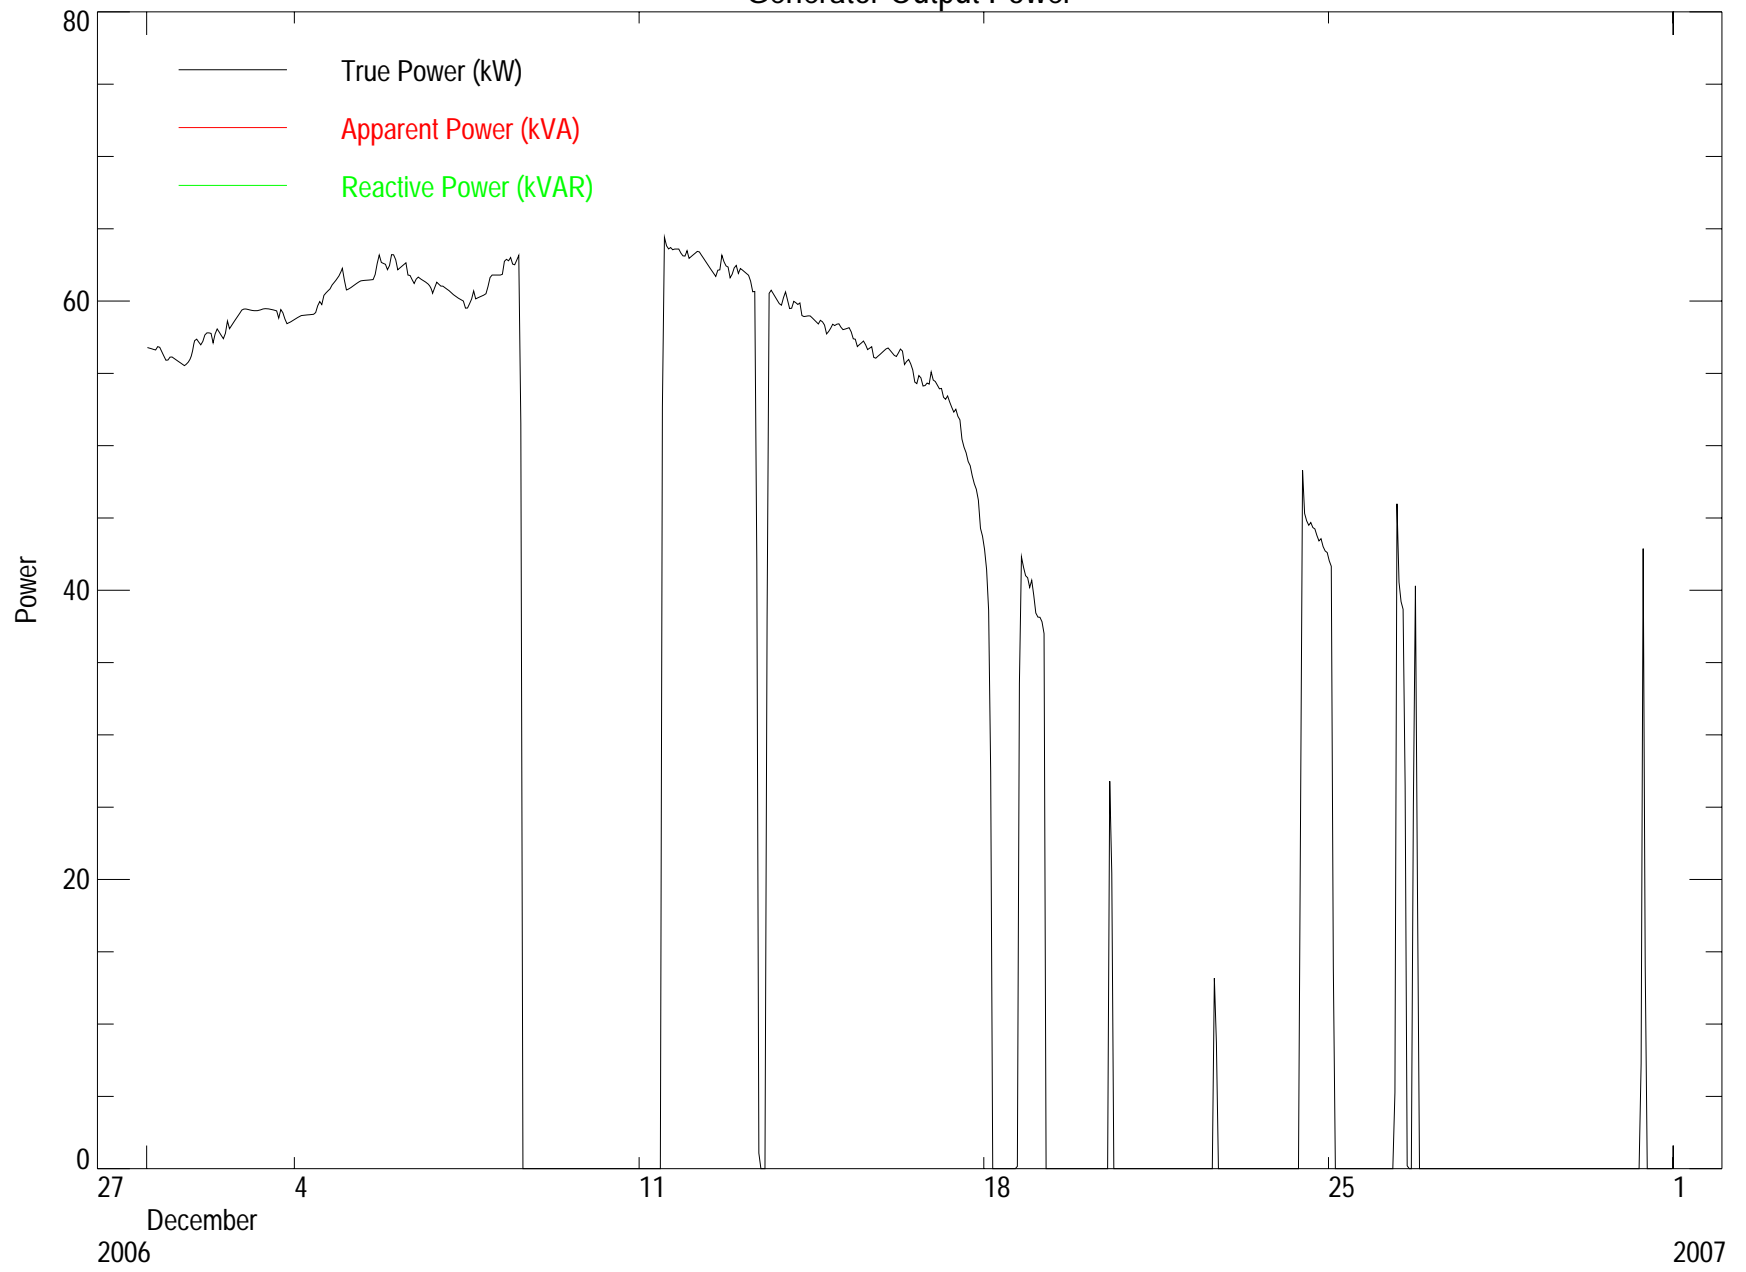

Generator Output Current

