

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

01/01/06 to 12/31/06

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	86.70	172.01	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.7	57.5	70.1
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

01/01/06 to 12/31/06

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
Jan 2006	100.00	n/a	n/a	44063.60	n/a
Feb 2006	86.50	n/a	n/a	28772.86	n/a
Mar 2006	100.00	n/a	n/a	46887.45	n/a
Apr 2006	96.67	n/a	n/a	33189.48	n/a
May 2006	100.00	n/a	n/a	40987.69	n/a
Jun 2006	100.00	n/a	n/a	19171.75	n/a
Jul 2006	100.00	n/a	n/a	0.00	n/a
Aug 2006	100.00	n/a	n/a	0.00	n/a
Sep 2006	100.00	n/a	n/a	23458.10	n/a
Oct 2006	100.00	n/a	n/a	33913.70	n/a
Nov 2006	100.00	n/a	n/a	39409.55	n/a
Dec 2006	100.00	n/a	n/a	21541.76	n/a
Total	98.69	n/a	n/a	331395.94	n/a

Generator Output Power

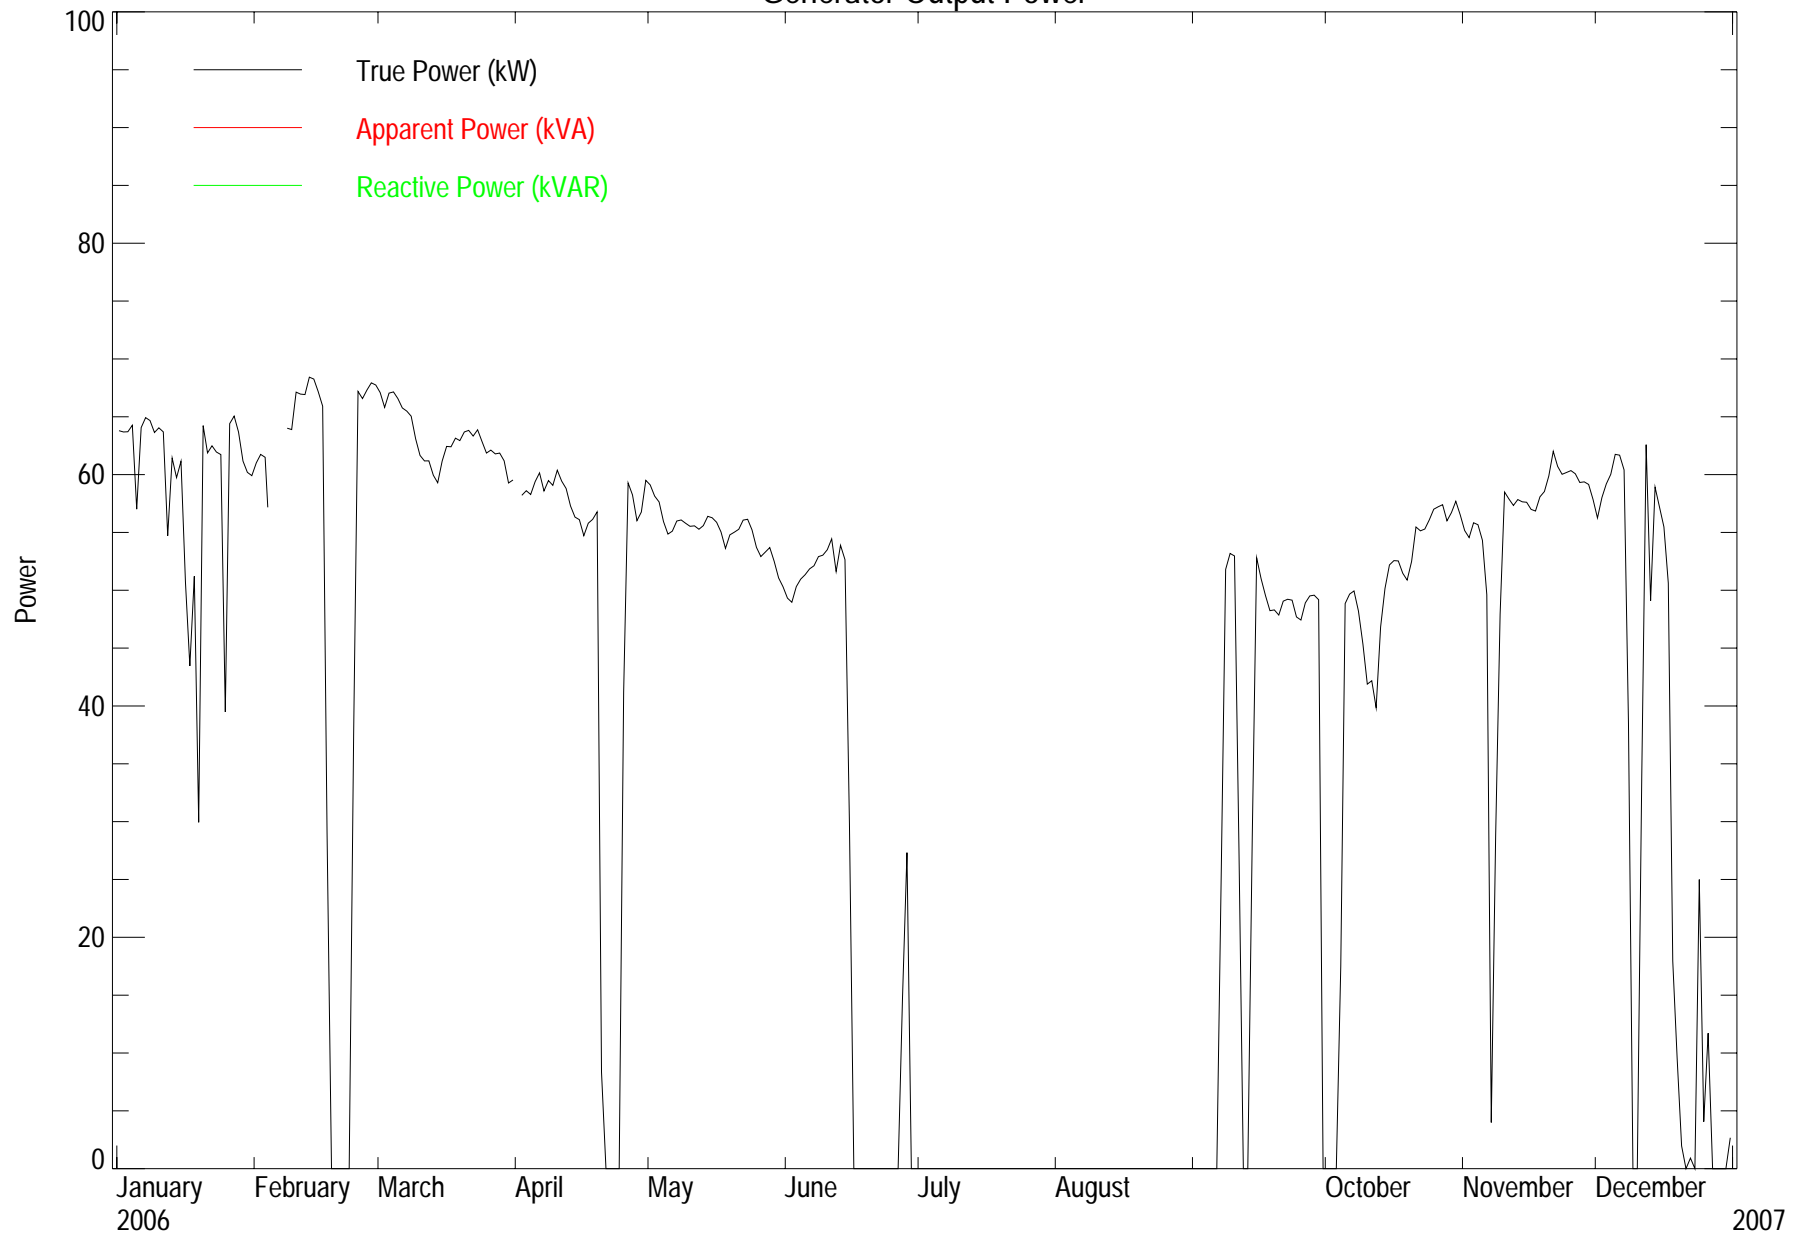

Generator Output Current

