

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

02/01/07 to 02/28/07

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.10	76.65	105.08	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	36.1	64.2	69.7
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

02/01/07 to 02/28/07

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
02/01/07	100.00	n/a	n/a	1573.35	n/a
02/02/07	100.00	n/a	n/a	1532.77	n/a
02/03/07	100.00	n/a	n/a	1551.93	n/a
02/04/07	100.00	n/a	n/a	1573.99	n/a
02/05/07	100.00	n/a	n/a	1623.31	n/a
02/06/07	100.00	n/a	n/a	1643.32	n/a
02/07/07	100.00	n/a	n/a	1638.13	n/a
02/08/07	100.00	n/a	n/a	1627.29	n/a
02/09/07	100.00	n/a	n/a	1612.71	n/a
02/10/07	100.00	n/a	n/a	1592.61	n/a
02/11/07	100.00	n/a	n/a	1591.55	n/a
02/12/07	100.00	n/a	n/a	1565.53	n/a
02/13/07	100.00	n/a	n/a	1559.45	n/a
02/14/07	100.00	n/a	n/a	1551.08	n/a
02/15/07	100.00	n/a	n/a	1603.55	n/a
02/16/07	100.00	n/a	n/a	1594.83	n/a
02/17/07	100.00	n/a	n/a	1570.90	n/a
02/18/07	100.00	n/a	n/a	1531.70	n/a
02/19/07	100.00	n/a	n/a	1531.18	n/a
02/20/07	100.00	n/a	n/a	1442.90	n/a
02/21/07	100.00	n/a	n/a	1261.11	n/a
02/22/07	100.00	n/a	n/a	836.77	n/a
02/23/07	100.00	n/a	n/a	0.00	n/a
02/24/07	100.00	n/a	n/a	0.00	n/a
02/25/07	100.00	n/a	n/a	0.00	n/a
02/26/07	100.00	n/a	n/a	0.00	n/a
02/27/07	100.00	n/a	n/a	0.00	n/a
02/28/07	100.00	n/a	n/a	0.00	n/a
Total	100.00	n/a	n/a	33609.91	n/a

Generator Output Power

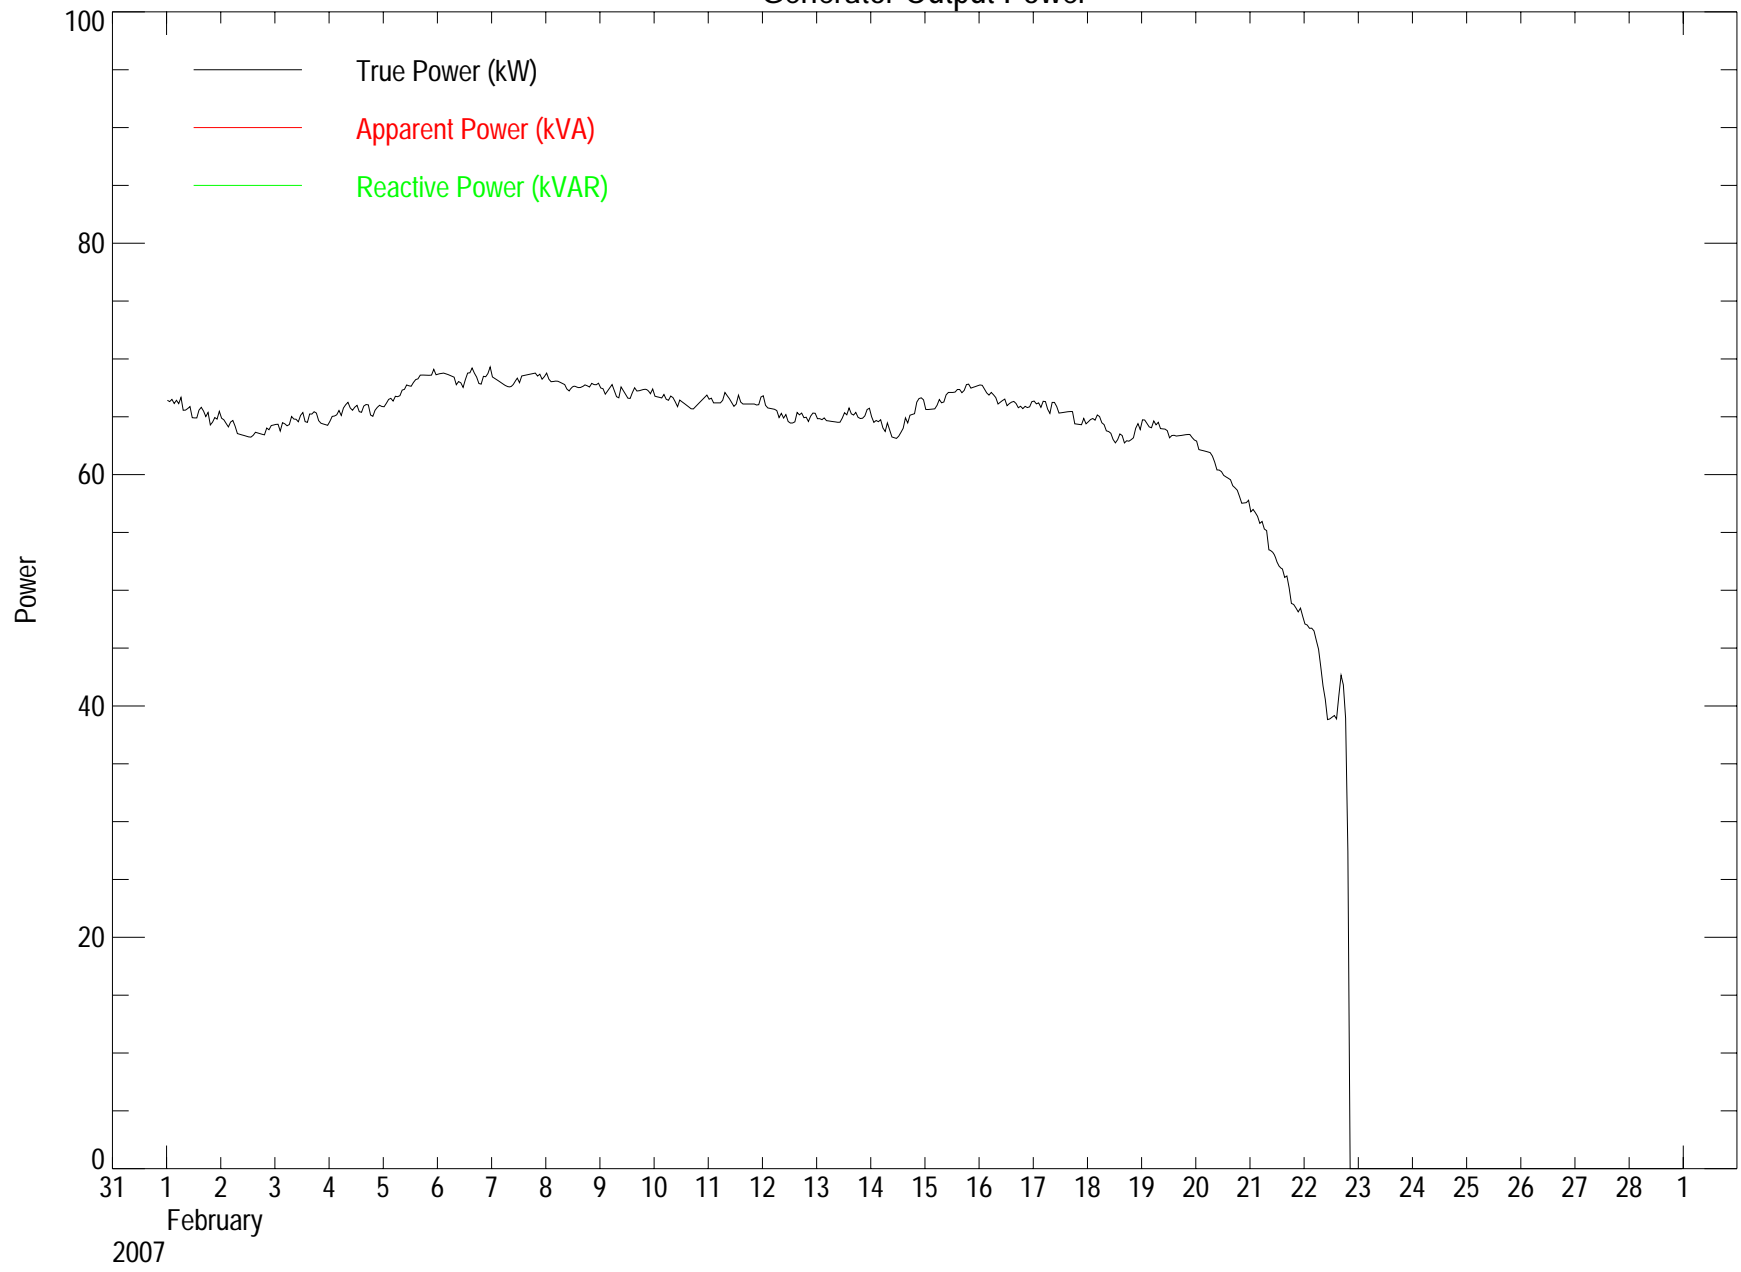

Generator Output Current

