

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

05/01/07 to 05/31/07

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.10	18.38	101.11	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	6.0	54.6	63.6
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

05/01/07 to 05/31/07

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
05/01/07	100.00	n/a	n/a	1358.01	n/a
05/02/07	100.00	n/a	n/a	206.60	n/a
05/03/07	100.00	n/a	n/a	675.23	n/a
05/04/07	100.00	n/a	n/a	236.91	n/a
05/05/07	100.00	n/a	n/a	0.00	n/a
05/06/07	100.00	n/a	n/a	0.00	n/a
05/07/07	100.00	n/a	n/a	0.00	n/a
05/08/07	100.00	n/a	n/a	0.00	n/a
05/09/07	100.00	n/a	n/a	0.00	n/a
05/10/07	100.00	n/a	n/a	0.00	n/a
05/11/07	100.00	n/a	n/a	0.00	n/a
05/12/07	100.00	n/a	n/a	0.00	n/a
05/13/07	100.00	n/a	n/a	0.00	n/a
05/14/07	100.00	n/a	n/a	0.00	n/a
05/15/07	100.00	n/a	n/a	0.00	n/a
05/16/07	100.00	n/a	n/a	0.00	n/a
05/17/07	100.00	n/a	n/a	0.00	n/a
05/18/07	100.00	n/a	n/a	0.00	n/a
05/19/07	100.00	n/a	n/a	0.00	n/a
05/20/07	100.00	n/a	n/a	0.00	n/a
05/21/07	100.00	n/a	n/a	0.00	n/a
05/22/07	100.00	n/a	n/a	0.00	n/a
05/23/07	100.00	n/a	n/a	0.00	n/a
05/24/07	100.00	n/a	n/a	0.00	n/a
05/25/07	100.00	n/a	n/a	648.51	n/a
05/26/07	100.00	n/a	n/a	1307.47	n/a
05/27/07	100.00	n/a	n/a	124.70	n/a
05/28/07	100.00	n/a	n/a	0.00	n/a
05/29/07	100.00	n/a	n/a	630.97	n/a
05/30/07	100.00	n/a	n/a	1322.31	n/a
05/31/07	100.00	n/a	n/a	1297.40	n/a
Total	100.00	n/a	n/a	7808.10	n/a

Generator Output Power

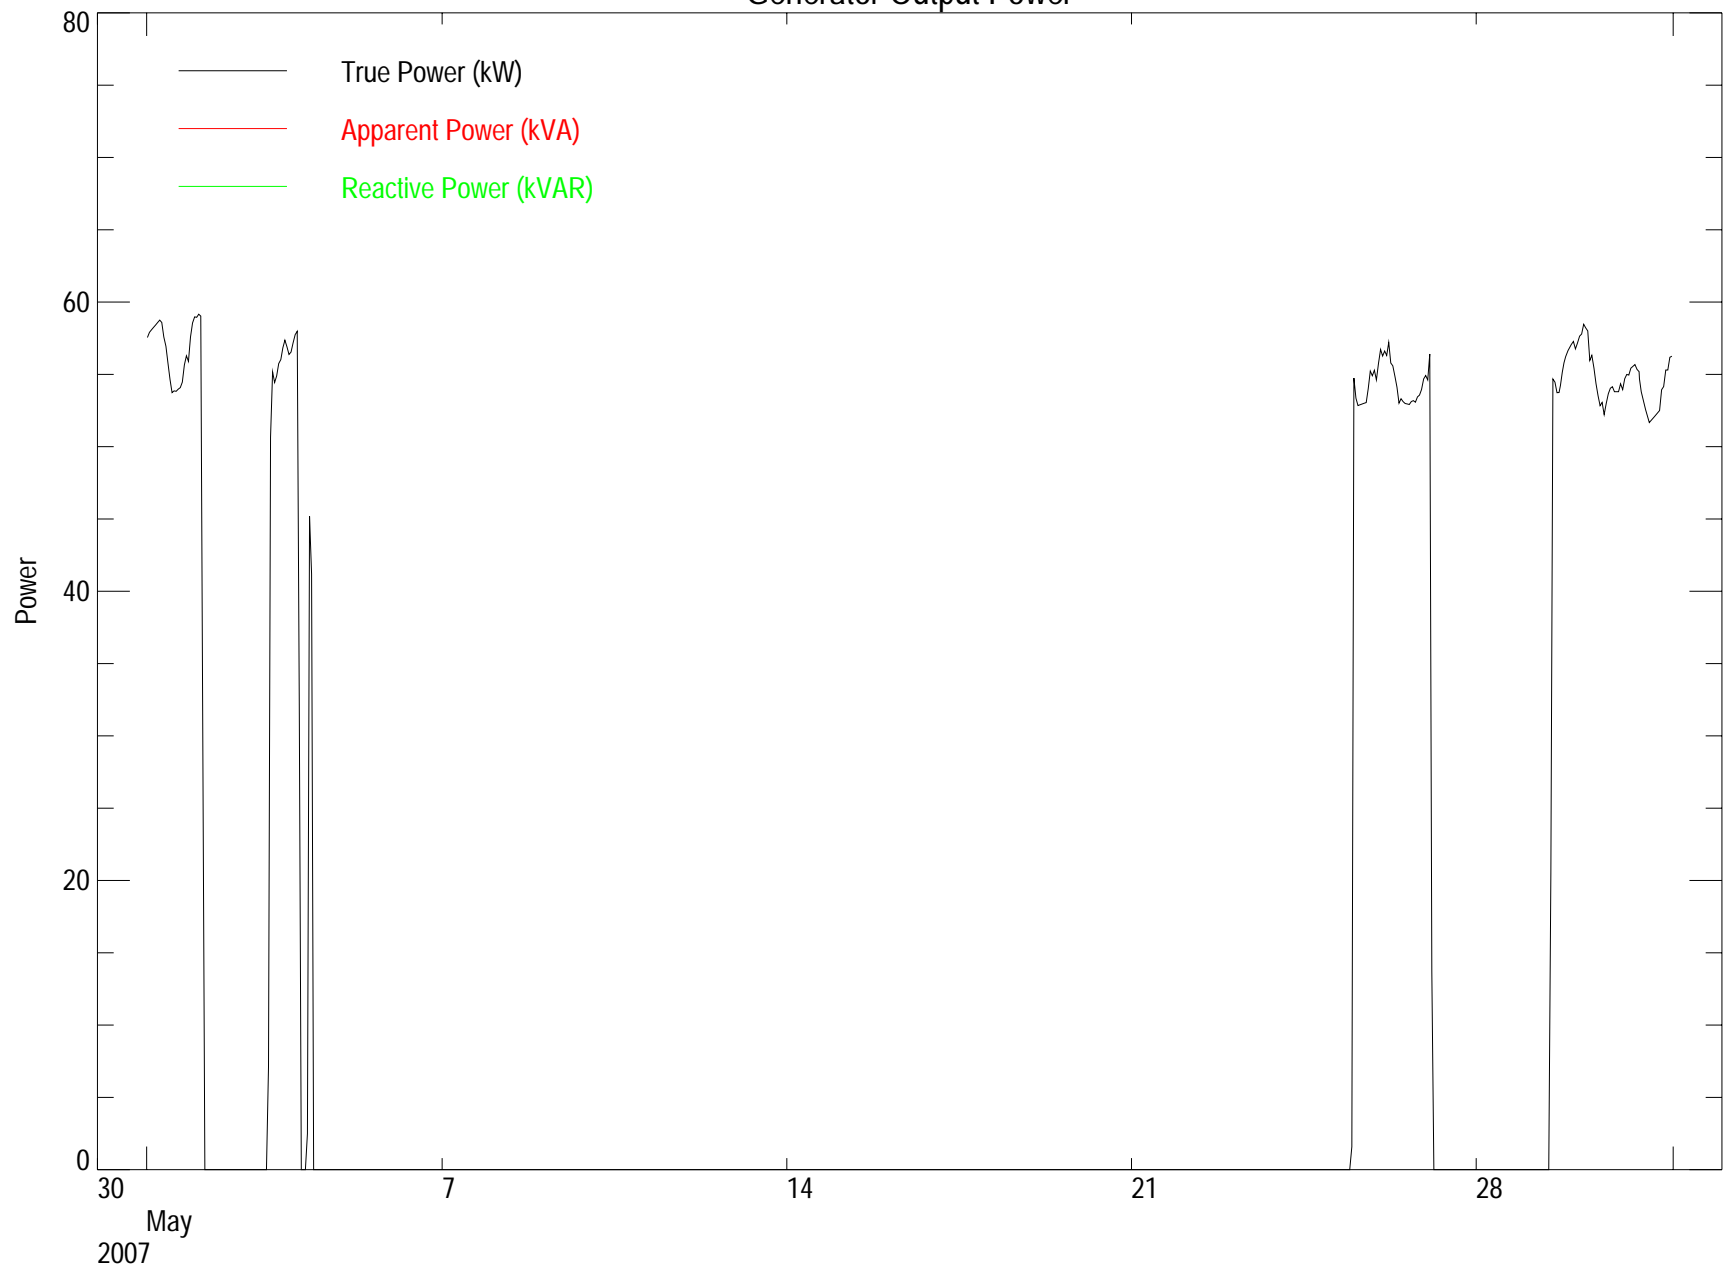

Generator Output Current

