

GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

06/01/07 to 06/30/07

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.01	65.05	99.81	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	0.3	54.2	61.6
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

06/01/07 to 06/30/07

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
06/01/07	100.00	n/a	n/a	1282.31	n/a
06/02/07	100.00	n/a	n/a	214.43	n/a
06/03/07	100.00	n/a	n/a	0.00	n/a
06/04/07	100.00	n/a	n/a	0.00	n/a
06/05/07	100.00	n/a	n/a	0.00	n/a
06/06/07	100.00	n/a	n/a	785.34	n/a
06/07/07	100.00	n/a	n/a	1371.30	n/a
06/08/07	100.00	n/a	n/a	1303.33	n/a
06/09/07	100.00	n/a	n/a	1295.32	n/a
06/10/07	100.00	n/a	n/a	235.41	n/a
06/11/07	100.00	n/a	n/a	0.00	n/a
06/12/07	100.00	n/a	n/a	0.00	n/a
06/13/07	100.00	n/a	n/a	876.36	n/a
06/14/07	100.00	n/a	n/a	1387.79	n/a
06/15/07	100.00	n/a	n/a	1374.17	n/a
06/16/07	100.00	n/a	n/a	1338.42	n/a
06/17/07	100.00	n/a	n/a	1270.18	n/a
06/18/07	100.00	n/a	n/a	1257.08	n/a
06/19/07	100.00	n/a	n/a	1265.88	n/a
06/20/07	100.00	n/a	n/a	1273.14	n/a
06/21/07	100.00	n/a	n/a	1290.25	n/a
06/22/07	100.00	n/a	n/a	1309.09	n/a
06/23/07	100.00	n/a	n/a	1324.71	n/a
06/24/07	100.00	n/a	n/a	293.00	n/a
06/25/07	100.00	n/a	n/a	797.05	n/a
06/26/07	100.00	n/a	n/a	1239.03	n/a
06/27/07	100.00	n/a	n/a	1215.28	n/a
06/28/07	100.00	n/a	n/a	248.09	n/a
06/29/07	100.00	n/a	n/a	0.00	n/a
06/30/07	100.00	n/a	n/a	0.00	n/a
Total	100.00	n/a	n/a	24246.96	n/a

Generator Output Power

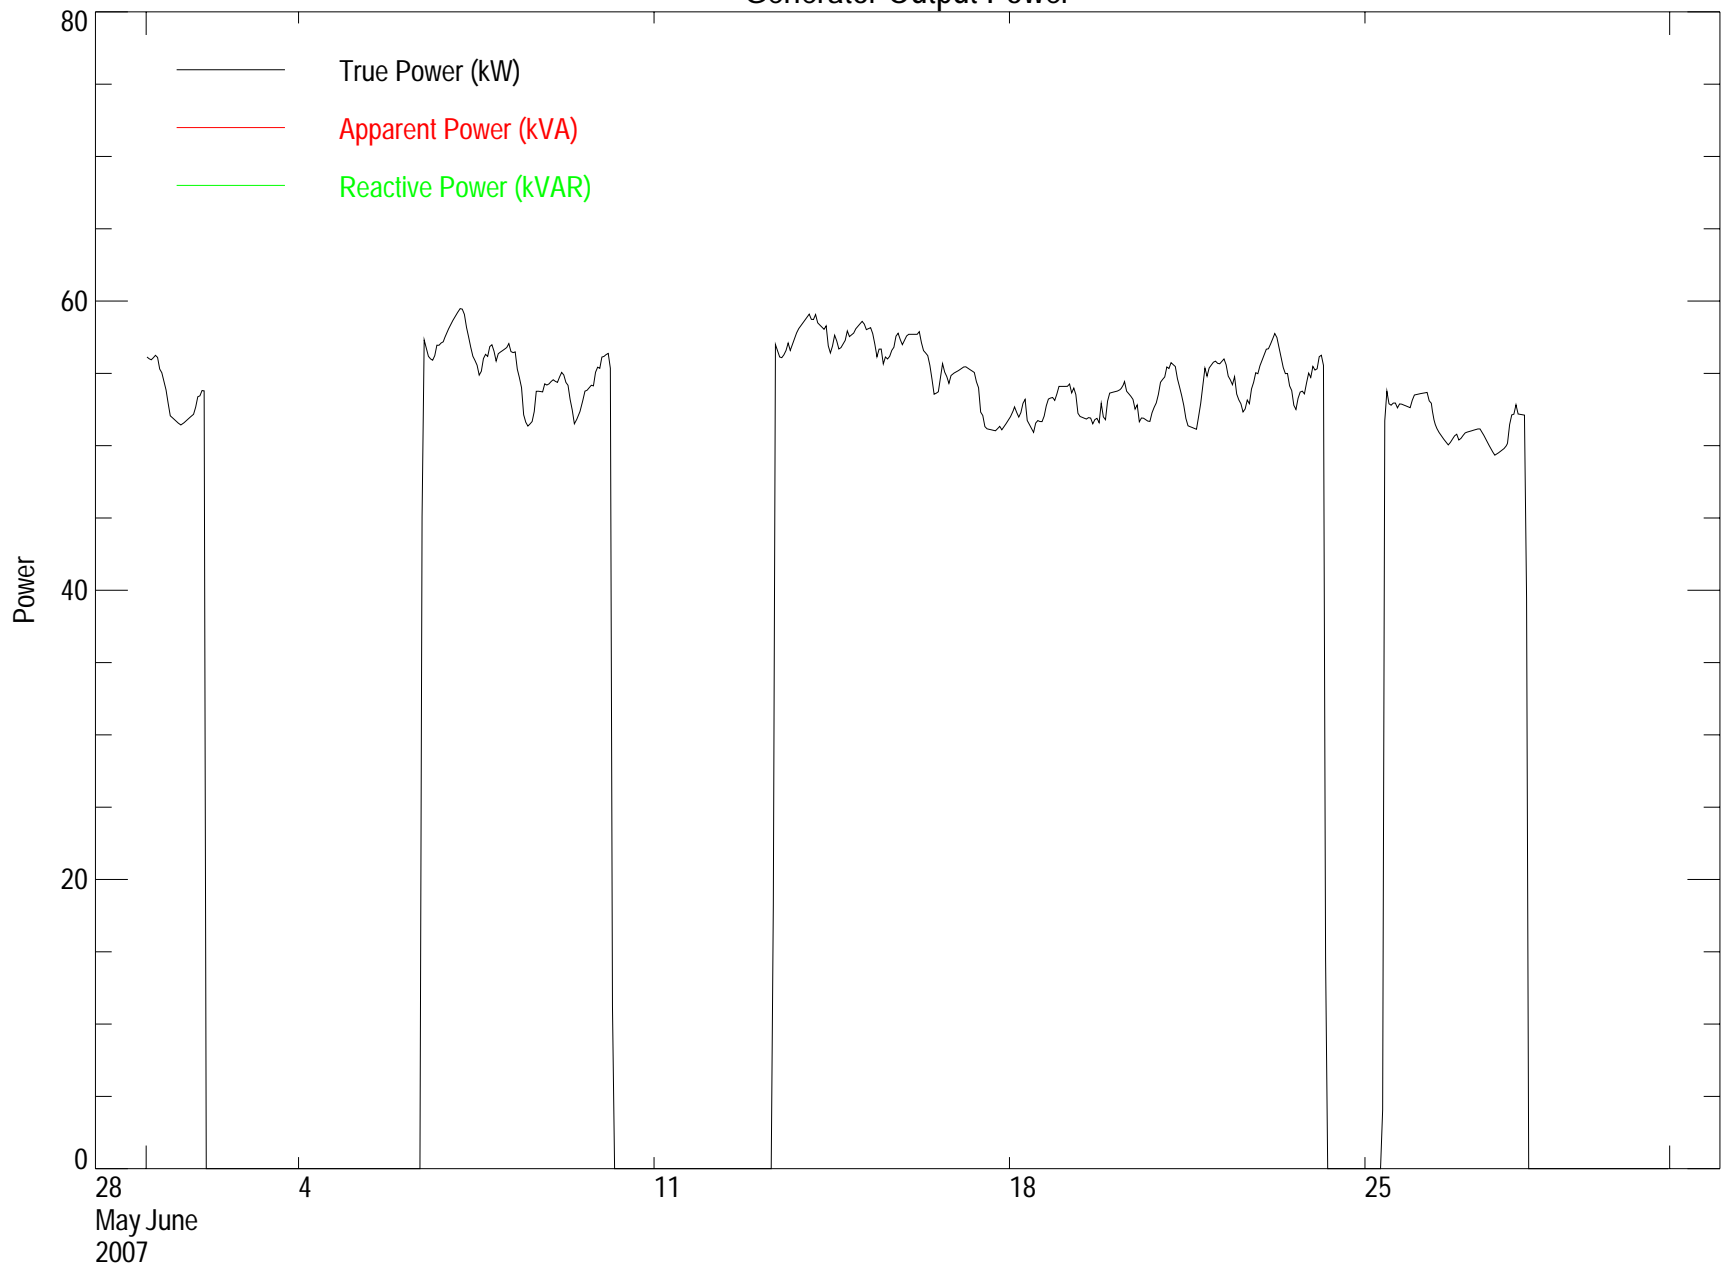

Generator Output Current

