

## GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

09/01/07 to 09/30/07

	Line 1			Line 2			Line 3			Totals		
	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max	Min	Avg	Max
Voltage (V)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current (amps)	0.10	77.99	100.54	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
True Power (kW)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	1.1	50.9	62.2
Apparent Power (kVA)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Power Factor (-)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Voltage THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Current THD (%)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Frequency (hz)	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a


## GENERATOR POWER QUALITY - DATA SUMMARY

Ten West 66th St. Corp.

09/01/07 to 09/30/07

Date	Good Data (%)	Generator Apparent Power (kVAh)	Generator Reactive Power (kVARh)	Generator True Power (kWh)	Power Factor (-)
09/01/07	100.00	n/a	n/a	1248.51	n/a
09/02/07	100.00	n/a	n/a	1019.39	n/a
09/03/07	100.00	n/a	n/a	790.59	n/a
09/04/07	100.00	n/a	n/a	1201.05	n/a
09/05/07	100.00	n/a	n/a	1220.91	n/a
09/06/07	100.00	n/a	n/a	1212.75	n/a
09/07/07	100.00	n/a	n/a	868.83	n/a
09/08/07	100.00	n/a	n/a	1176.79	n/a
09/09/07	100.00	n/a	n/a	929.06	n/a
09/10/07	100.00	n/a	n/a	171.41	n/a
09/11/07	100.00	n/a	n/a	543.60	n/a
09/12/07	100.00	n/a	n/a	709.51	n/a
09/13/07	100.00	n/a	n/a	208.37	n/a
09/14/07	100.00	n/a	n/a	0.00	n/a
09/15/07	100.00	n/a	n/a	0.00	n/a
09/16/07	100.00	n/a	n/a	0.00	n/a
09/17/07	100.00	n/a	n/a	913.73	n/a
09/18/07	100.00	n/a	n/a	1329.41	n/a
09/19/07	100.00	n/a	n/a	1291.97	n/a
09/20/07	100.00	n/a	n/a	1250.50	n/a
09/21/07	100.00	n/a	n/a	1225.83	n/a
09/22/07	100.00	n/a	n/a	1253.22	n/a
09/23/07	100.00	n/a	n/a	1118.92	n/a
09/24/07	100.00	n/a	n/a	185.94	n/a
09/25/07	100.00	n/a	n/a	392.96	n/a
09/26/07	100.00	n/a	n/a	719.18	n/a
09/27/07	100.00	n/a	n/a	672.64	n/a
09/28/07	100.00	n/a	n/a	1196.08	n/a
09/29/07	100.00	n/a	n/a	238.64	n/a
09/30/07	100.00	n/a	n/a	842.34	n/a
Total	100.00	n/a	n/a	23932.13	n/a

# Generator Output Power

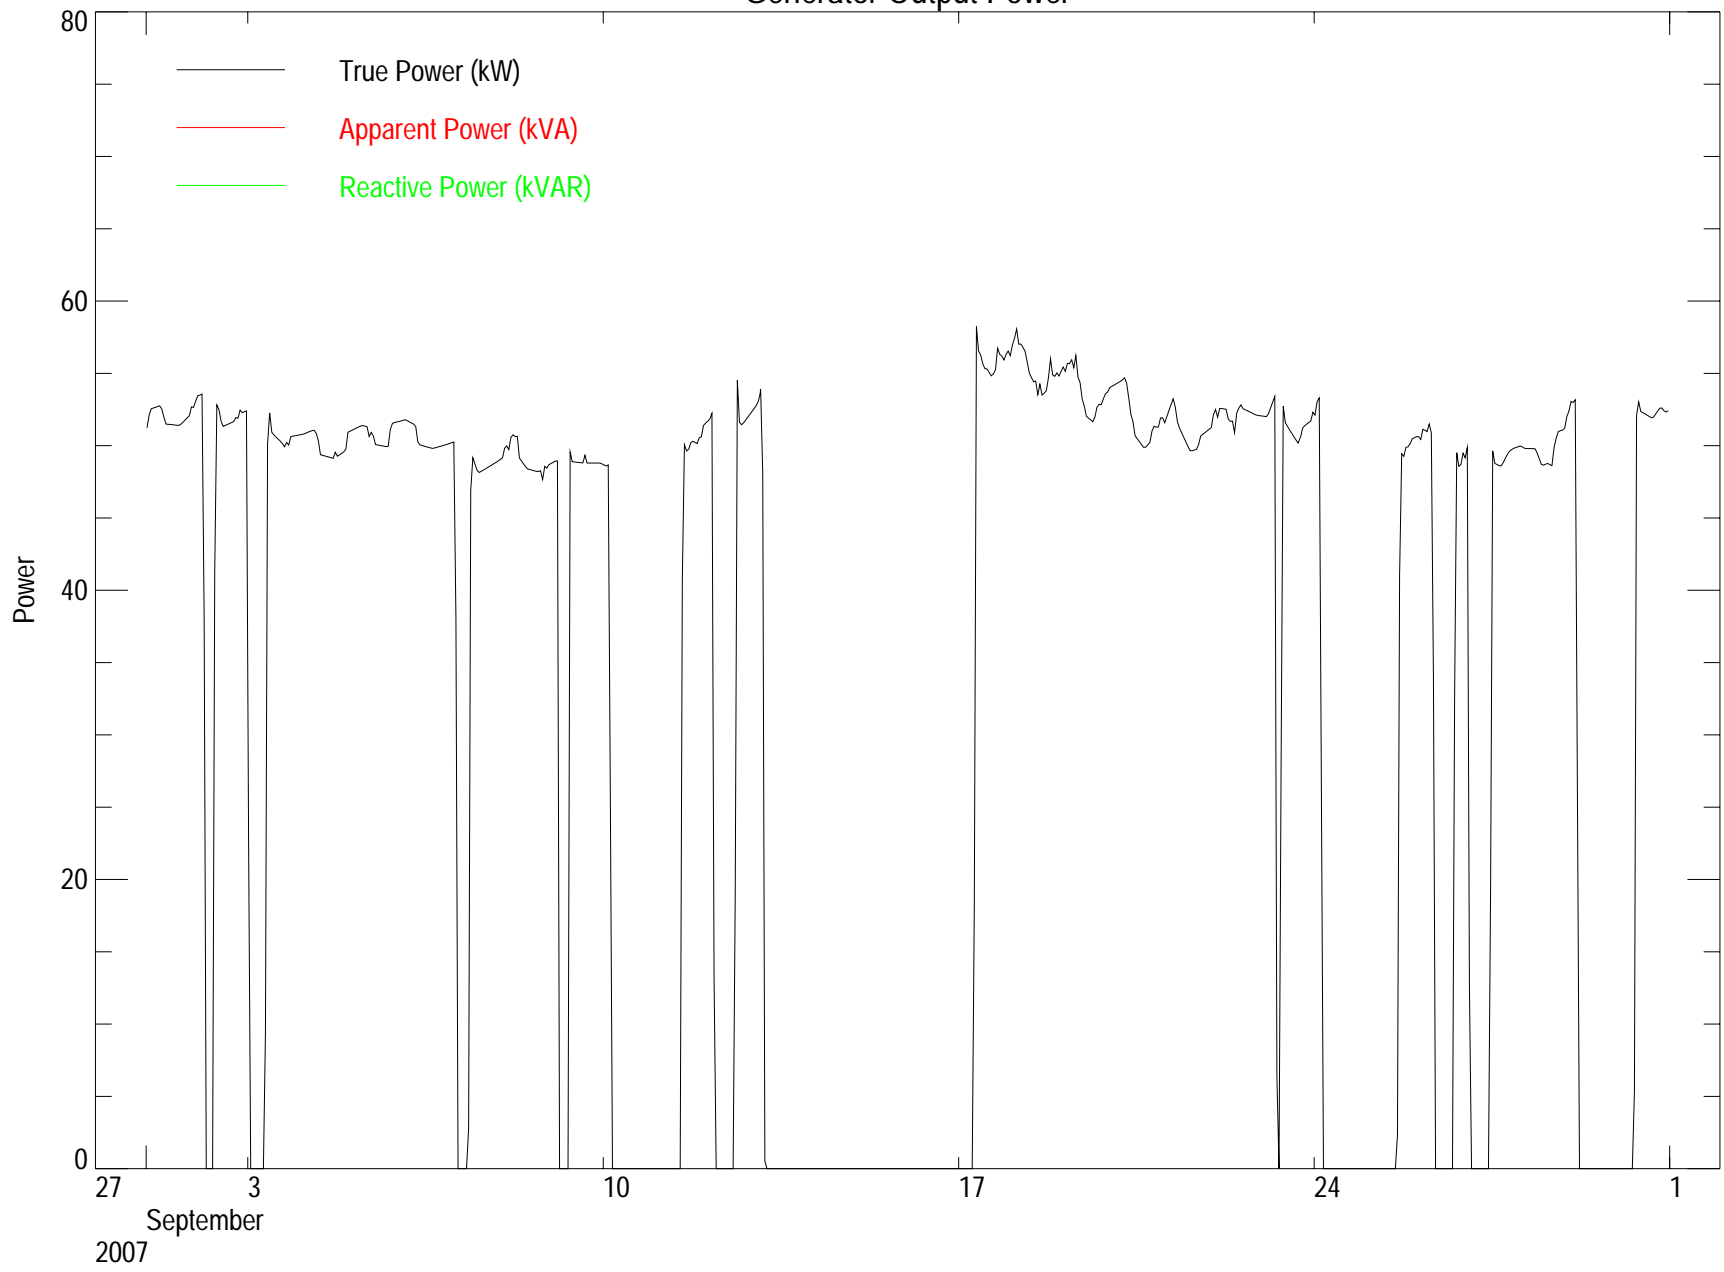

# Generator Output Current

